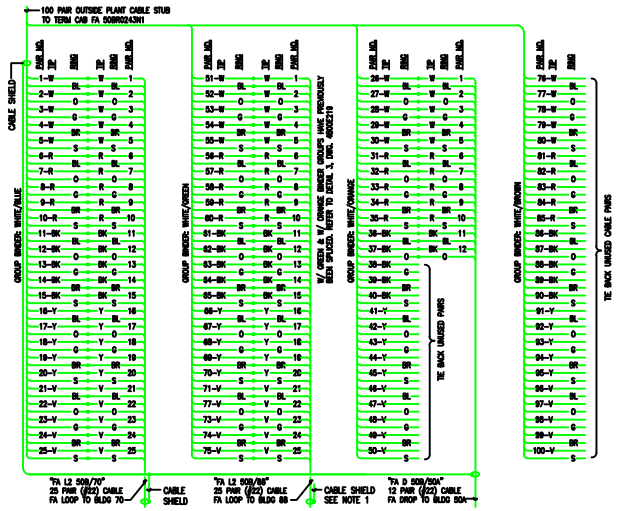

BLDG 50B – SPLICING DIAGRAM (1) 4B00E233

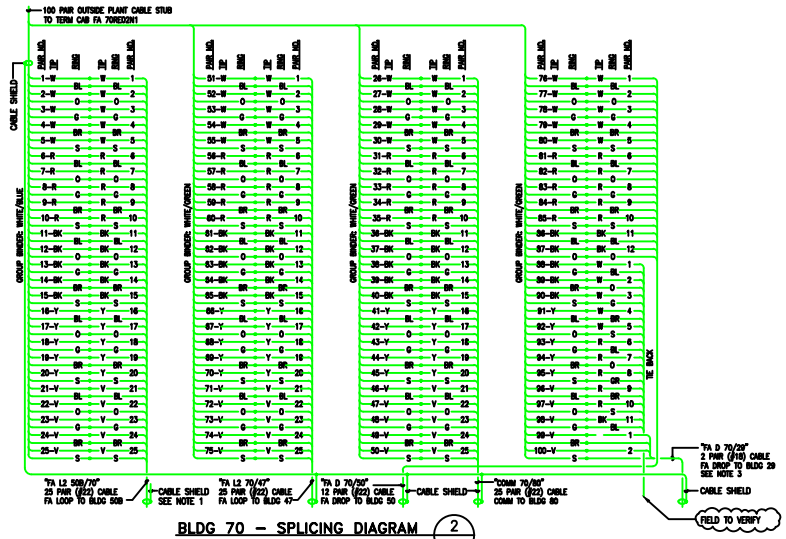

BLDG 70 – SPLICING DIAGRAM (2) 4B00E233

NOTES:

1. DO NOT MAKE ANY ELECTRICAL CONNECTIONS TO THE SHIELDS OF EITHER CABLE IN THIS SPLICE CASE.
2. DO NOT MAKE ANY ELECTRICAL CONNECTIONS TO THE CABLE SHIELDS OF EITHER INCOMING OR OUTGOING CABLES IN THIS SPLICE CASE. THE LOCAL DROP CABLES ARE GROUNDED ONLY AT THE BRIDGE-ISOLATOR INTERFACE PORTS.
3. 2 PR (#18) DROP CABLE (UL LISTED SUBJECT 1424). COLOR CODING VARIES WITH MNFR. FOR MOHAWK CAT. #274: PR (1) BK & R PR (2) BK & BL.

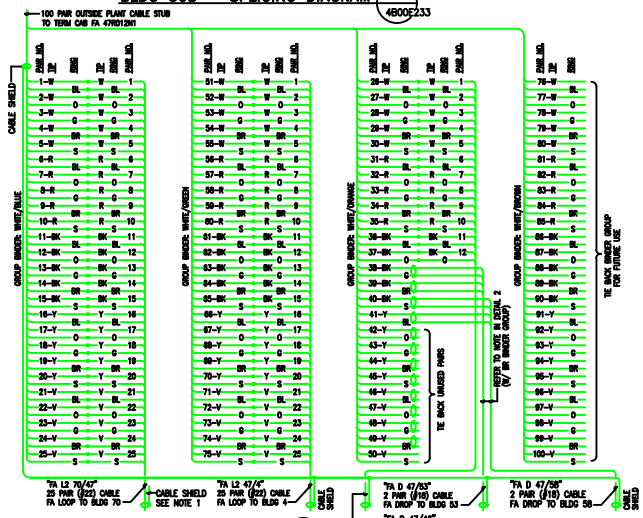

BLDG 47 – SPLICING DIAGRAM (3) 4B00E233

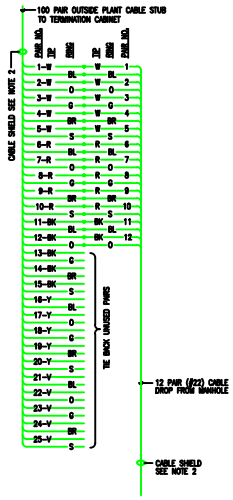

TYP SPLICING DIAGRAM LOCAL DROPS (4) 4B00E233

COLOR CODES:

BL	BLUE
BK	BLACK
BR	BROWN
G	GREEN
O	ORANGE
R	RED
S	SLATE
V	VIOLET
W	WHITE
Y	YELLOW

DISTRIBUTION LIST:

2–ELECTRIC SHOP 876 (FILE I & II)
1–BWOJ (FILE III)
1–STICK FILE B90J
ORIGINAL–FLAT FILE B90F

A	LM	ROB	MG	3/12/96	AUTOCAD CONVERSION

00 FIRE ALARM/EMCS
BLDG 47, 50B & 70
CABLE PLANT SPLICING DIAGRAM

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	JBR	DATE 8/2/82
CHECKED BY	RG	2/11/83
APPROVED BY	ROB	4/12/83
CAD FILE PATH	00007128	
SCALE	NONE	
DRAWING NO.	4B00E233A	SHEET E20
PROJECT NO.	FA8040	1 OF 1