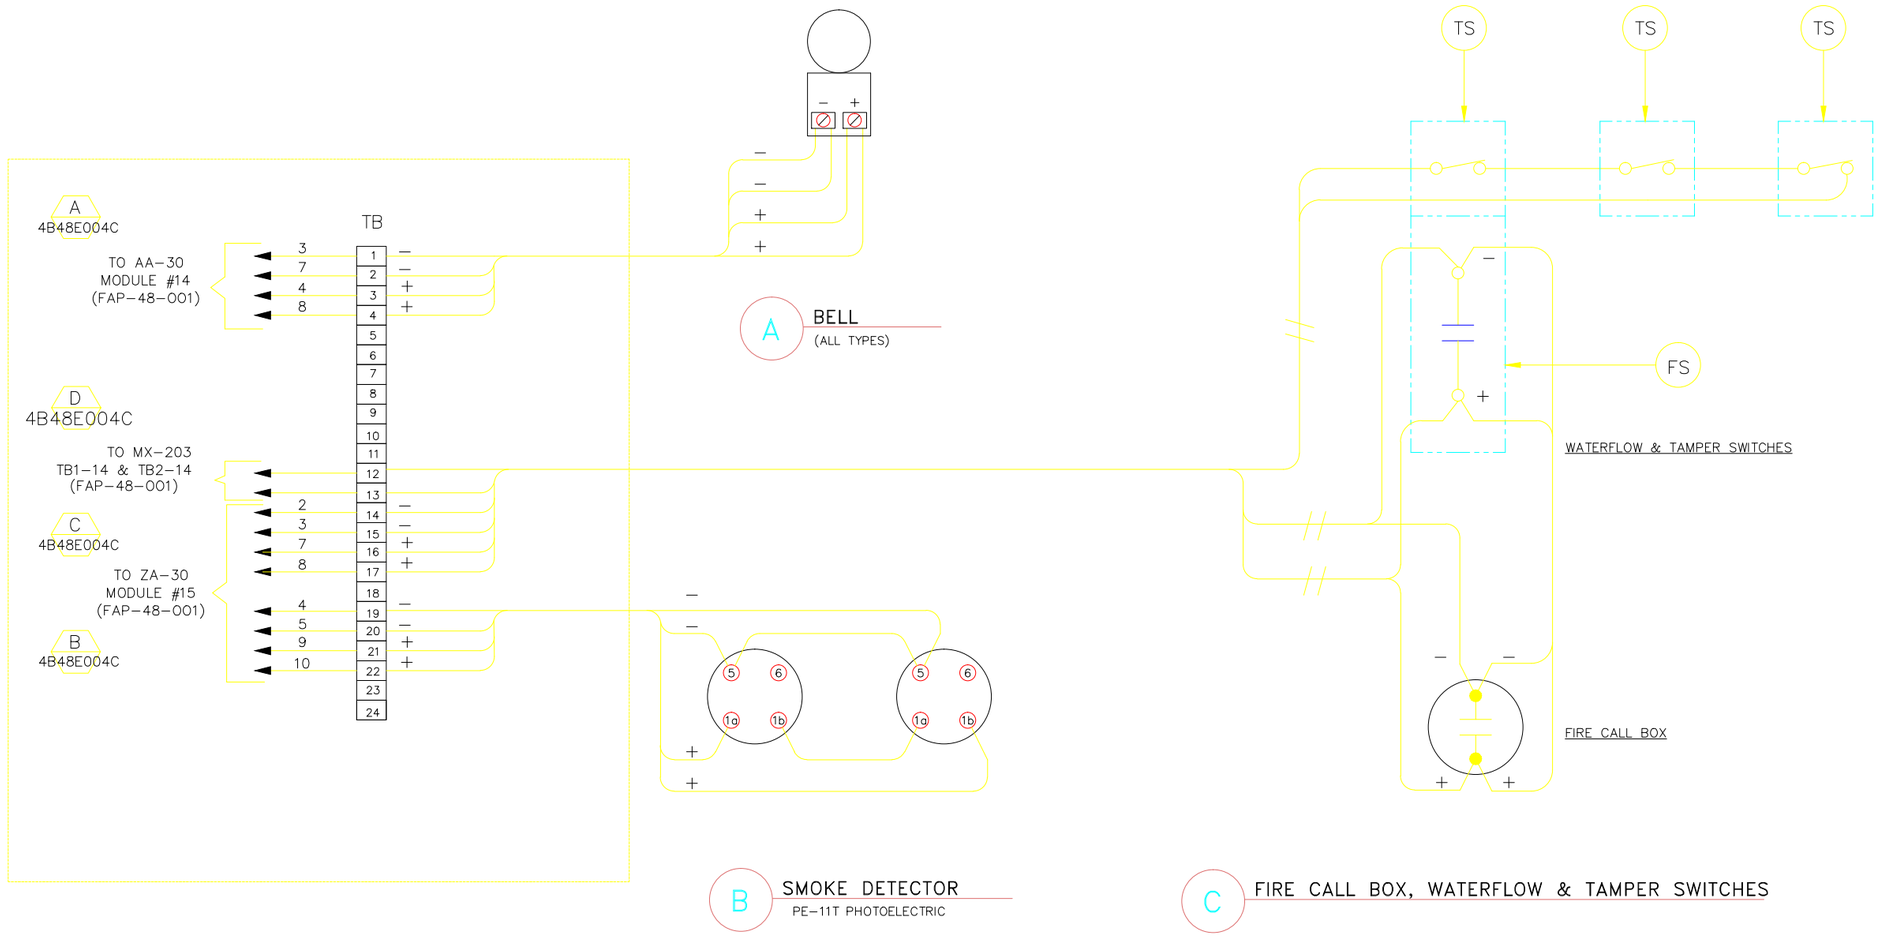

NOTES:

1. SPLIT IONIZATION AND PHOTOELECTRIC SMOKE DETECTORS 50-50%
2. REFER TO SPEC 16721 AND CONSTRUCTION DRAWINGS FOR WIRE SIZE AND TYPE.
3. END OF LINE DEVICE REQUIRED IN CONTROL PANEL FOR ALL FOUR WIRE DEVICES.

REF DWG 4BSTE002

REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS

28 RADIO EQUIPMENT SHELTER
FIRE ALARM SYSTEM
FIELD WIRING DIAGRAM DETAILS

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	VDA	1/23/2004
CHECKED BY	MCG	1/26/2004
APPROVED BY	MCG	1/27/2004
CAD FILE PATH	00017011	
SCALE	As Noted	
DRAWING NO.	4B28E008_	
PROJECT NO.	FM1255	
SHEET	E-1	1 OF 1