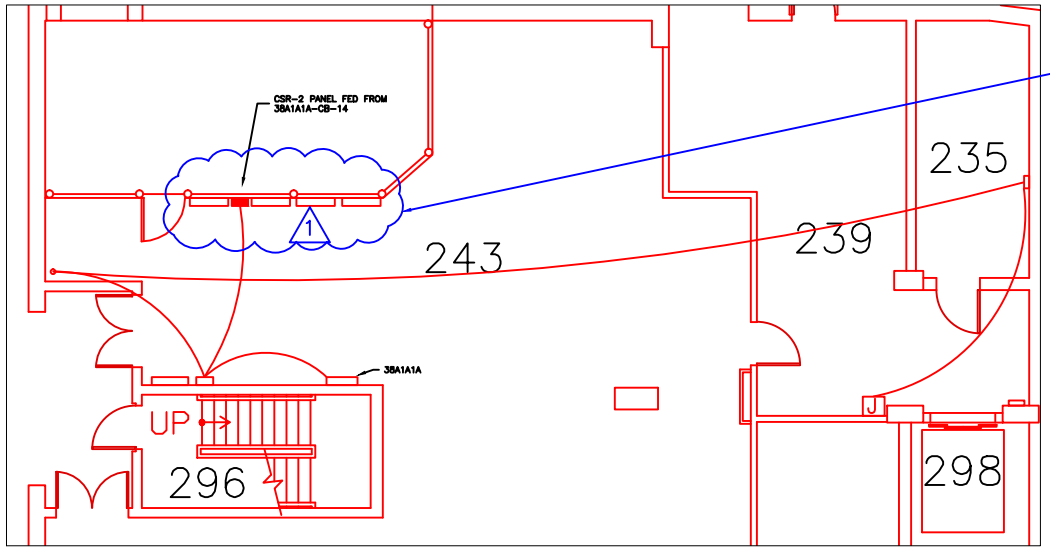

1 EXISTING BASEMENT RACEWAY & PANEL LOCATION
SCALE: 1/4" = 1'-0"

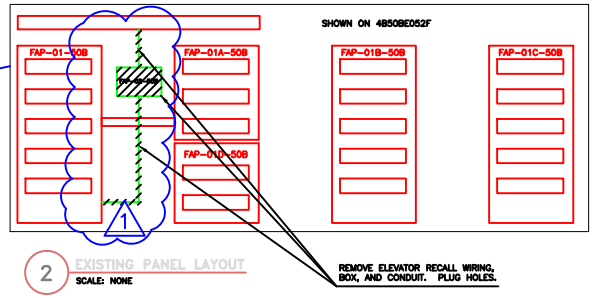

2 EXISTING PANEL LAYOUT
SCALE: NONE

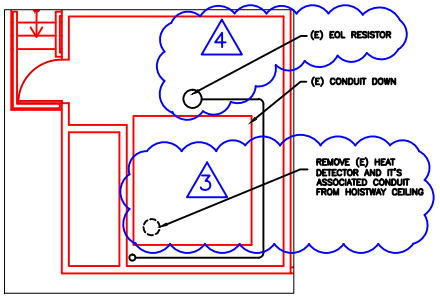

4 EXISTING MACHINE ROOM LAYOUT
SCALE: 1/4" = 1'-0"

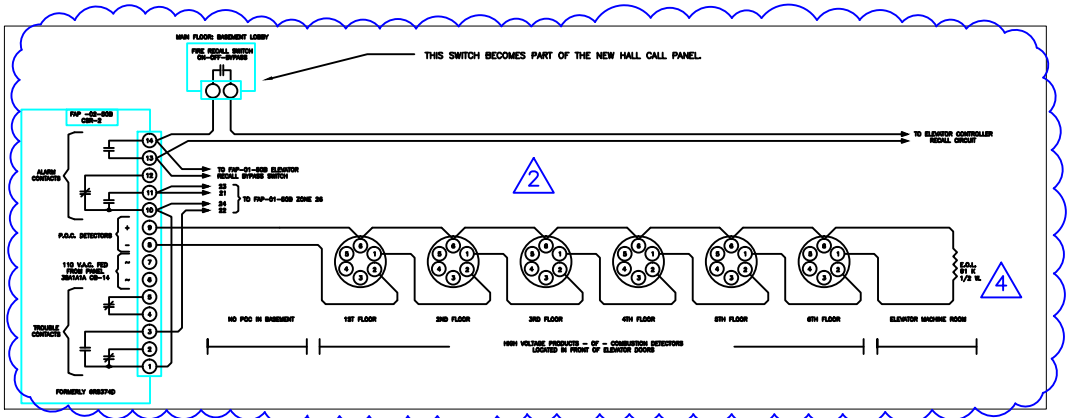

3 EXISTING ELEVATOR RECALL AND DETECTOR WIRING (FORMERLY 6R8374D)
SCALE: NONE

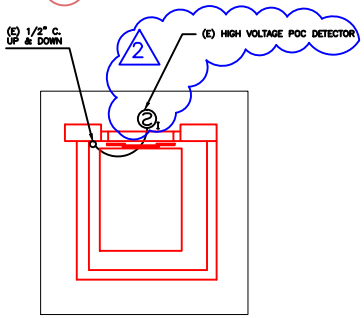

5 EXISTING ELEVATOR LOBBY SMOKE DETECTOR LAYOUT
SCALE: 1/4" = 1'-0"

NOTES

1. REMOVE EXISTING ELEVATOR RECALL PANEL, CONDUIT AND BOX LOCATED ON BACKBOARD AS NOTED. PLUG HOLES INTO FAP AS REQUIRED.
2. REMOVE EXISTING ELEVATOR RECALL LOBBY SMOKE DETECTORS AND WIRING AS NOTED.
3. REMOVE EXISTING HEAT DETECTOR, MOUNTING BOX, ASSOCIATED CONDUIT AND WIRING FROM HOISTWAY CEILING.
4. REMOVE EXISTING ELEVATOR RECALL SMOKE DETECTOR EOL RESISTOR AND WIRING.

DISTRIBUTION LIST
2-ELECTRIC SHOP 76 (FILE I & II)
1-BLDG 90J (FILE III)
1-BLDG 90J (STICK FILE)

T-II BID/JO
4/16/2002

PROFESSIONAL SEAL (IF SEALED, STAMP ONLY TO SEALED SHEET)

ISSUE	PROGRESS PRINTS, PS, CONSTRUCTION, CONTROLS, REVISED, IF-SEALD	REVISION NUMBER	DRAWN BY	CHECKED BY	APPD'D BY	DATE	REMARKS

50B FIRE ALARM SYSTEM
ELEVATOR RECALL
DEMOLITION PLAN

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	GMS	DATE 4/16/2002
CHECKED BY	MCG	4/16/2002
APPROVED BY	MCG	4/16/2002
CAD FILE PATH	C0013911	
SCALE	As Noted	
DRAWING NO.	4B50BE243_	SHEET E1 OF
PROJECT NO.	FE2002	