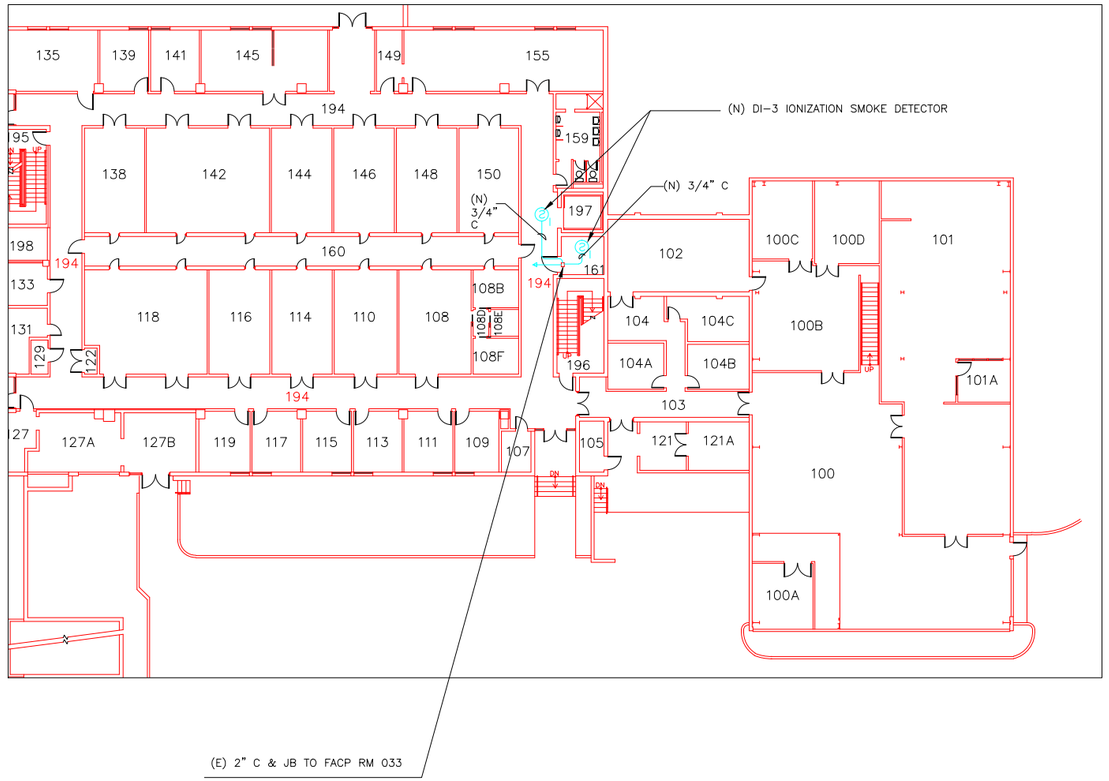

TO ALARM DEVICES: 14 BELLS.
DEVICE LOCATIONS: ORIGINAL A/E DRAWINGS E3, E4, AND E5.
WIRE NUMBERS: 1ST DIGIT IS OLD TB No. 2ND & 3RD ARE LAST TWO DIGITS OF ZONE No.

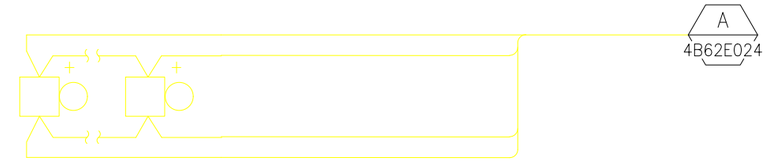

HOLD FOR EXISTING CONDITION INFORMATION

2 1ST FLOOR ALARM DEVICES
SCALE: NONE

FROM INITIATING DEVICES.
DEVICE LOCATIONS: ORIGINAL A/E DRAWINGS E3, E4, AND E5.
WIRE NUMBERS: 1ST DIGIT IS OLD TB No. 2ND & 3RD ARE LAST TWO DIGITS OF ZONE No.

HOLD FOR EXISTING CONDITION INFORMATION

3 1ST FLOOR INITIATING DEVICES
SCALE: NONE

SYMOBLS

PYROTRONICS MODEL DI-3 IONIZATION SMOKE DETECTOR

NOTES

1. SMOKE DETECTORS ARE PYROTRONICS IONIAZTION TYPE, MODEL DI-3

REFERENCE DRAWINGS

1. 4B62E011 BLDG 62 FIRE ALARM SYSTEM SYS 3 WIRING DIAGRAM
2. 4B62E024 BLDG 62 FIRE ALARM SYSTEM TX 113, 114 ZONE WIRING DIAGRAM
3. 4B62E057 BLDG 62 FIRE ALARM SYSTEM LOGIC DIAGRAM
4. 4B62E058 BLDG 62 FIRE ALARM SYSTEM 1ST FLOOR & 62A INIT / ALARM DEVICES — THIS DRAWING
5. 4B62E059 BLDG 62 FIRE ALARM SYSTEM 2ND FLOOR INIT / ALARM DEVICES
6. 4B62E060 BLDG 62 FIRE ALARM SYSTEM 3RD FLOOR INIT / ALARM DEVICES
7. 4B62E061 BLDG 62 FIRE ALARM SYSTEM ELEV & MISC INIT / ALARM DEVICES

DISTRIBUTION LIST:

2-ELECTRIC SHOP B76 (FILE I & II)
1-B90J (FILE III)
1-STICK FILE B90J
ORIGINAL-FLAT FILE B90F

PROFESSIONAL SEAL (IF REVISION, APPLIES ONLY TO REVISED WORK)	ISSUE (PROGRESS, ESTIMATE, BID, CONSTRUCTION, CONFORMED, REVISION, AS-BUILT)	REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS	
	Unfinished 4/18/2001							

62 FIRE ALARM SYSTEM
1ST FLOOR INIT / ALARM DEVICES
WIRING DIAGRAM

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	GMS	DATE 4/18/2001
CHECKED BY	MCG	
APPROVED BY	MCG	
CAD FILE PATH	00012164	
SCALE	As Noted	
DRAWING NO.	4B62E058_	SHEET
PROJECT NO.	308021	