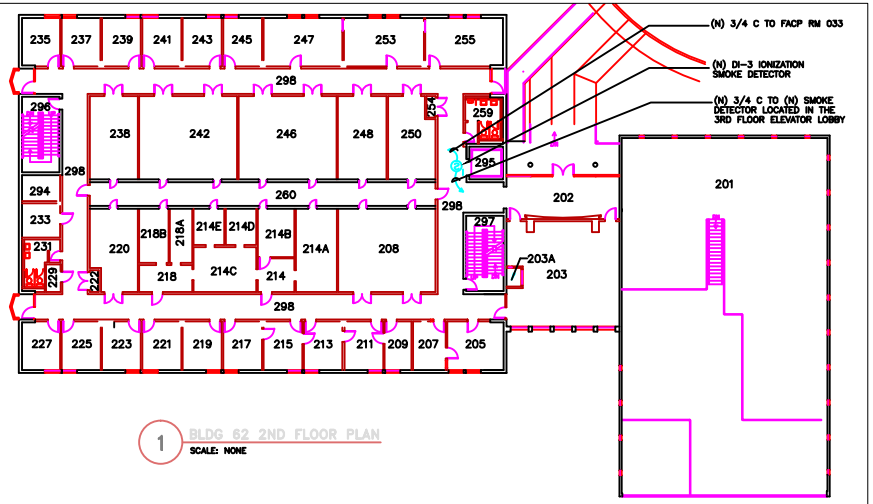

1 BLDG 62 2ND FLOOR PLAN
SCALE: NONE

TO ALARM DEVICES: 14 BELLS.
DEVICE LOCATIONS: ORIGINAL A/E DRAWINGS E3, E4, AND E5.
WIRE NUMBERS: 1ST DIGIT IS OLD TB No. 2ND & 3RD ARE LAST TWO DIGITS OF ZONE No.

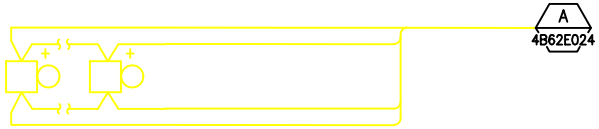

HOLD FOR EXISTING CONDITION INFORMATION

2 2ND FLOOR ALARM DEVICES
SCALE: NONE

FROM INITIATING DEVICES.
DEVICE LOCATIONS: ORIGINAL A/E DRAWINGS E3, E4, AND E5.
WIRE NUMBERS: 1ST DIGIT IS OLD TB No. 2ND & 3RD ARE LAST TWO DIGITS OF ZONE No.

HOLD FOR EXISTING CONDITION INFORMATION

3 2ND FLOOR INITIATING DEVICES
SCALE: NONE

SYMOBLS

PYROTRONICS MODEL DI-3 IONIZATION SMOKE DETECTOR

NOTES

1. SMOKE DETECTORS ARE PYROTRONICS IONIAZTION TYPE, MODEL DI-3
2. CONNECT SMOKE DETECTORS FOR ELEVATOR LOBBIES ON THE 2ND AND 3RD FLOOR TOGETHER AND RUN TO FACP IN RM. 033. REFER TO 4B062E061 FOR WIRING DETAILS.

REFERENCE DRAWINGS

1. 4B62E011 BLDG 62 FIRE ALARM SYSTEM SYS 3 WIRING DIAGRAM
2. 4B62E024 BLDG 62 FIRE ALARM SYSTEM TX 113, 114 ZONE WIRING DIAGRAM
3. 4B62E057 BLDG 62 FIRE ALARM SYSTEM LOGIC DIAGRAM
4. 4B62E058 BLDG 62 FIRE ALARM SYSTEM 1ST FLOOR & 62A INIT / ALARM DEVICES
5. 4B62E059 BLDG 62 FIRE ALARM SYSTEM 2ND FLOOR INIT / ALARM DEVICES — THIS DRAWING
6. 4B62E060 BLDG 62 FIRE ALARM SYSTEM 3RD FLOOR INIT / ALARM DEVICES
7. 4B62E061 BLDG 62 FIRE ALARM SYSTEM ELEV & MISC INIT / ALARM DEVICES

DISTRIBUTION LIST:
2-ELECTRIC SHOP B76 (FILE I & II)
1-B90J (FILE III)
1-STICK FILE B90J
ORIGINAL-FLAT FILE B90F

T-ii Bid/jo
4/18/2001

62 FIRE ALARM SYSTEM
2ND FLOOR INIT / ALARM DEVICES
WIRING DIAGRAM

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	GMS
DATE	4/18/2001
CHECKED BY	MCO
APPROVED BY	MCO
CAD FILE PATH	C0012185
SCALE	As Noted
DRAWING NO.	4B62E059_
SHEET	
PROJECT NO.	308021