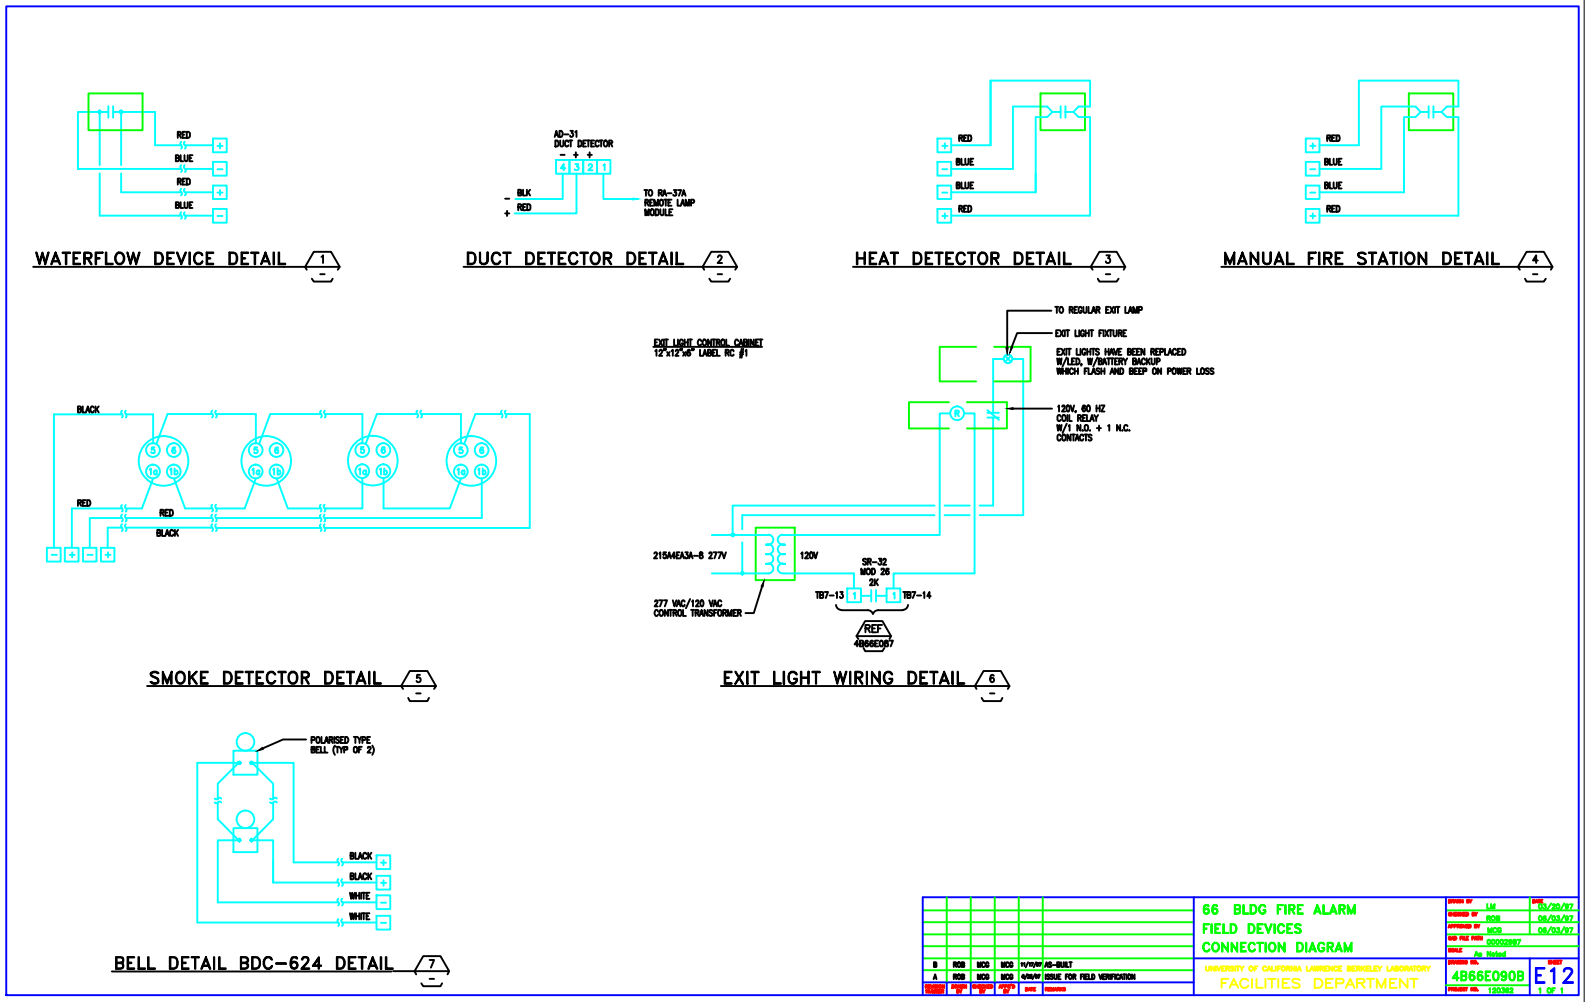

RED
BLUE
RED
BLUE
WATERFLOW DEVICE DETAIL 1
AD-31
DUCT DETECTOR
4 3 2 1
BLK
RED
TO RA-37A
REMOTE LAMP
MODULE
DUCT DETECTOR DETAIL 2
RED
BLUE
BLUE
RED
HEAT DETECTOR DETAIL 3
RED
BLUE
BLUE
RED
MANUAL FIRE STATION DETAIL 4
BLACK
RED
RED
BLACK
SMOKE DETECTOR DETAIL 5
EXIT LIGHT CONTROL CABINET
12"x12"x6" LABEL RC #1
TO REGULAR EXIT LAMP
EXIT LIGHT FIXTURE
EXIT LIGHTS HAVE BEEN REPLACED
W/LED, W/BATTERY BACKUP
WHICH FLASH AND BEEP ON POWER LOSS
120V, 60 HZ
COIL RELAY
W/1 N.O. + 1 N.C.
CONTACTS
215A4EA3A-8 277V
120V
SR-32
MOD 26
2K
TB7-13
TB7-14
277 VAC/120 VAC
CONTROL TRANSFORMER
REF
4B66E087
EXIT LIGHT WIRING DETAIL 6
POLARISED TYPE
BELL (TYP OF 2)
BLACK
BLACK
WHITE
WHITE
BELL DETAIL BDC-624 DETAIL 7
B ROB MCG MCG 11/12/97 AS-BUILT
A ROB MCG MCG 4/08/97 ISSUE FOR FIELD VERIFICATION
66 BLDG FIRE ALARM
FIELD DEVICES
CONNECTION DIAGRAM
UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY LABORATORY
FACILITIES DEPARTMENT
LM 03/20/97
ROB 06/03/97
MCG 06/03/97
00002987
As Noted
4B66E090B
E12
1 OF 1
120362