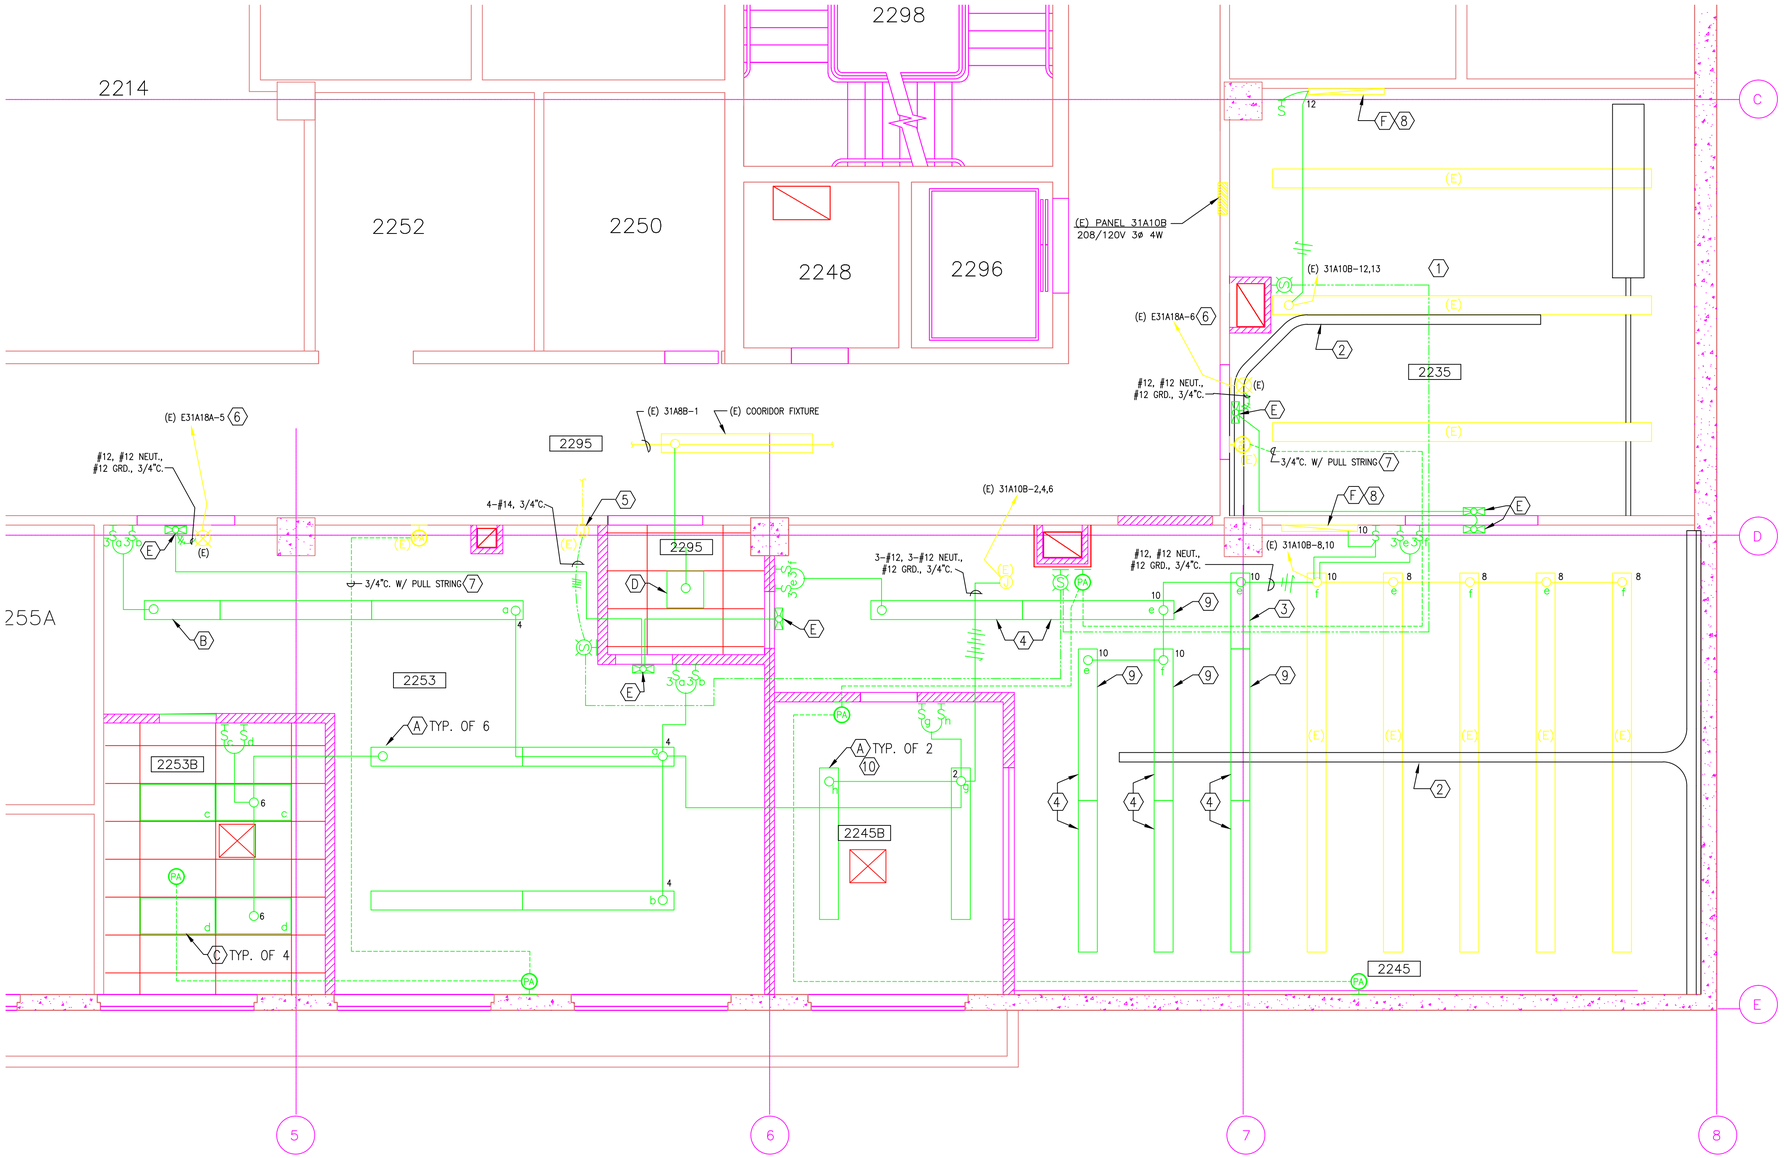

1 PARTIAL FLOOR PLAN
1/4" = 1'-0"



SHEET NOTES

1. NO MODIFICATIONS TO RM 2235 GENERAL LIGHTING.
2. 4" x 1.5" ALUMINUM CHANNEL TRAY, SQUARE D, CLASS 5160 SERIES. MOUNT AT +10'-9" AFF.
3. REPLACE (E) FIXTURE WITH A 4" FIXTURE STORED FOR REUSE IN RM 2253.
4. INSTALL 8' FIXTURE STORED FOR REUSE IN RM 2253. TYP. OF 8.
5. (E) FIRE ALARM J-BOX WITH BELL/STROBE CIRCUIT. COORDINATE TIE-IN WITH PROJECT MANAGER.
6. PANEL E31A8B IS LOCATED AT WEST END OF 2ND FLOOR PERIMETER CORRIDOR.
7. SUBCONTRACTOR TO PROVIDE CONDUIT WITH PULL STRING AND AN OUTLET BOX FOR EACH SPEAKER. LBNL WILL INSTALL SPEAKERS AND WIRING.
8. SEE ARCH. DWGS. FOR MOUNTING HEIGHTS.
9. ALIGN NEW FIXTURES VERTICALLY & HORIZONTALLY WITH EXISTING.
10. SEE ARCH. DWGS. FOR SPACING.

PROFESSIONAL SEAL (IF REVISION, APPLIES ONLY TO REVISED WORK)	TITLE 2 CONSTRUCTION 1/24/03	ISSUE (PROGRESS, ESTIMATE, BID, CONSTRUCTION, CONFORMED, REVISION, AS-BUILT)	REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS

70A RMS 2235,2245,2253
LABORATORY MODIFICATIONS
LIGHTING, FIRE ALARM & PA PLAN

DRAWN BY LDD		DATE 1/24/03
CHECKED BY MCG		1/24/03
APPROVED BY MCG		1/24/03
CAD FILE PATH 00015516		
SCALE As Noted		
DRAWING NO. 4B70AE165_		SHEET E2
PROJECT NO. FM3004		1 OF1

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DEPARTMENT