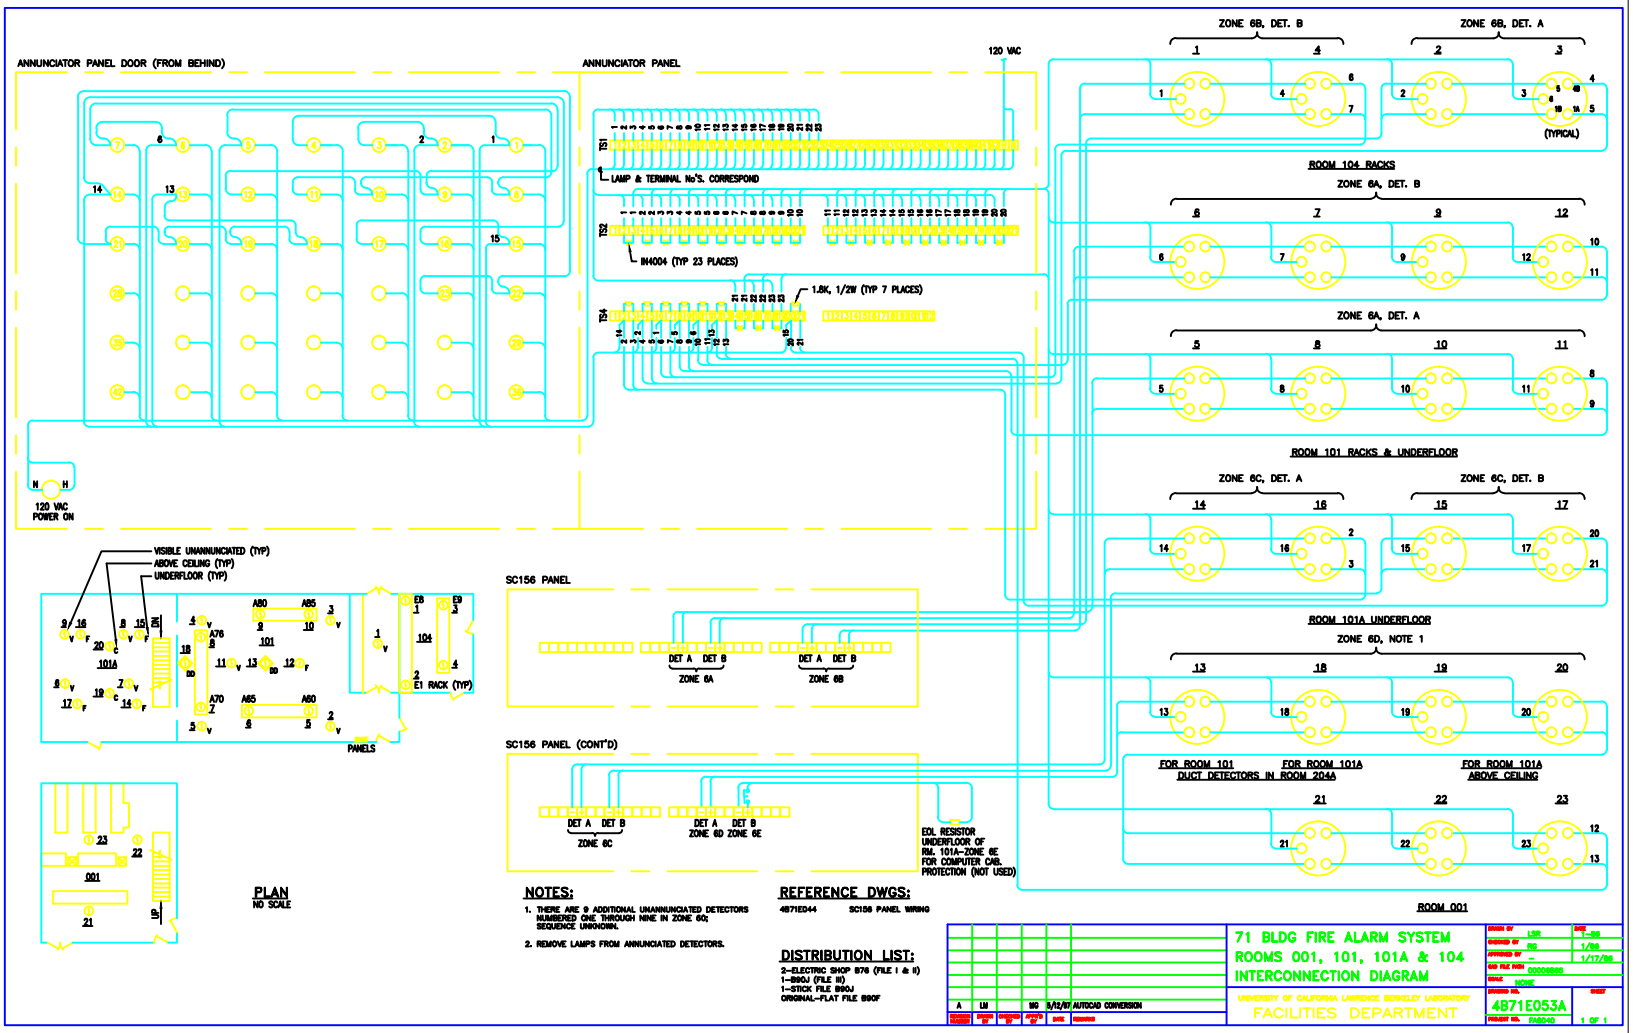

NOTES:

1. THERE ARE 9 ADDITIONAL UNANNUNCIATED DETECTORS NUMBERED ONE THROUGH NINE IN ZONE 6C; SEQUENCE UNKNOWN.
2. REMOVE LAMPS FROM ANNUNCIATED DETECTORS.

REFERENCE DWGS:

4B71E044 SC156 PANEL WIRING

DISTRIBUTION LIST:

2–ELECTRIC SHOP B76 (FILE I & II)
1–B90J (FILE III)
1–STICK FILE B90J
ORIGINAL–FLAT FILE B90F

A	LM		BG	5/12/97	AUTOCAD CONVERSION

71 BLDG FIRE ALARM SYSTEM
ROOMS 001, 101, 101A & 104
INTERCONNECTION DIAGRAM

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	LSR	1-98
CHECKED BY	RG	1/98
APPROVED BY	–	1/17/98
CAD FILE PATH	00000885	
SCALE	NONE	
DRAWING NO.	4B71E053A	SHEET 1 OF 1
PROJECT NO.	FA9040	