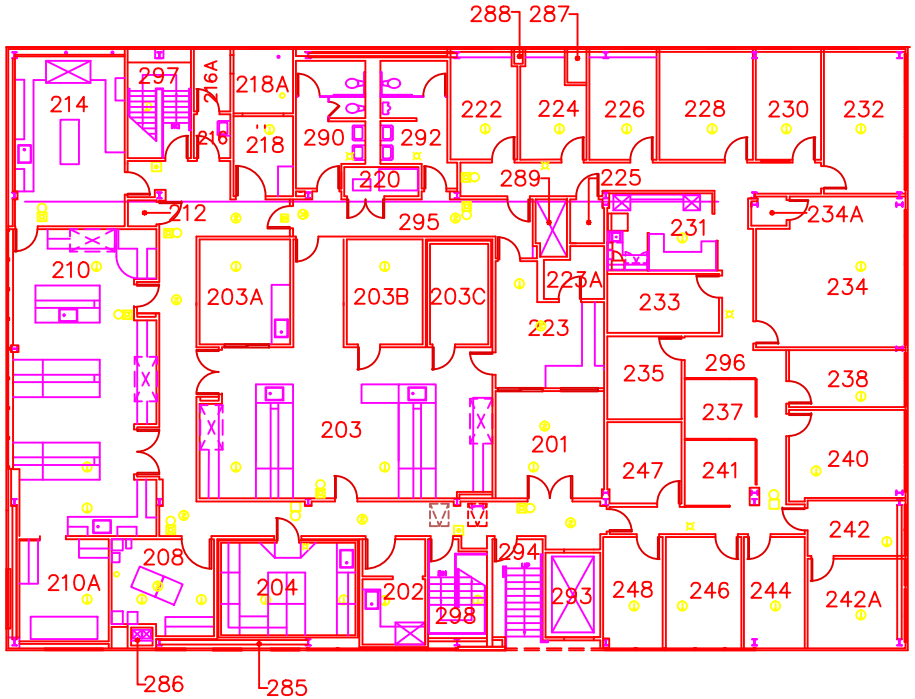

1 PLAN – SECOND FLOOR FIRE CALL BOXES, BELLS STROBES, AND HEAT DETECTORS

0 5 10 20
GRAPHIC SCALE
1/8" = 1' – 0"

N

O&M TO FIELD

AS–BUILT REMOVED HEAT DETECTORS

FIRE ALARM SYMBOLS

- MANUAL ALARM BOX (PULL STATION AND PULL BOX)
- HEAT DETECTOR
- HEAT DETECTOR – PENDANT TYPE
- SMOKE DETECTOR
- FLOW DETECTOR/SWITCH
- TAMPER DETECTOR/SWITCH
- VALVE WITH TAMPER DETECTOR/SWITCH
- OS & Y VALVE (OUTSIDE SCREW & YOKE, RISING STEM)
- STROBE AND BELL AS ONE ASSEMBLY
- STROBE ONLY
- BELL ONLY
- ILLUMINATED EXIT SIGN, SINGLE FACE
- DOOR HOLDER, 24VDC

REFERENCE DRAWINGS

1. 4B80E004 BLDG. 80 FIRE ALARM SYSTEM BASEMENT PLAN
2. 4B80E005 BLDG. 80 FIRE ALARM SYSTEM FIRST FLOOR PLAN
3. 4B80E022 BLDG. 80 FIRE ALARM SYSTEM INTERCONNECTION DIAGRAM
4. 4B80E036 BLDG. 80 FIRE ALARM SYSTEM LOGIC

REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS
C	LM	MCG	MCG	9/25/98	CONSTRUCTION COMPLETE, FIELD TO VERIFY
B	ROB	ROB	MCG	10/4/94	ADD DOOR HOLDER, EXIT LITE, NEW FLOOR PLAN
A	PL	GW	MCG	-	ADDED 3 STROBES, RM'S 239 & 298

80
FIRE ALARM SYSTEM
2ND FLOOR PLAN

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DEPARTMENT

DRAWN BY	LSR	DATE 08/18/94
CHECKED BY	JEH	08/22/94
APPROVED BY	ROB	08/23/94
CAD FILE PATH	00007439	
SCALE	1/8=1-0	
DRAWING NO.	4B80E006C	SHEET 1 OF 1
PROJECT NO.	FAB040	