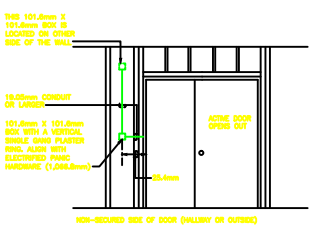

CARD ACCESS DETAIL – FIRST FLOOR
N.T.S.

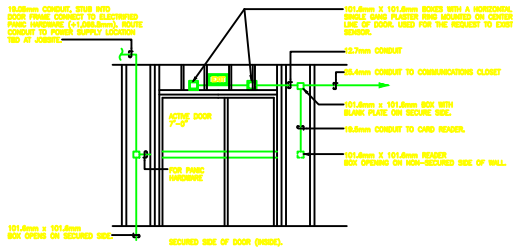

CARD ACCESS DETAIL – FIRST FLOOR
N.T.S.

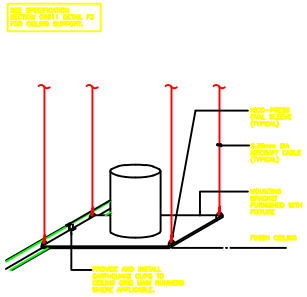

RECESSED DOWNLIGHT FIXTURE MOUNTING DETAIL
N.T.S.

NOTES:

1. ALL CONCEALED WIRING SHALL BE IN CONDUIT, ALL EXPOSED WIRING TO BE IN WIREMOLD.
2. SEE FLOOR PLANS FOR DEVICE QUANTITIES AND LOCATIONS
3. THE FIRE ALARM SYSTEM SHALL NOT BE INSTALLED UNTIL SHOP DRAWINGS, INCLUDING STATE FIRE MARSHALL LISTING NUMBERS FOR EACH COMPONENT OF THE SYSTEM HAVE BEEN SUBMITTED AND APPROVED BY THE STATE FIRE MARSHALL REPRESENTATIVE.
4. THE UNIVERSITY WILL MAKE FINAL CONNECTION TO THE EXISTING SYSTEM.
5. FIRE/SPRINKLER DAMPERS TO CLOSE ON ANY SMOKE DETECTOR ON THE RESPECTIVE FLOOR. RUN 120V DAMPER MOTOR POWER IN SEPARATE CONDUIT TO CIRCUIT FEEDER FIRE ALARM CONTROL PANEL. – VERIFY POWER REQUIREMENTS AND AVAILABLE CIRCUIT CAPACITY PRIOR TO CONNECTION

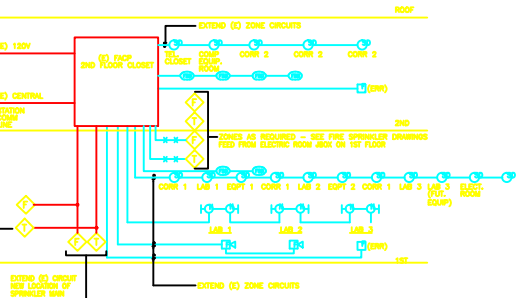

PARTIAL FIRE ALARM DIAGRAM
SCHEMATIC

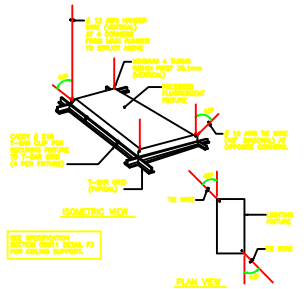

SEE SPECIFICATION SECTION 09511 CEIL F3 FOR CEILING SUPPORT.

RECESSED LIGHT FIXTURE IN T-BAR CEILING MOUNTING DETAIL
N.T.S.

DC-313
DETAILS

1-2-0	PERMIT REVISED DRAWINGS	

BUILDING 72C
OFFICE AND LABORATORY ADDITION
DETAILS

1	09/98	9-30-98
2	A. BRUEHL	3-1-99
3	A. BRUEHL	3-1-99
4		
5		
6		
7		
8		

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY