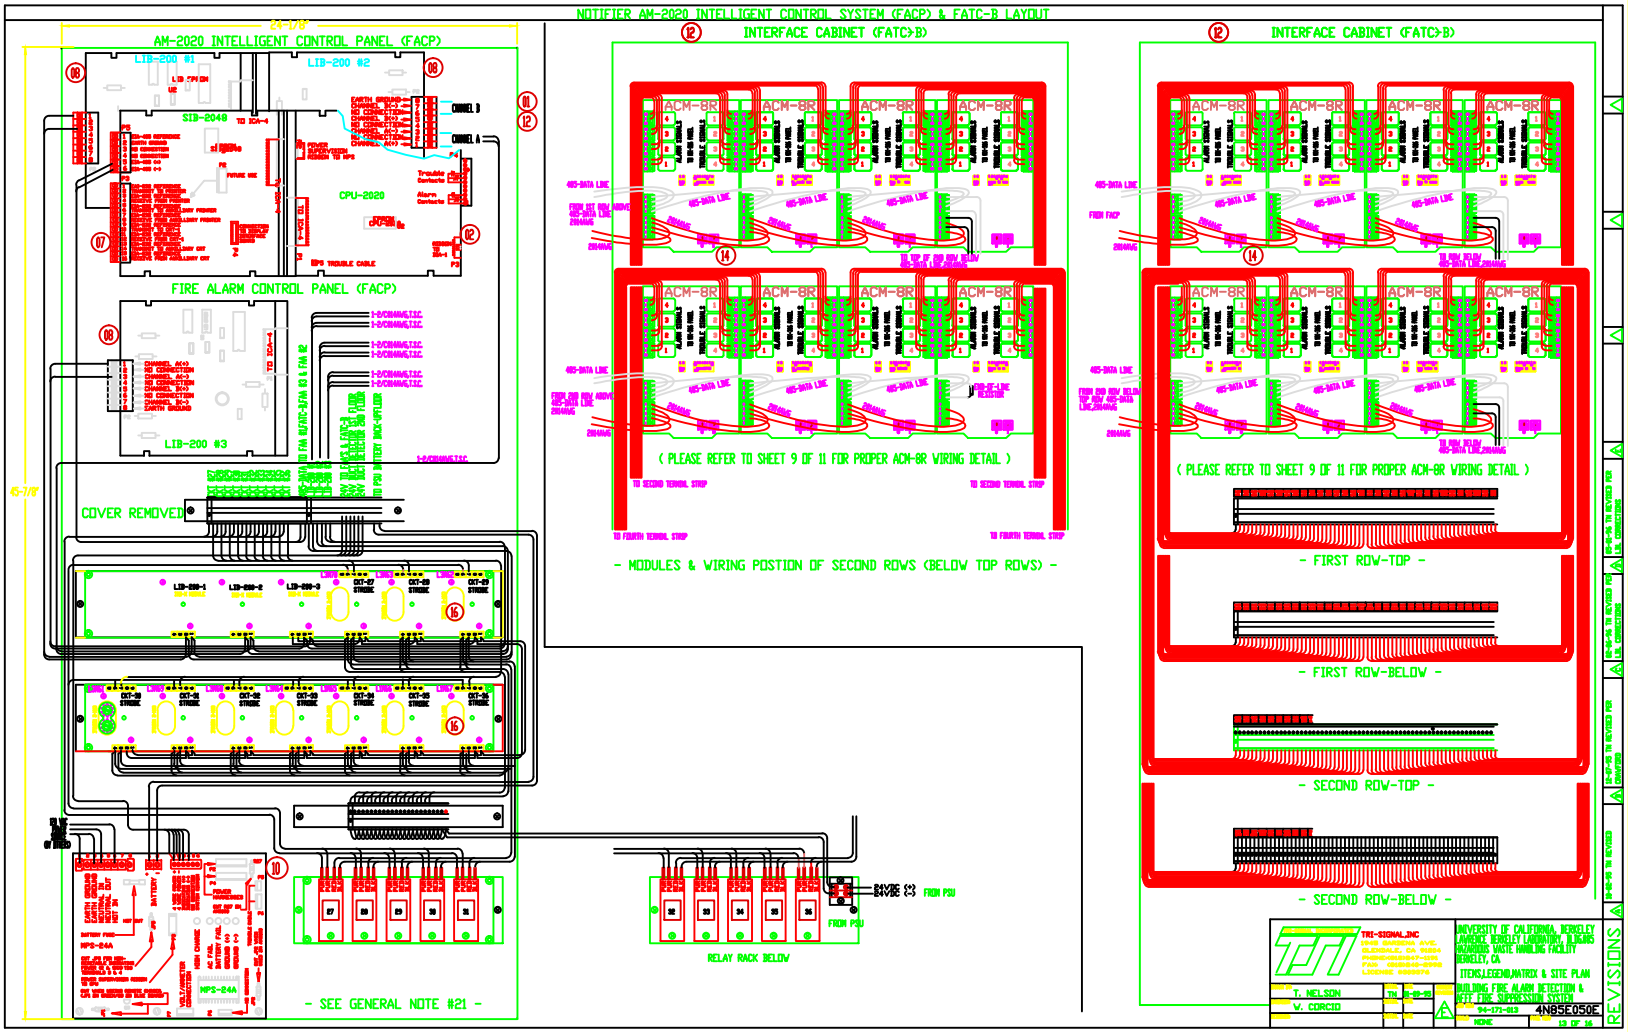
NOTIFIER AM-2020 INTELLIGENT CONTROL SYSTEM (FACP) & FATC-B LAYOUT
AM-2020 INTELLIGENT CONTROL PANEL (FACP)
LIB-200 #1
LIB-200 #2
LIB-200 #3
SIB-2048
CPU-2020
CHANNEL B
CHANNEL A
FIRE ALARM CONTROL PANEL (FACP)
COVER REMOVED
24-1/8"
45-7/8"
- SEE GENERAL NOTE #21 -
INTERFACE CABINET (FATC>B)
ACM-8R
(PLEASE REFER TO SHEET 9 OF 11 FOR PROPER ACM-8R WIRING DETAIL)
- MODULES & WIRING POSTION OF SECOND ROWS (BELOW TOP ROWS) -
- FIRST ROW-TOP -
- FIRST ROW-BELOW -
- SECOND ROW-TOP -
- SECOND ROW-BELOW -
RELAY RACK BELOW
FROM PSU
TRI-SIGNAL,INC
UNIVERSITY OF CALIFORNIA, BERKELEY
ITEMS,LEGEND,MATRIX & SITE PLAN
BUILDING FIRE ALARM DETECTION & AUTO FIRE SUPPRESSION SYSTEM
T. NELSON
W. CORCID
94-171-013
4N85E050E
NONE
13 OF 16
REVISIONS