PROPOSED 120 VAC SUPERVISION FIRE ALARM TERMINAL CABINETS - FATC-G, H, I, J, K, & L LAYOUTS

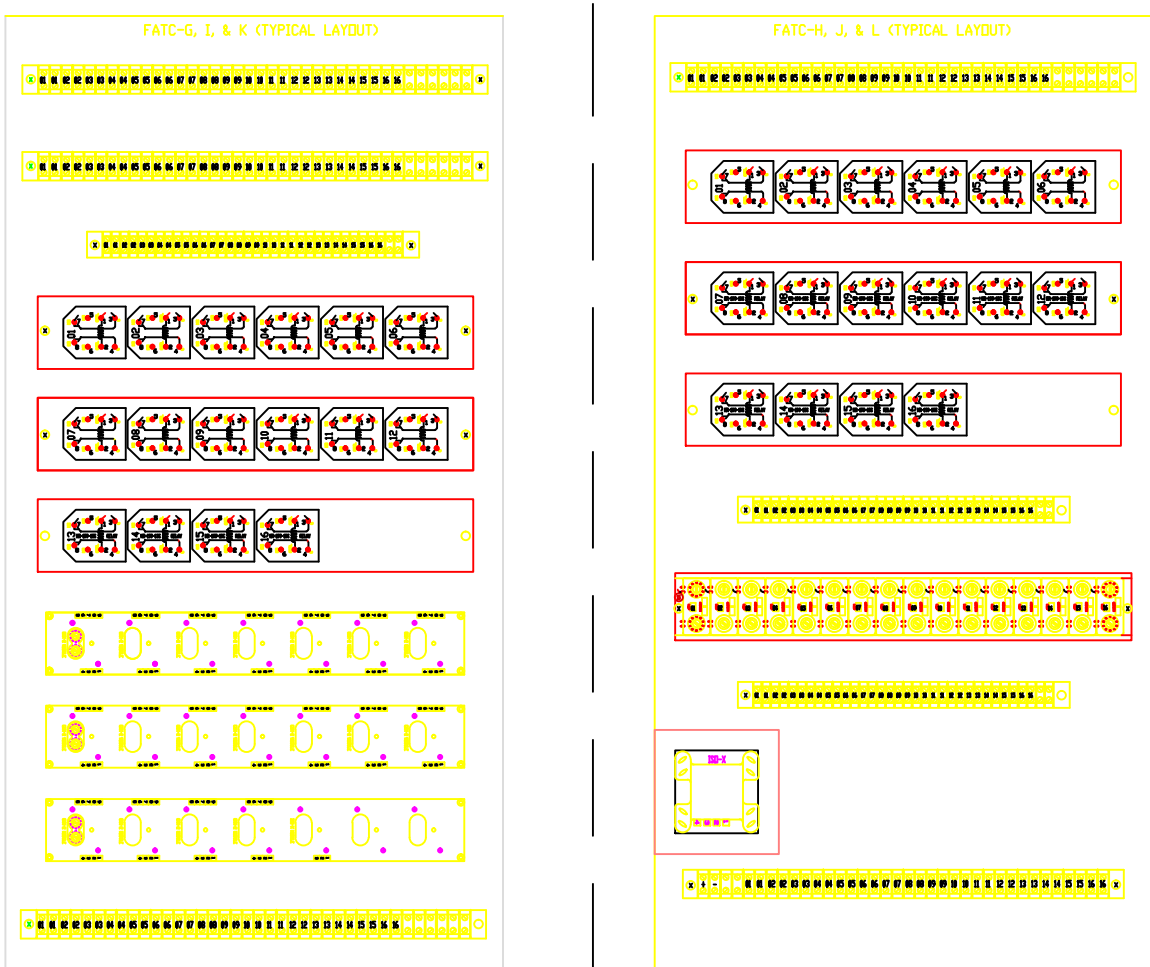


TRI-SIGNAL,INC
1000 SANDOVAL AVE.
GLENDALE, CA 91206
PHONE(818)247-1191
FAX (818)247-2998
LICENSE #0000976

UNIVERSITY OF CALIFORNIA, BERKELEY
LAWRENCE BERKELEY LABORATORY, BLDG.105
HAZARDOUS WASTE HANDLING FACILITY
BERKELEY, CA
PROPOSED 120VAC SUPERVISION
FATC'S G, H, I, J, K, & L
BUILDING FIRE ALARM DETECTION &
AFFF FIRE SUPPRESSION SYSTEM

| | | | |
|---|---|---|---|
| T. NELSON | TN | 8-29-95 | E |
| W. CORCID | | | |

94-171-016 4N85E053E
NONE 16 OF 16

REVISIONS