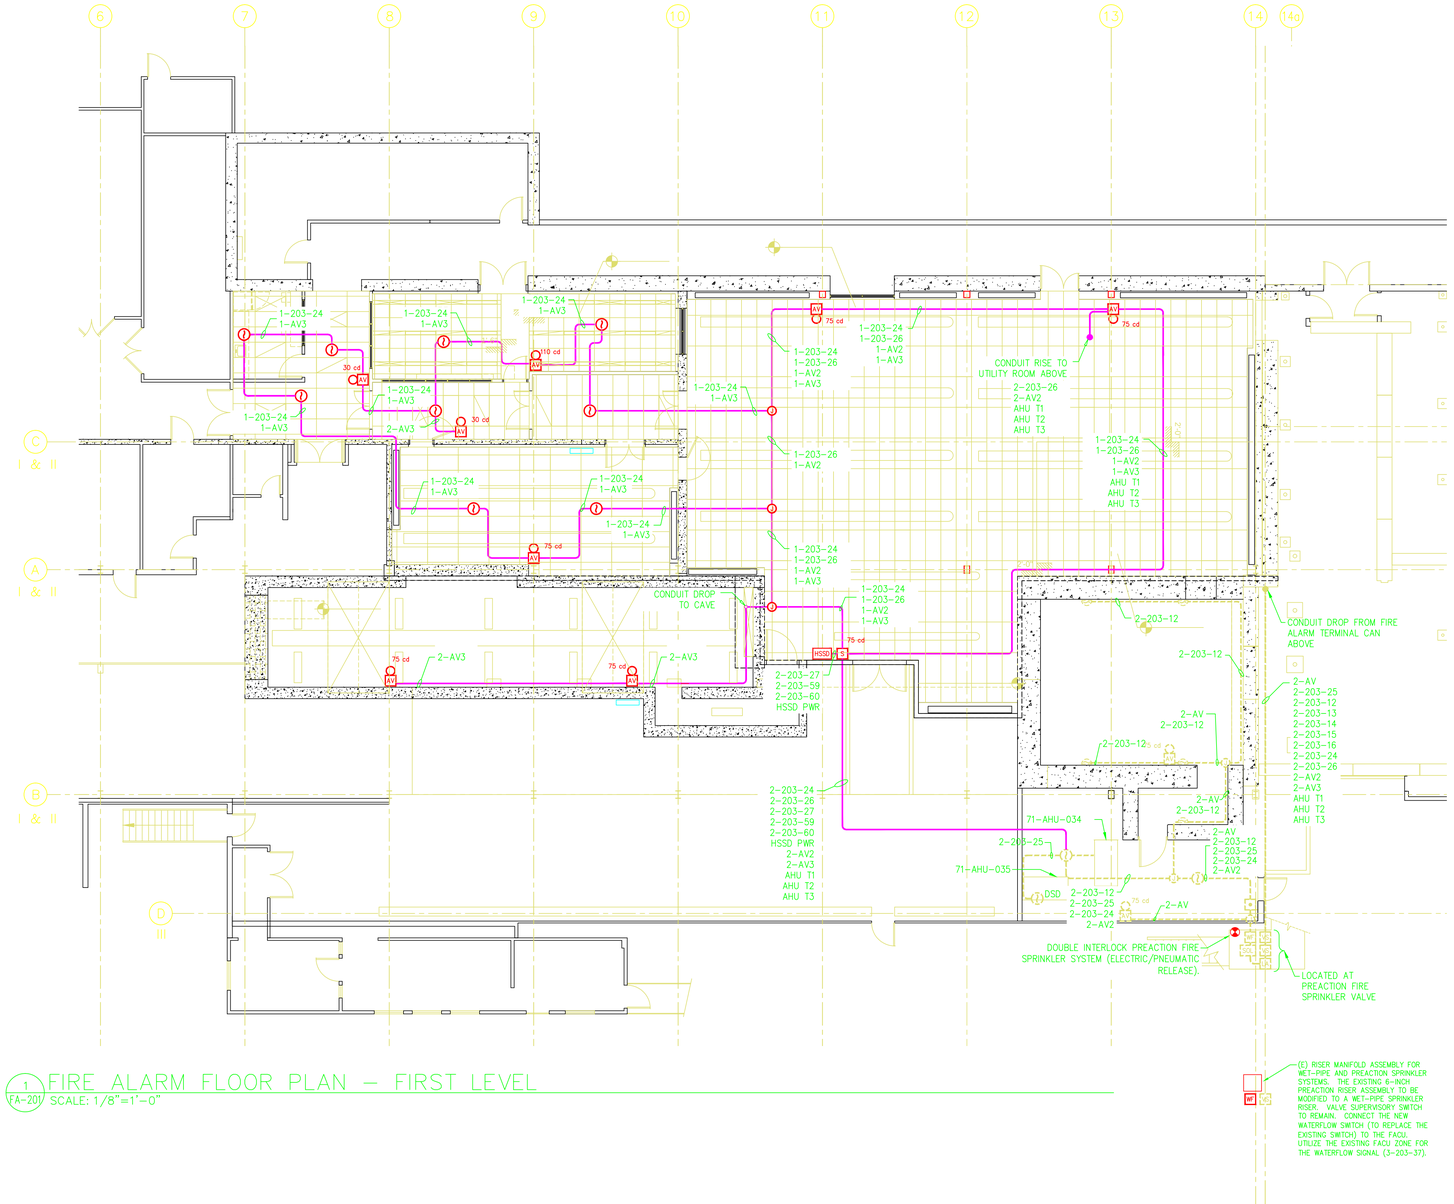

1 FA-201 FIRE ALARM FLOOR PLAN – FIRST LEVEL
SCALE: 1/8"=1'-0"

NOTES:

1. NEW CIRCUIT 3-203-27 WILL PROVIDE ALARM STATUS ("FIRE") FROM THE NEW HSSD DETECTION SYSTEM.
2. NEW CIRCUIT 3-203-24 WILL PROVIDE DETECTION FOR THE DETECTORS IN THOSE AREAS NOT PROTECTED BY THE EXPANDED PREACTION FIRE SPRINKLER SYSTEM.
3. NEW CIRCUITS AV2 & AV3 WILL PROVIDE POWER FOR THE STROBE ELEMENT OF THE OCCUPANT NOTIFICATION APPLIANCES IN THE AREA. THE EXISTING BUILDING'S BELL CIRCUIT WILL POWER TO THE BELL ELEMENT OF THE OCCUPANT NOTIFICATION APPLIANCES IN THE UTILITY ROOM.

REV.	DATE	DESCRIPTION	DRAWN	CHECKED
1	10/21/10	RESPONSE TO LBNL FM COMMENTS	HYT	HYT

KEY PLAN

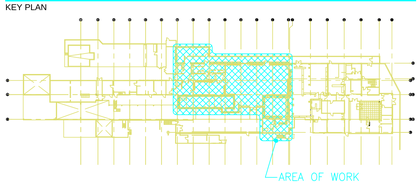

HORIZONTAL SCALE IN FEET
0 8 16 24
SCALE: 1/8"=1'-0"

PLAN NORTH
TRUE NORTH

CLIENT
BERKELEY LAB

PROJECT
BUILDING 71
BERKELEY LAB LASER ACCELERATOR (BELLA)
CONVENTIONAL FACILITIES

M+W GROUP
M+W U.S., Inc.
49 Stevenson Street, Suite 700
San Francisco, CA 94105
Telephone: (415) 442-1881
Fax: (415) 442-1882

HYT Corporation
Fire Protection Engineers and Consultants
3490 Clayton Road - Suite 101
Concord, California 94519
Phone: (925) 681-2731

SHEET TITLE
FIRE ALARM FLOOR PLAN FIRST LEVEL

	DATE	NAME	PROJ. NO.	PROJ. PHASE
DRAWN	04/21/2010	DWH	12092	FINAL
CHECKED	04/21/2010	BBT		
ISSUED/APPROVE	05/26/2010		SHEET NO.	REV.
SCALE/SHT. SIZE	AS NOTED		FA-201	
CTB FILE	LBNL_B&W_Full			

© M+W Zander. All rights reserved. Reproduction in whole or in part is prohibited without the written consent of the copyright owner.

FOR CONSTRUCTION