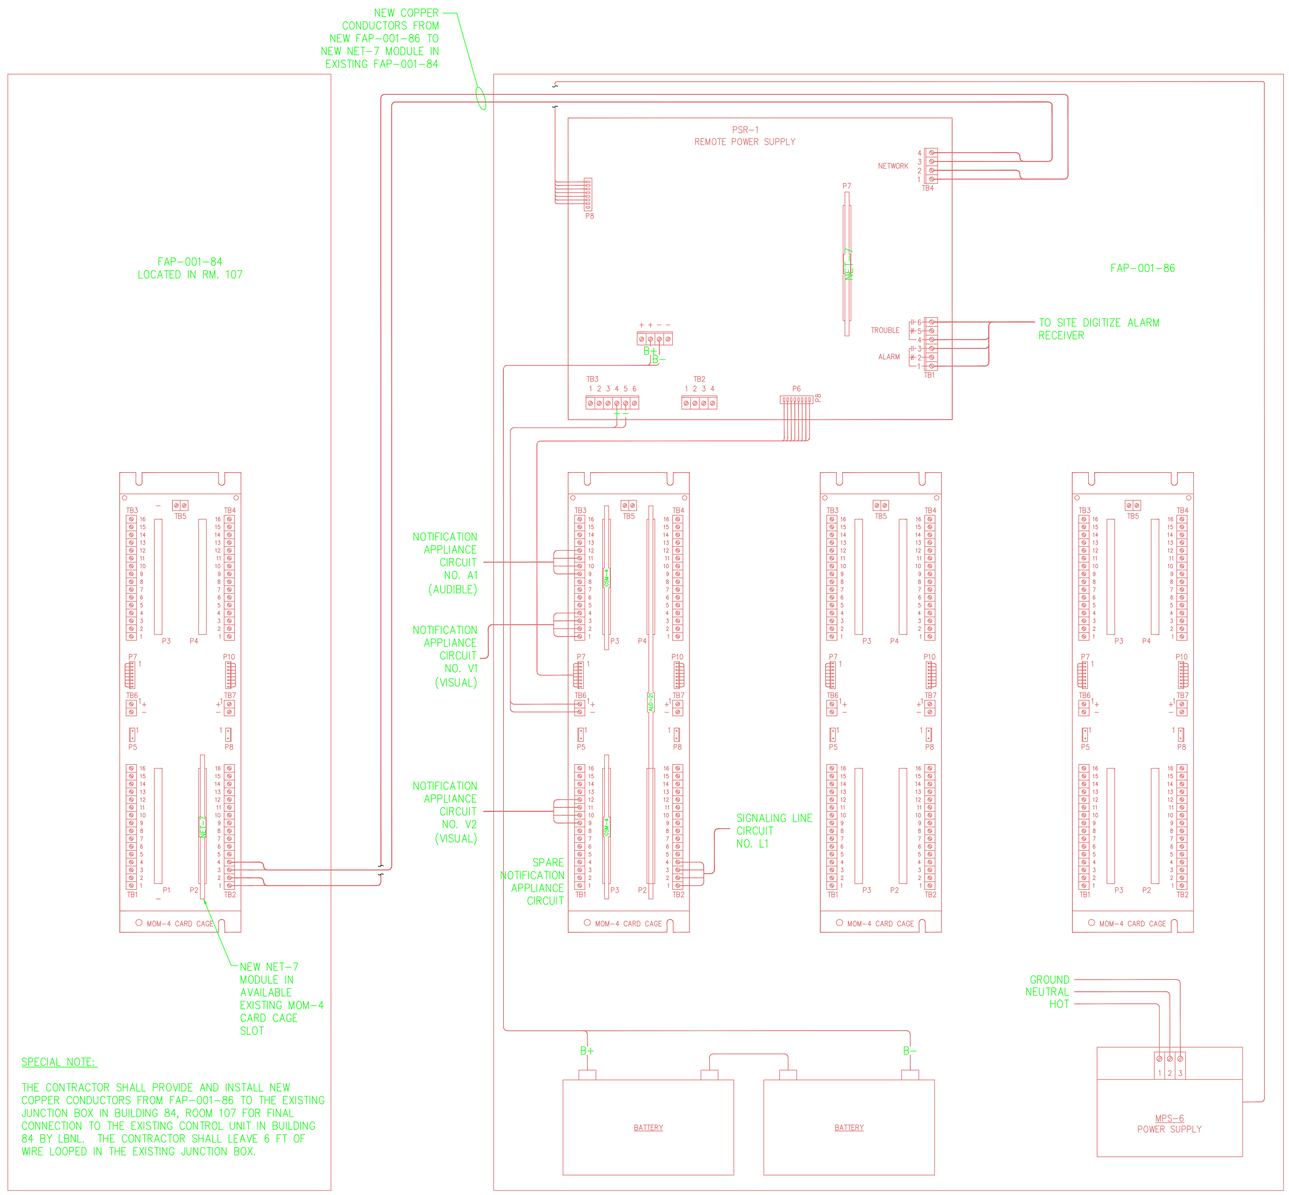

SPECIAL NOTE:

THE CONTRACTOR SHALL PROVIDE AND INSTALL NEW COPPER CONDUCTORS FROM FAP-001-86 TO THE EXISTING JUNCTION BOX IN BUILDING 84, ROOM 107 FOR FINAL CONNECTION TO THE EXISTING CONTROL UNIT IN BUILDING 84 BY LBNL. THE CONTRACTOR SHALL LEAVE 6 FT OF WIRE LOOPED IN THE EXISTING JUNCTION BOX.

1 FIRE ALARM CONTROL UNIT ARRANGEMENT
N.T.S

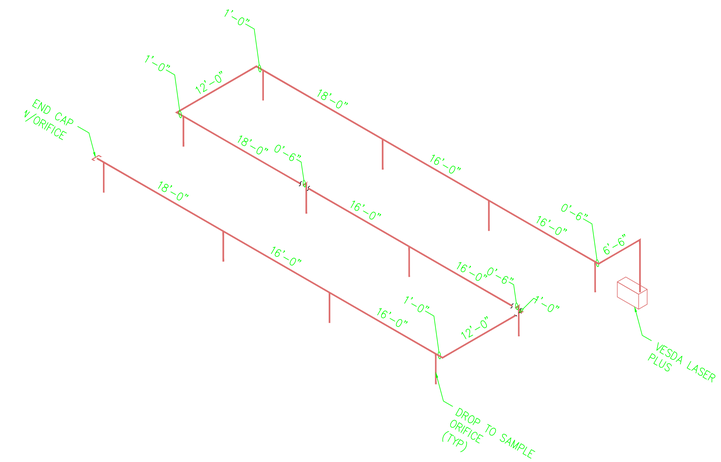

2 VESDA PIPING ISOMETRIC
N.T.S

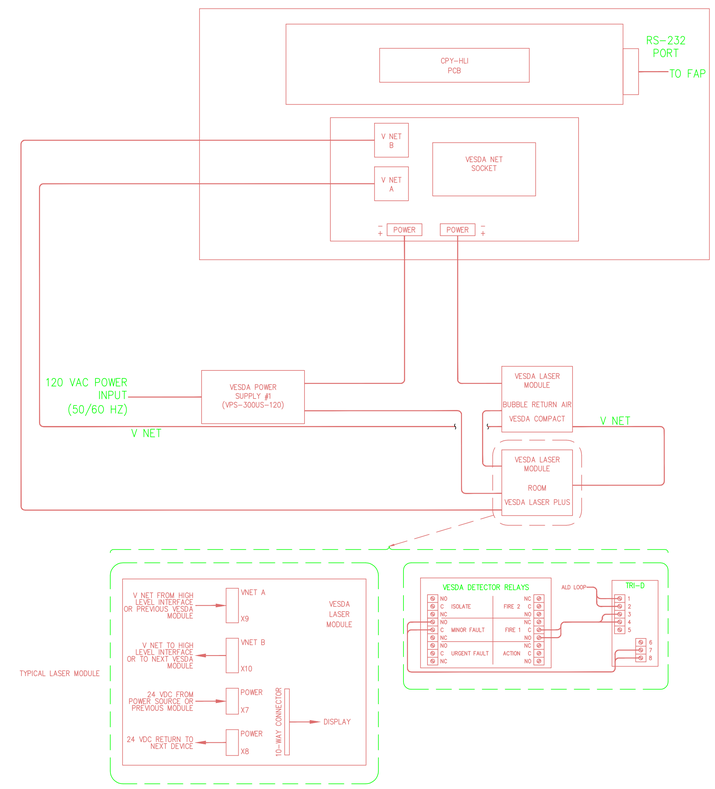

3 VESDA WIRING ARRANGEMENT
N.T.S

HYT Corporation
Fire Protection Engineers and Consultants
3498 Clayton Road - Suite 101, Concord, California 94519
Phone: (925) 681-2731 - FAX: (925) 681-2733

CONSULTING FIRM | CONSULTING FIRM | CONSULTING FIRM | CONSULTING FIRM

ARCHITECT
Flad & Associates
650 California St.
8th Floor
San Francisco, CA 94108
(415) 398-1600
Fax: (415) 398-1606
CONSULTING A/E FIRM

PROFESSIONAL SEAL

CONSTRUCTION
7.31.2006

ISSUE (PROGRESS, ESTIMATE, BID, CONSTRUCTION, CONFORMED, REVISION, AS-BUILT)	REVISION NUMBER	DRAWN BY	CHECKED BY	APPR'D BY	DATE	REMARKS
					7.31.2006	ISSUED FOR CONSTRUCTION

BUILDING 86
ANIMAL CARE FACILITY
FIRE ALARM DETAILS

UNIVERSITY OF CALIFORNIA
LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DIVISION

DRAWN BY	DWH
DATE	3.21.2006
CHECKED BY	BBT
APPROVED BY	
CAD FILE PATH	
SCALE	AS NOTED
DRAWING NO.	5N86E014
SHEET	FA-1.1
PROJECT NO.	FM5500
	2 OF 4