Final Schedule

	Work Order	Description	Lead Craft	FAM Name
Location : 001-0401 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0227396	PM NFPA72 BLDG. 01 fire alarm system ITM(Donner Weekly)	FATSD	Tafoya,Eric
Location : 002-0301 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229642	Troubleshoot temperature issue in 002-0301, change SP to 70	FAOMH	Reisinger,Richard I
Location : 002-0307A (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0211770	Install dedicated 20A and 30A receptacles for laser equipment.	FATSE1	Reisinger,Richard I
Location : 002-0333 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229291	Troubleshoot temp too high for experiment @ B02-0333 (Escort req'd)	FAOMH	Reisinger,Richard I
Location : 006-1000 (2 items) (Total=4)				
Work Type Group : CMR, Etc (4 items)				
1	W0229627	Reinstall Electrical Panel at New Location	FATSE	Reisinger,Richard I
2	W0231655	BL 11 New Rack Power and LV Wireway Install	FATSE	Reisinger,Richard I
3	W0221723	Pull Low Volt Cable, multiple locations in ALS	FATSE	Reisinger,Richard I
4	W0229686	Transport and fill Shielding Plugs for ALS B6	FATSL	Reisinger,Richard I
Location : 006-2145A (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230897	PM FOR 06 DSRO 004	FAOMH	Reisinger,Richard I
Location : 006-2270 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230899	PM FOR 06 DSRO 005	FAOMH	Reisinger,Richard I
Location : 006A-0101 (1 item) (Total=2)				
Work Type Group : PMs (2 items)				

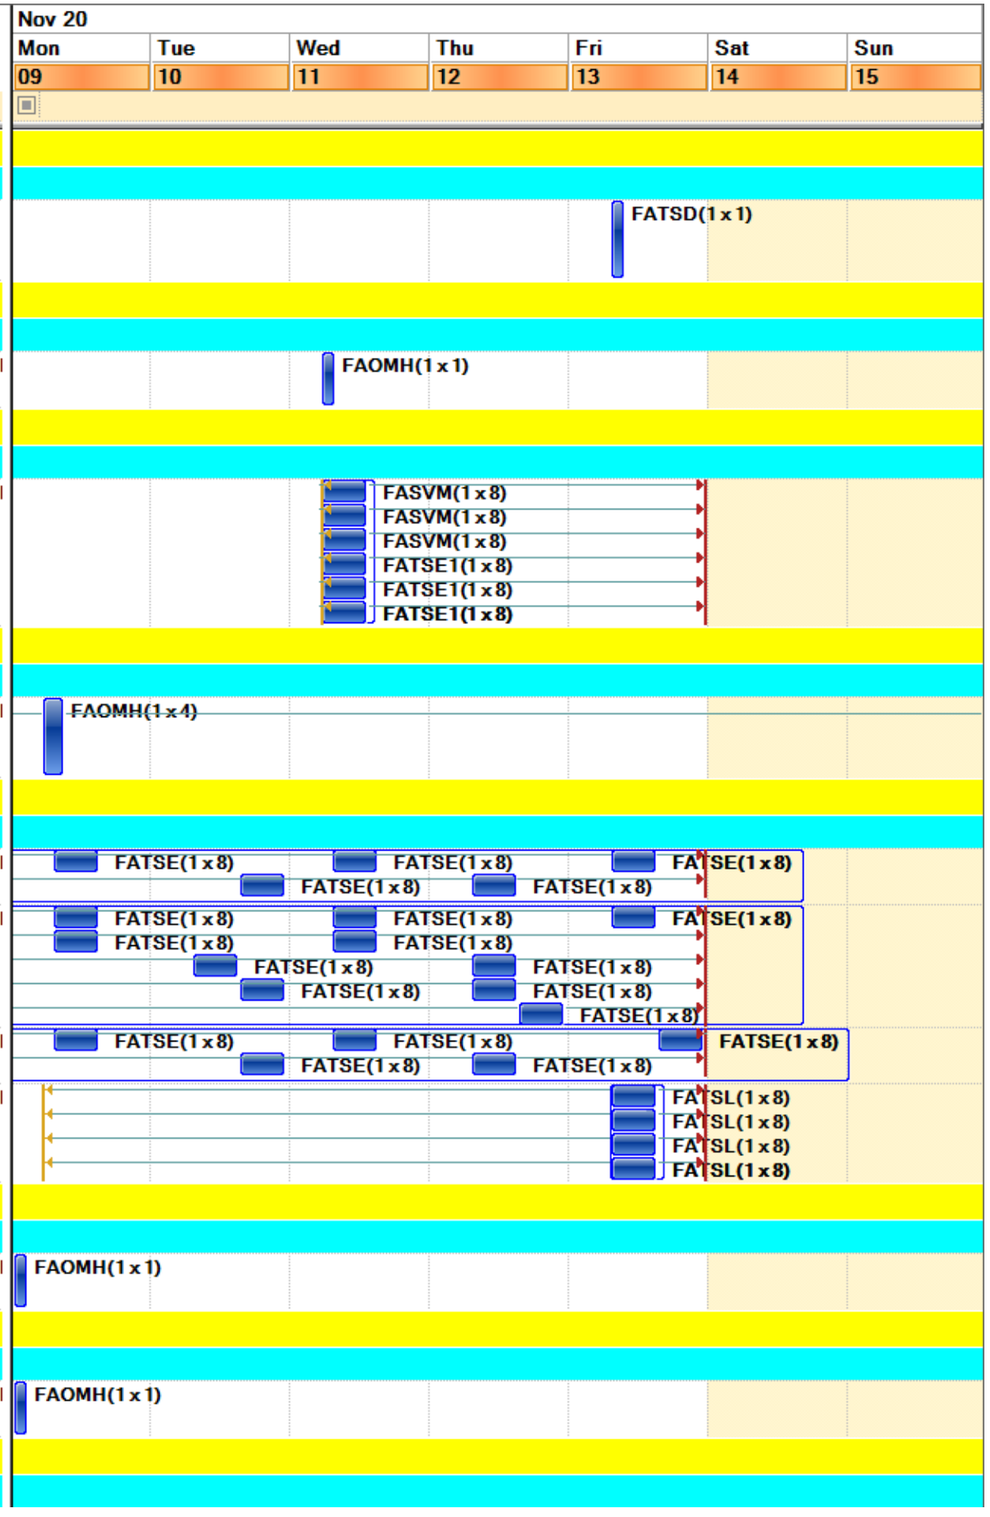

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
1	W0230376	Battery Bank PM Switchstation SW-A3	FATSE2	Reisinger,Richard I				FATSE2(1 x 2)			
2	W0230482	Inspection of SW-A3 Bldg. 06A	FATSE2	Reisinger,Richard I				FATSE2(1 x 1)			
Location : 007-0100 (2 items) (Total=3)											
Work Type Group : PROJECTS (3 items)											
1	W0223447	Recover refrigerant from AC units @ B7 & B7C	FAOMH	Reisinger,Richard I	FAOMH(1 x 4)						
2	W0227464	Daily bypass of Sprinkler systems for B07 & B07C.	FATSD	Reisinger,Richard I	FATSD(1 x 2)	FATSD(1 x 2)	FATSD(1 x 2)	FATSD(1 x 2)	FATSD(1 x 2)		
3	W0230136	FATSL Support to HVAC in refrigerant recovery @ B7	FATSL	Reisinger,Richard I	FATSL(1 x 6) FATSL(1 x 6)						
Location : 007-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0230132	PM NFPA25 BLDG. 7/7A sprinkler ITM	FATSD	Reisinger,Richard I					FATSD(1 x .5)		
Location : 013A-0199 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0227556	PM FOR 13ABL 002	FAOMP1	Gutierrez,Myrna	FAOMP1(1 x 1)						
Location : 013E-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0227476	PM FOR 13EBFP003	FAOMP1	Rini,Christopher G					FAOMP1(1 x 1)		
Location : 017-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229900	PM NFPA25 BLDG. 17/17A sprinkler ITM	FATSD	Reisinger,Richard I					FATSD(1 x 1)		
Location : 026-0198 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0231369	ES & EW PM FOR BLDG. 26 11/10	FAOMP2	Rini,Christopher G		FAOMP2(1 x 1)					
Location : 026-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229873	PM NFPA25 BLDG. 26 sprinkler ITM	FATSD	Rini,Christopher G					FATSD(1 x .5)		
Location : 027-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229903	PM NFPA25 BLDG. 27 sprinkler ITM	FATSD	Reisinger,Richard I					FATSD(1 x 1)		
Location : 028-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229876	PM NFPA25 BLDG. 28 sprinkler ITM	FATSD	Rini,Christopher G					FATSD(1 x .5)		
Location : 030-0101B (1 item) (Total=1)											
Work Type Group : CMR, Plc (1 item)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0223633	Replace smoke detector head that is giving trouble alarm	FATSD	Rini,Christopher G
Location : 030-0143 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0226875	Troubleshoot Fire Alarm Panel going in and out of trouble	FATSD	Rini,Christopher G
Location : 030-0144 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0230047	PM NFPA25 BLDG. 30 sprinkler ITM	FATSD	Rini,Christopher G
Location : 030-0199 (1 item) (Total=2)				
Work Type Group : PROJECTS (2 items)				
1	W0229225	FMCS to monitor building systems during outage	FMCS	Rini,Christopher G
2	W0229229	FAOMP3 - Monitor generators for B30 outage, refuel and add DEF (Diesel exhaust fuel) as needed.	FAOMP3	Rini,Christopher G
Location : 030-0199X (1 item) (Total=1)				
Work Type Group : PROJECTS (1 item)				
1	W0226979	FATSE2 to connect 360kW temporary generator for B30 shutdown & disconnect after	FATSE2	Rini,Christopher G
Location : 030-0218 (1 item) (Total=1)				
Work Type Group : PROJECTS (1 item)				
1	W0229565	FATSC - Setup false door for Move-n-cools for IDF, and change door back after outage	FATSC	Rini,Christopher G
Location : 033-0120 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0226685	Install cylinder holder in 33-120 on wall to the left of door to 33-122 (photo attached)	FATSC	Rini,Christopher G
Location : 033-0122 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0225961	Troubleshoot non-functioning clock (Batteries?) @ 33-122	FATSL	Rini,Christopher G
Location : 033-0156 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230526	PM for 33 BD 001	FAOMP1	Rini,Christopher G
Location : 033-0199X (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0230181	Move filters from the rear exterior of B33 & stage in 33-401	FATSL	Rini,Christopher G
Location : 033-R403 (1 item) (Total=2)				

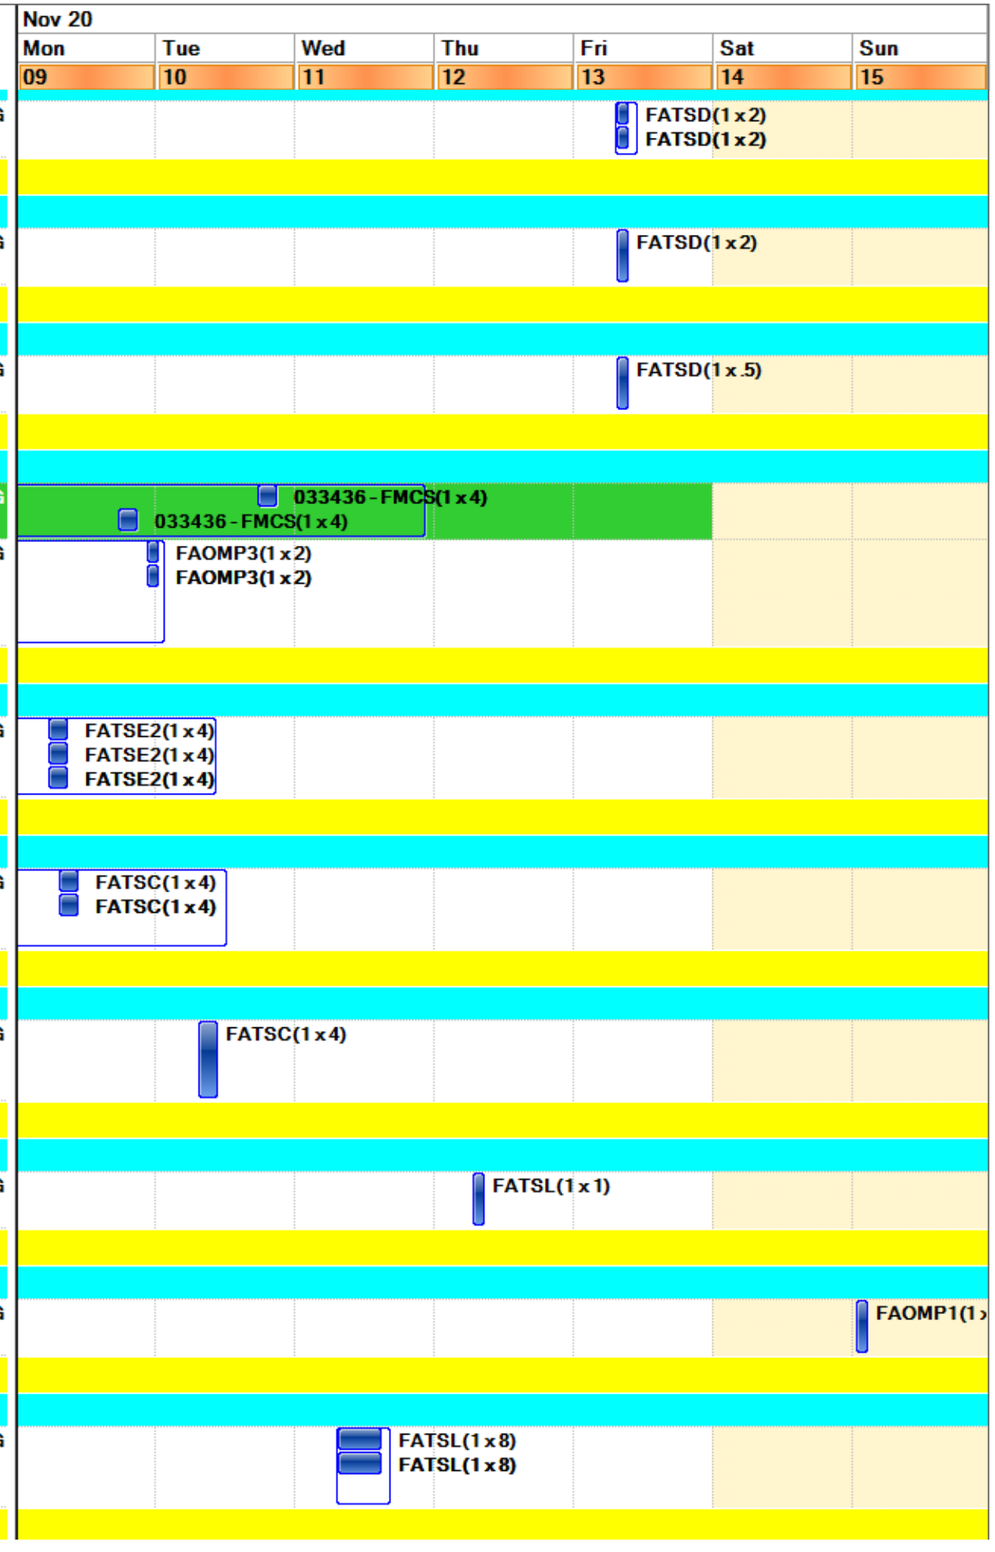

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
Work Type Group : PMs (2 items)											
1	W0230906	PM for 33 ADR001	FAOMH	Rini,Christopher G	FAOMH(1 x 2)						
2	W0230908	PM for 33 ADR002	FAOMH	Rini,Christopher G	FAOMH(1 x 2)						
Location : 033U-0101 (2 items) (Total=3)											
Work Type Group : PMs (3 items)											
1	W0225178	PM for 33UGP 001	FAOMP2	Rini,Christopher G	FAOMP2(1 x 1)						
2	W0225180	PM for 33UGP 002	FAOMP2	Rini,Christopher G	FAOMP2(1 x 1)						
3	W0225182	PM for 33UGP 003	FAOMP2	Rini,Christopher G	FAOMP2(1 x 1)						
Location : 035-0100 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230484	Inspection of SW-A4 Bldg. 35	FATSE2	Reisinger,Richard I				FATSE2(1 x 1)			
Location : 035-0101 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230378	Battery Bank PM Switchstation SW-A4	FATSE2	Reisinger,Richard I				FATSE2(1 x 2)			
Location : 036-0101 (2 items) (Total=2)											
Work Type Group : PMs (2 items)											
1	W0230374	Battery Bank PM Switchstation SW-A1 SW-A2	FATSE2	Rini,Christopher G					FATSE2(1 x 2)		
2	W0230480	Inspection of SW-A1&A2 Bldg. 36	FATSE2	Rini,Christopher G					FATSE2(1 x 1)		
Location : 036A-0101 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230382	Inspection of Grizzly Peak Substation	FATSE2	Rini,Christopher G					FATSE2(1 x 1)		
Location : 045-0101 (1 item) (Total=2)											
Work Type Group : PMs (2 items)											
1	W0227971	PM FOR 45 UH 003	FAOMP1	Reisinger,Richard I		FAOMP1(1 x 2)					
2	W0227969	PM FOR 45 UH 002	FAOMP1	Reisinger,Richard I			FAOMP1(1 x 2)				
Location : 046-0125 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0226543	Replace thermostat to heater 46 GH 015 @ B46-0125	FAOMH	Atkinson,Joseph				FAOMH(1 x 4) FAOMH(1 x 4)			
Location : 046-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229885	PM NFPA25 BLDG. 46/46A/46B/46D sprinkler ITM	FATSD	Atkinson,Joseph						FATSD(1 x 1)	
Location : 046-0234C (1 item) (Total=1)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
		Work Type Group : CMR, Etc (1 item)		
1	W0230863	Replace burnt out lamps and or/ballasts as requested by the customer/client. See long text for more	FAOML	Atkinson,Joseph
		Location : 046-ROF1 (1 item) (Total=2)		
		Work Type Group : PMs (2 items)		
1	W0216049	PM FOR 46 AC 041 (Materials) Sent multiple emails on status of Matl's	FAOMH	Atkinson,Joseph
2	W0216051	PM FOR 46 AC 043 (Materials) Sent multiple emails on status of Matl's	FAOMH	Atkinson,Joseph
		Location : 047-0199 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0229888	PM NFPA25 BLDG. 47 sprinkler ITM	FATSD	Atkinson,Joseph
		Location : 048-0201 (1 item) (Total=1)		
		Work Type Group : CMR, Etc (1 item)		
1	W0226926	Replace window screens at firehouse Room 48-201	FATSC	Reisinger,Richard
		Location : 050-0100 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231847	PM For Building 50 Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
		Location : 050-4005 (1 item) (Total=1)		
		Work Type Group : CMR, Etc (1 item)		
1	W0229442	Investigate and gather pipe insulation information, order, and install.	FATSF	Escobedo,Carlos
		Location : 050-4008 (1 item) (Total=1)		
		Work Type Group : PMs (1 item)		
1	W0220201	50 AHU041- [PM AHU042 at same time] MATL Here (Carbons) Do before 9:30am	FAOMP1	Escobedo,Carlos
		Location : 050-4009 (2 items) (Total=5)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0229783	PM NFPA72 BLDG. 50 fire alarm system ITM	FATSD	Escobedo,Carlos
		Work Type Group : PMs (4 items)		
1	W0230912	PM FOR 50 DSRO 003	FAOMH	Escobedo,Carlos
2	W0231512	PM FOR 50 BR 008	FAOMP3	Escobedo,Carlos
3	W0231206	PM FOR 50 GP 034	FAOMP3	Escobedo,Carlos
4	W0231208	PM FOR 50 GP 035	FAOMP3	Escobedo,Carlos
		Location : 050-4014 (1 item) (Total=1)		

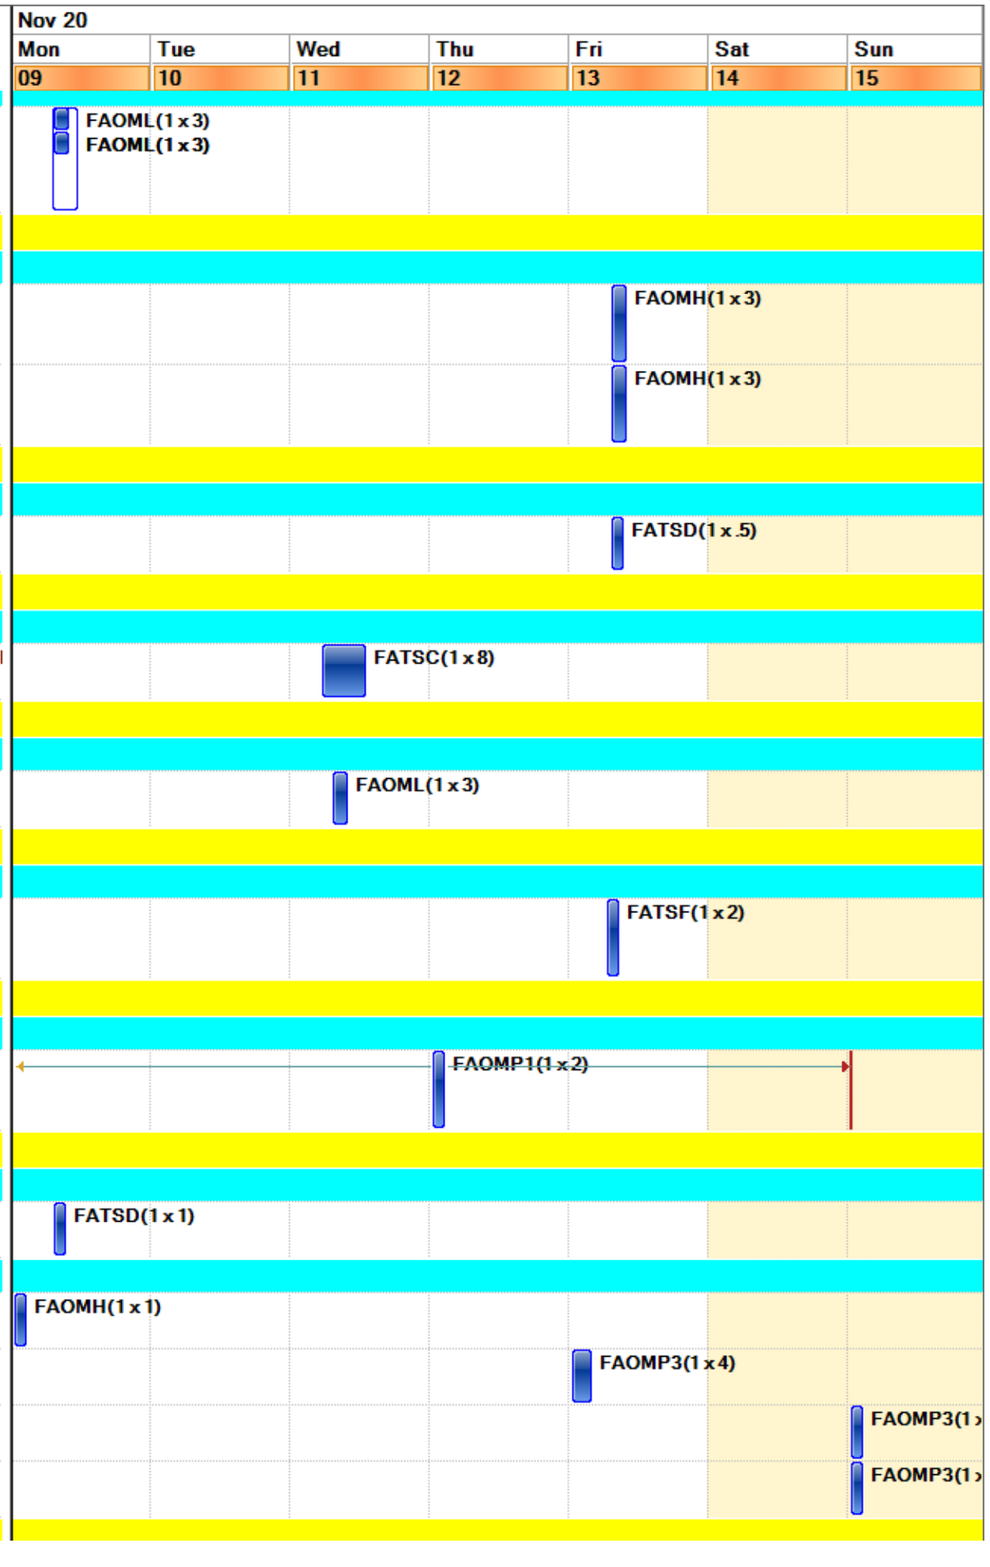

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
Work Type Group : PMs (1 item)											
1	W0220203	50 AHU042 [PM AHU041 at same time] MATL Here (Carbons) Do before 9:30am	FAOMP1	Escobedo,Carlos				FAOMP1(1 x 2)			
Location : 050-6040 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0219050	(Child) Support plumber work by disconnecting and moving shelf from the wall. (See attached photo)	FATSC	Escobedo,Carlos			FATSC(1 x 1)				
Location : 050A-0135 (2 items) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229785	PM NFPA72 BLDG. 50A/50C/50E fire alarm system ITM	FATSD	Escobedo,Carlos	FATSD(1 x 1)						
Location : 050A-0143B (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0229771	Install signs on portable sign stands.	FATSL	Escobedo,Carlos				FATSL(1 x 2) FATSL(1 x 2)			
Location : 050A-0199 (1 item) (Total=2)											
Work Type Group : Code Complaint PMs (2 items)											
1	W0231140	Monthly PM for 50AEG 101	FAOMP3	Escobedo,Carlos	FAOMP3(1 x 1.75)						
2	W0231146	PM FOR 50A TK 002	FAOMP3	Escobedo,Carlos	FAOMP3(1 x 1)						
Location : 050A-1134 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0231859	PM For Building 50A Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos			FAOML(1 x 3)				
Location : 050A-4112 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0220737	Perform rounds on portable ac unit inside Dr. Brandt's office and drain condensate tank as needed.	FAOMP1	Escobedo,Carlos	FAOMP1(1 x 1)		FAOMP1(1 x 1)		FAOMP1(1 x 1)		
Location : 050B-0243 (3 items) (Total=5)											
Work Type Group : CMR, Etc (1 item)											
1	W0217511	Change Batteries in Halon panel B50B	FATSD	Escobedo,Carlos			FATSD(1 x 1)				
Work Type Group : Code Complaint PMs (3 items)											
1	W0231152	Monthly PM for 50BEG 095	FAOMP3	Escobedo,Carlos	FAOMP3(1 x 1.75)						
2	W0231154	PM FOR 50B TK 001	FAOMP3	Escobedo,Carlos	FAOMP3(1 x 1)						
3	W0229787	PM NFPA72 BLDG. 50B/50D/50F fire alarm system ITM	FATSD	Escobedo,Carlos	FATSD(1 x 1)						
Work Type Group : PMs (1 item)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
		Work Type Group : PMs (1 item)		
1	W0231508	PM FOR 50B BR 005	FAOMP3	Escobedo,Carlos
		Location : 050B-1245 (1 item) (Total=1)		
		Work Type Group : PROJECTS (1 item)		
1	W0228982	Shut off smoke detectors in room 1275	FATSD	Escobedo,Carlos
		Location : 050B-1297 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231861	PM For Building 50B Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
		Location : 050B-ROF1 (2 items) (Total=1)		
		Work Type Group : CMR, Etc (1 item)		
1	W0230314	Field verify all components of circuit feeding 50B-CT-004	FATSE1	Escobedo,Carlos
		Location : 050C-3397 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231863	PM For Building 50C Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
		Location : 050C-ROF1 (1 item) (Total=2)		
		Work Type Group : PMs (2 items)		
1	W0230950	PM FOR 50C DSRO 001	FAOMH	Escobedo,Carlos
2	W0230952	PM FOR 50C DSRO 002	FAOMH	Escobedo,Carlos
		Location : 050E-1598 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231865	PM For Building 50E Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
		Location : 050F-1698 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231867	PM For Building 50F Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
		Location : 050F-1699 (1 item) (Total=1)		
		Work Type Group : PMs (1 item)		
1	W0230956	PM FOR 50F DSRO 001	FAOMH	Escobedo,Carlos
		Location : 050-ROF1 (1 item) (Total=1)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0230910	PM FOR 50 ARU007 (Quarterly PM - Auditorium)	FAOMH	Escobedo,Carlos
		Location : 051F-0101 (1 item) (Total=2)		
		Work Type Group : PROJECTS (2 items)		
1	W0231585	Remove all ballast and light bulbs inside 51F	FAOML	Gutierrez,Myrna

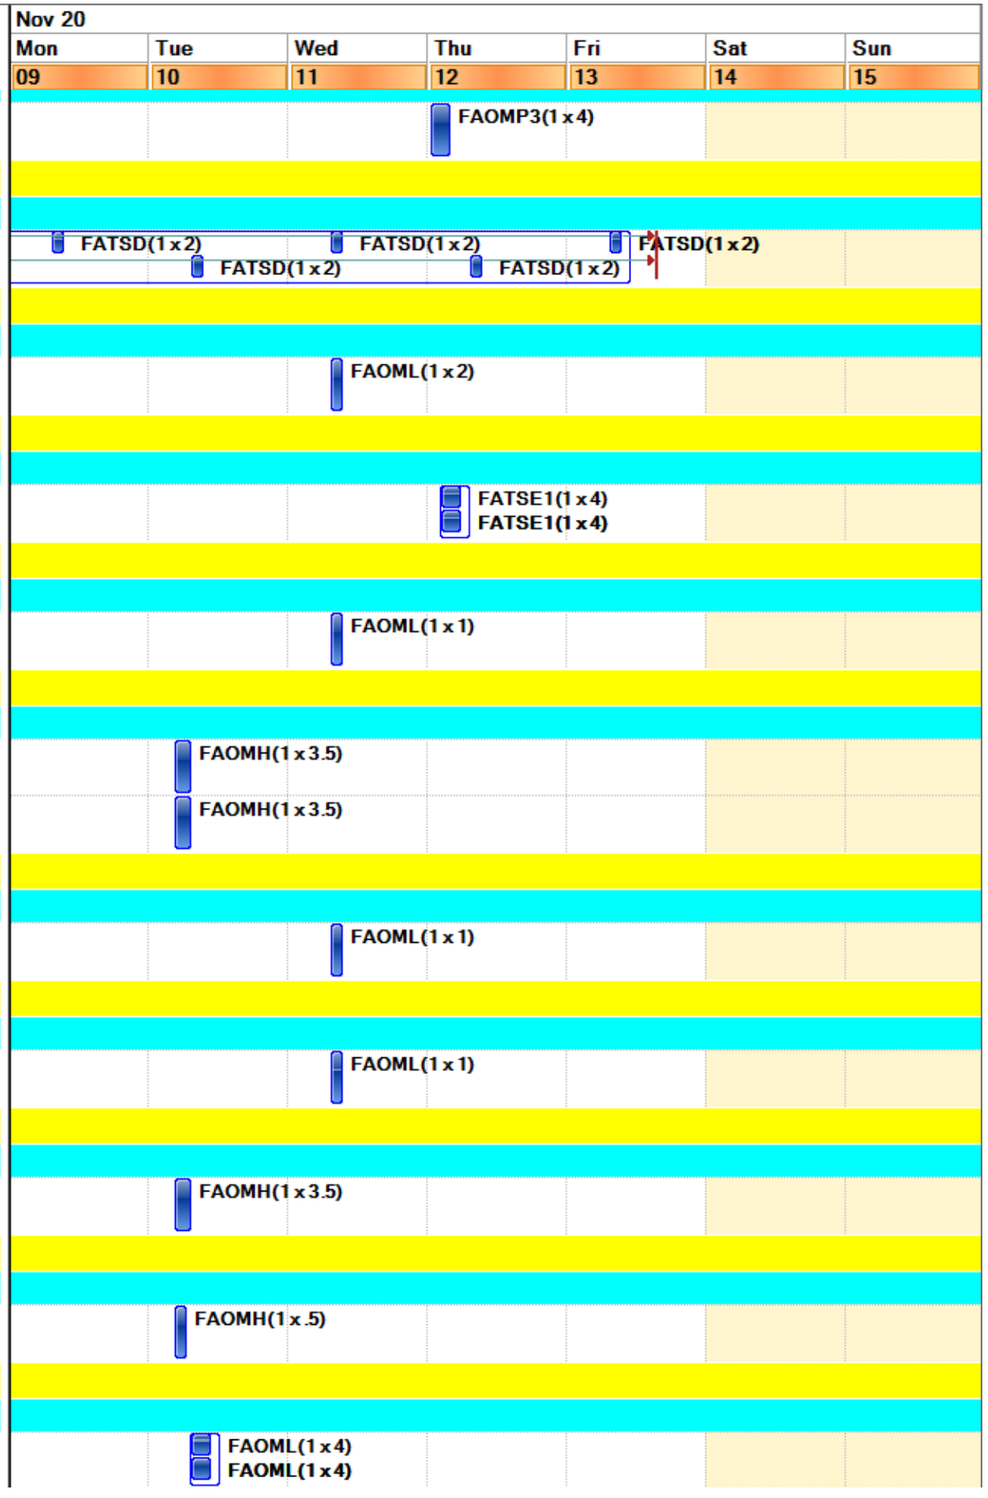

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
2	W0232125	(Child) Remove shelving unit in front of the wall AC unit.	FATSC	Gutierrez,Myrna
Location : 053-0008 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229789	PM NFPA72 BLDG. 53/17/23 fire alarm system ITM	FATSD	Reisinger,Richard I
Location : 053-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229906	PM NFPA25 BLDG. 53 sprinkler ITM	FATSD	Reisinger,Richard I
Location : 054-0001 (2 items) (Total=1)				
Work Type Group : PROJECTS (1 item)				
1	W0229289	Open manhole covers, take pictures and measure depths of electrical vaults	FATSE2	Escobedo,Carlos
Location : 054-0002A (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230677	PM FOR 54 BL 006	FAOMP2	Escobedo,Carlos
Location : 054-0098 (2 items) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230536	PM FOR 54 AHU003	FAOMP2	Escobedo,Carlos
Location : 054-0104 (2 items) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231406	PM FOR 54 XX 039	FAOMP2	Escobedo,Carlos
Location : 054-0116 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230673	PM FOR 54 BL 001	FAOMP2	Escobedo,Carlos
Location : 054-0118 (1 item) (Total=4)				
Work Type Group : PMs (4 items)				
1	W0222450	PM FOR 54 BR 004 MATL Here	FAOMP3	Escobedo,Carlos
2	W0227974	PM for 54 WH 003	FAOMP2	Escobedo,Carlos
3	W0227976	PM for 54 WH 004	FAOMP2	Escobedo,Carlos
4	W0231514	PM FOR 54 BR 005	FAOMP3	Escobedo,Carlos
Location : 054-0193 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230697	PM FOR 54 BL 020	FAOMP2	Escobedo,Carlos

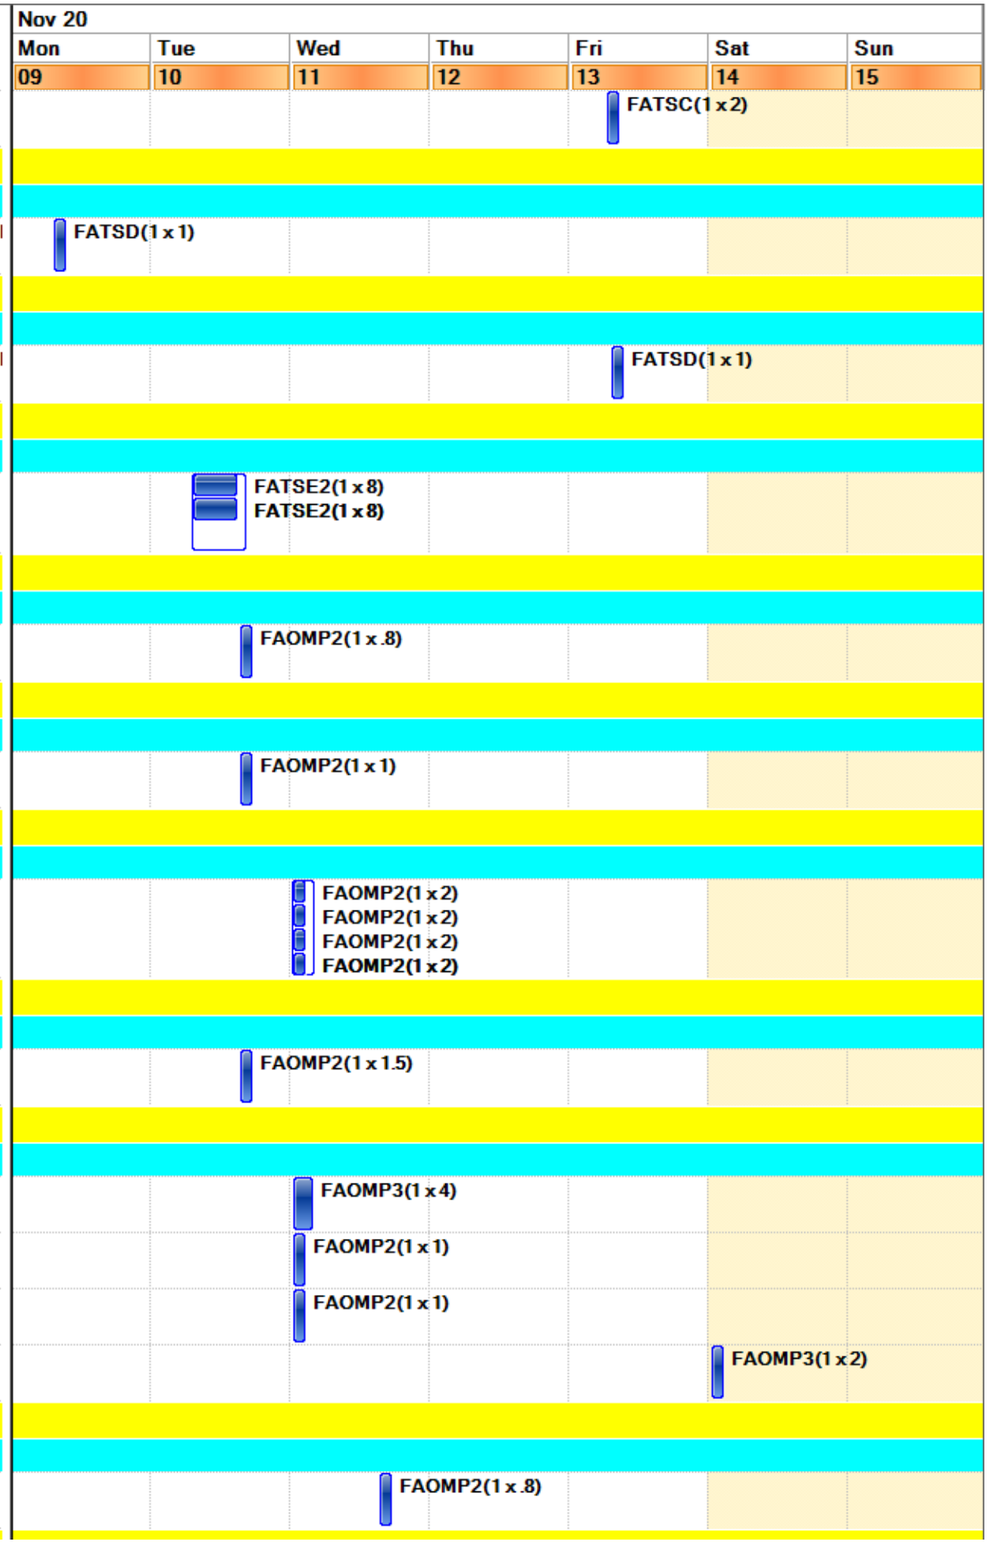

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
Location : 054-0194 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230695	PM FOR 54 BL 019	FAOMP2	Escobedo,Carlos			FAOMP2(1 x .8)				
Location : 054-ROF1 (1 item) (Total=7)											
Work Type Group : PMs (7 items)											
1	W0230675	PM FOR 54 BL 002	FAOMP2	Escobedo,Carlos		FAOMP2(1 x 1)					
2	W0230679	PM FOR 54 BL 010	FAOMP2	Escobedo,Carlos		FAOMP2(1 x 1)					
3	W0230683	PM FOR 54 BL 012	FAOMP2	Escobedo,Carlos			FAOMP2(1 x 1)				
4	W0230685	PM FOR 54 BL 013	FAOMP2	Escobedo,Carlos			FAOMP2(1 x .8)				
5	W0230689	PM FOR 54 BL 015	FAOMP2	Escobedo,Carlos			FAOMP2(1 x 1)				
6	W0230691	PM FOR 54 BL 017	FAOMP2	Escobedo,Carlos			FAOMP2(1 x 1)				
7	W0230855	PM FOR 54 BL 014	FAOMP2	Escobedo,Carlos			FAOMP2(1 x .8)				
Location : 055-0125 (1 item) (Total=2)											
Work Type Group : PROJECTS (2 items)											
1	W0226963	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna	FAOMH(1 x 1.5)						
2	W0226966	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna	FAOMH(1 x 1.5)						
Location : 055-0198 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0231389	ES & EW PM FOR BLDG. 55 11/10	FAOMP2	Gutierrez,Myrna			FAOMP2(1 x 2)				
Location : 055-ROF1 (3 items) (Total=6)											
Work Type Group : PROJECTS (6 items)											
1	W0224541	(Parent) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna	FAOMH(1 x 1.5)						
2	W0226947	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna		FAOMH(1 x 1.5)					
3	W0226949	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna		FAOMH(1 x 1.5)					
4	W0226950	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna		FAOMH(1 x 1.5)					
5	W0226961	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna		FAOMH(1 x 1.5)					
6	W0226962	(Child) Filter and OA survey for smoke mitigation project	FAOMH	Gutierrez,Myrna		FAOMH(1 x 1.5)					
Location : 058-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229915	PM NFPA25 BLDG. 58/58A/58B sprinkler ITM	FATSD	Atkinson,Joseph					FATSD(1 x .5)		
Location : 059-0198X (1 item) (Total=2)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
		Work Type Group : PROJECTS (2 items)		
1	W0224248	Execute LOTO and release when work is complete.	FATSE2	Escobedo,Carlos
2	W0231457	LOTO and EVAP support for contractor work.	FATSE2	Escobedo,Carlos
		Location : 059-0199X (3 items) (Total=2)		
		Work Type Group : Code Complaint PMs (1 item)		
1	W0231335	Monthly PM FOR 59 TK 003	FAOMP3	Escobedo,Carlos
		Work Type Group : PROJECTS (1 item)		
1	W0231453	Mech level & 2nd floor fire sprinkler impairment	FATSD	Escobedo,Carlos
		Location : 059-1002 (2 items) (Total=2)		
		Work Type Group : PMs (2 items)		
1	W0230476	PM for 59 PNL048	FATSE2	Escobedo,Carlos
2	W0230478	PM for 59 PNL063	FATSE2	Escobedo,Carlos
		Location : 059-1003 (2 items) (Total=1)		
		Work Type Group : PROJECTS (1 item)		
1	W0217428	Disarm fire alarm points and functions as per construction manager instructions. (On going until Nov	FATSD	Escobedo,Carlos
		Location : 059-1201 (3 items) (Total=4)		
		Work Type Group : Code Complaint PMs (4 items)		
1	W0229852	PM NFPA25 BLDG. 59 FRA001 sprinkler ITM	FATSD	Escobedo,Carlos
2	W0229855	PM NFPA25 BLDG. 59 FRA002 sprinkler ITM	FATSD	Escobedo,Carlos
3	W0229858	PM NFPA25 BLDG. 59 FRA003 sprinkler ITM	FATSD	Escobedo,Carlos
4	W0229861	PM NFPA25 BLDG. 59 FRA004 sprinkler ITM	FATSD	Escobedo,Carlos
		Location : 059-2103 (1 item) (Total=12)		
		Work Type Group : PMs (12 items)		
1	W0230362	PM for 59 ADF001	FATSE2	Escobedo,Carlos
2	W0230366	PM for 59 ADF003	FATSE2	Escobedo,Carlos
3	W0230368	PM for 59 ADF004	FATSE2	Escobedo,Carlos
4	W0230370	PM for 59 ADF006	FATSE2	Escobedo,Carlos
5	W0230488	PM for 59 XFM590	FATSE2	Escobedo,Carlos

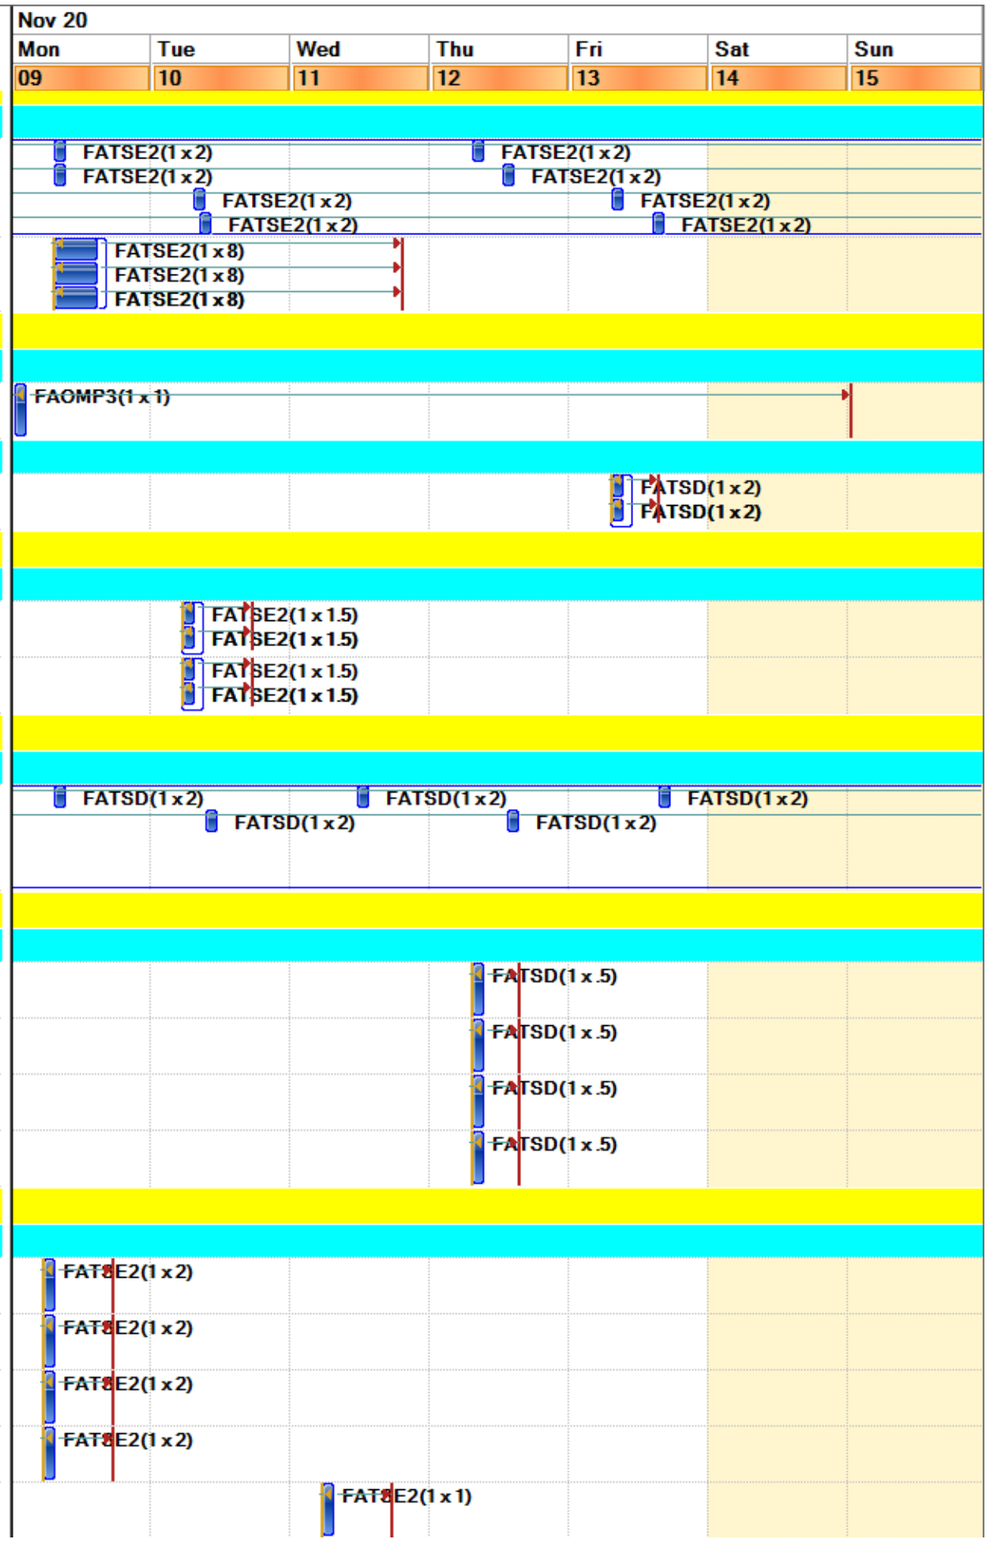

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
6	W0230492	PM for 59 XFM612	FATSE2	Escobedo,Carlos
7	W0230494	PM for 59 XFM613	FATSE2	Escobedo,Carlos
8	W0230496	PM for 59 XFM628	FATSE2	Escobedo,Carlos
9	W0230466	PM for 59 PNL001	FATSE2	Escobedo,Carlos
10	W0230470	PM for 59 PNL070	FATSE2	Escobedo,Carlos
11	W0230472	PM for 59 PNL077	FATSE2	Escobedo,Carlos
12	W0230474	PM for 59 PNL084	FATSE2	Escobedo,Carlos
Location : 059-2104 (1 item) (Total=3)				
Work Type Group : PMs (3 items)				
1	W0230364	PM for 59 ADF002	FATSE2	Escobedo,Carlos
2	W0230490	PM for 59 XFM596	FATSE2	Escobedo,Carlos
3	W0230468	PM for 59 PNL047	FATSE2	Escobedo,Carlos
Location : 059-3069 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0232033	Hang plaque on the wall.	FATSC	Escobedo,Carlos
Location : 060-0199 (2 items) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0227649	PM FOR 60 BL 001	FAOMP1	Gutierrez,Myrna
Location : 062-0034 (1 item) (Total=2)				
Work Type Group : Code Complaint PMs (2 items)				
1	W0231053	Monthly PM for 62 EG 102	FAOMP3	Tafoya,Eric
2	W0231055	PM FOR 62 TK 002	FAOMP3	Tafoya,Eric
Location : 062-0337 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0230127	HVAC to investigate and repair leaking coil(Follow up to W0229152)	FAOMH	Tafoya,Eric
Location : 062B-0199 (1 item) (Total=2)				
Work Type Group : Code Complaint PMs (2 items)				
1	W0231057	Monthly PM for 62BEG 081 ICS Node	FAOMP3	Tafoya,Eric
2	W0231059	PM FOR 62B TK 081	FAOMP3	Tafoya,Eric
Location : 062C-0199 (1 item) (Total=1)				

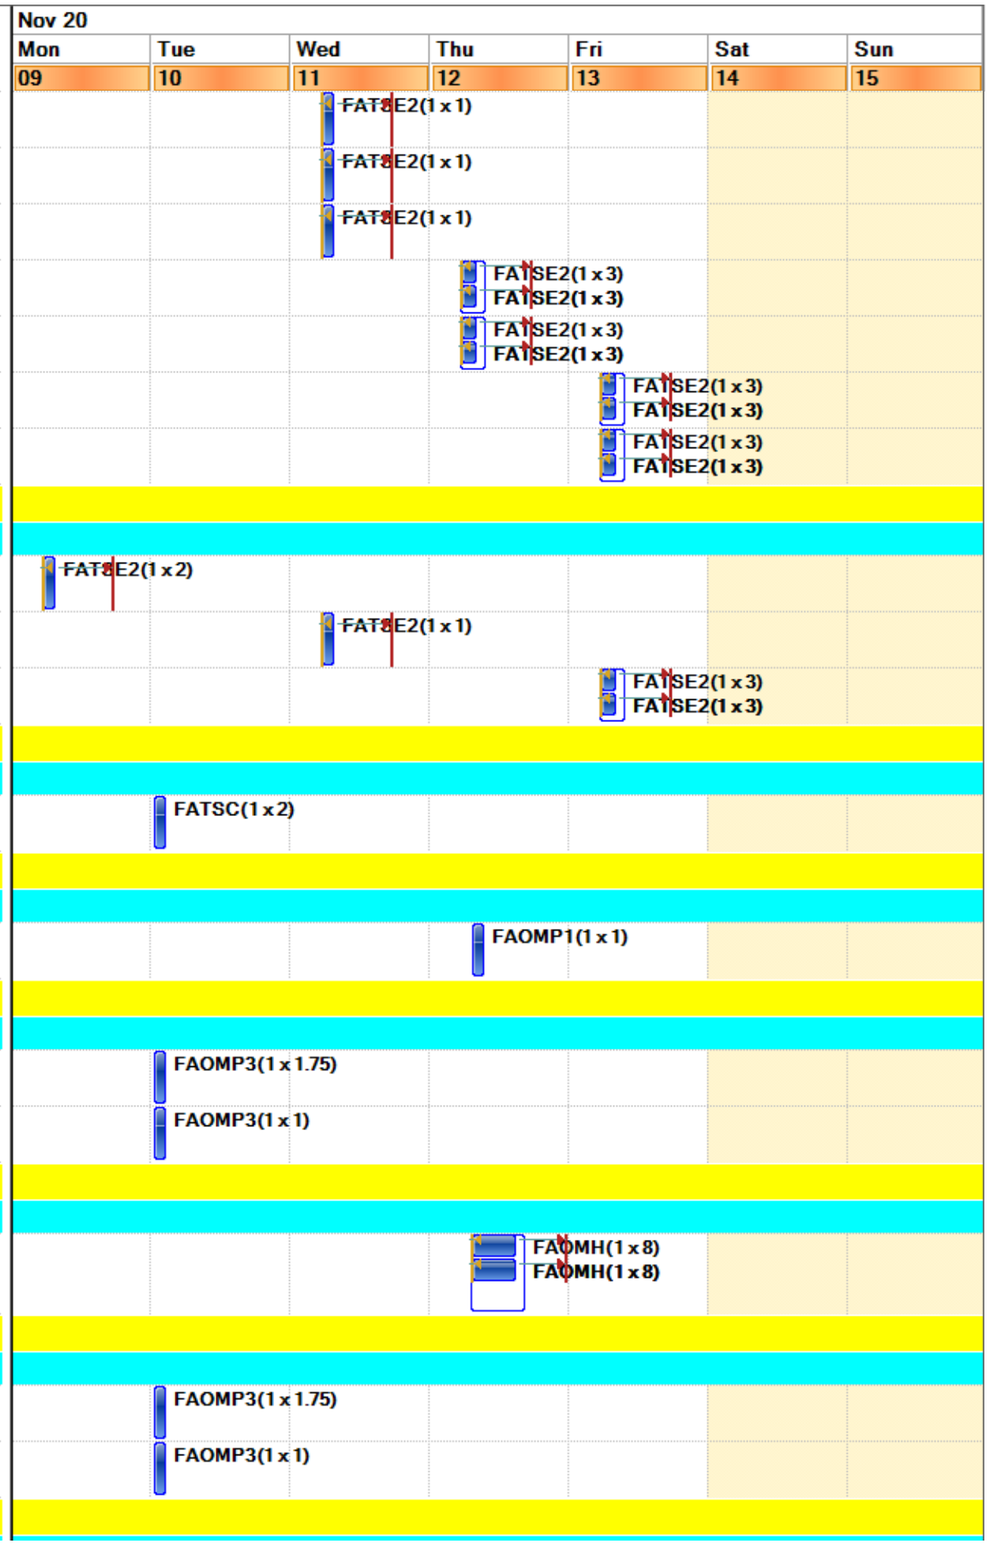

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
Work Type Group : PMs (1 item)											
1	W0227651	PM FOR 62CBL 001	FAOMP2	Tafoya,Eric		FAOMP2(1 x 1.5)					
Location : 062D-0199 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0227653	PM FOR 62DBL 001	FAOMP2	Tafoya,Eric		FAOMP2(1 x 1.5)					
Location : 063-0199 (1 item) (Total=2)											
Work Type Group : Code Complaint PMs (2 items)											
1	W0224727	PM FOR 63 BFP002 IND	FAOMP2	Gutierrez,Myrna					FAOMP2(1 x 1)		
2	W0224729	PM FOR 63 BFP003 IND	FAOMP2	Gutierrez,Myrna					FAOMP2(1 x 1)		
Location : 063-ROF1 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0227655	PM FOR 63 BL 002	FAOMP2	Gutierrez,Myrna					FAOMP2(1 x 1.5)		
Location : 064-0199 (3 items) (Total=2)											
Work Type Group : PMs (2 items)											
1	W0230717	PM FOR 64 BL 009	FAOMP1	Gutierrez,Myrna						FAOMP1(1 x 1)	
2	W0230795	PM FOR 64 BL 015	FAOMP1	Gutierrez,Myrna						FAOMP1(1 x 1)	
Location : 064-0199X (2 items) (Total=3)											
Work Type Group : Code Complaint PMs (2 items)											
1	W0230958	PM FOR 64 ARU 004	FAOMH	Gutierrez,Myrna		FAOMH(1 x .5)					
2	W0230960	PM FOR 64 ARU 005	FAOMH	Gutierrez,Myrna		FAOMH(1 x .5)					
Work Type Group : PROJECTS (1 item)											
1	W0231671	Reconnect conduit and conductors to Trailer outside B64 Roll-Up Door	FATSE1	Gutierrez,Myrna				FATSE1(1 x 8)			
Location : 064C-0100 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230498	Inspection of SW-A6 Bldg. 64C	FATSE2	Gutierrez,Myrna					FATSE2(1 x 1)		
Location : 064-ROF1 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0230636	PM FOR 64 BL 012	FAOMP1	Gutierrez,Myrna						FAOMP1(1 x 1)	
Location : 065-0100 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0231841	PM For Building 65 Emerg. Lights and Exit Signs	FAOML	Gutierrez,Myrna		FAOML(1 x 1)					
Location : 065A-0198 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0231843	PM For Building 65A Emerg. Lights and Exit Signs	FAOML	Gutierrez,Myrna
Location : 065B-0100 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0231845	PM For Building 65B Emerg. Lights and Exit Signs	FAOML	Gutierrez,Myrna
Location : 066-0110 (1 item) (Total=2)				
Work Type Group : Code Complaint PMs (2 items)				
1	W0231114	Monthly PM for 66 EG 109	FAOMP3	Tafoya,Eric
2	W0231121	PM FOR 66 TK 008	FAOMP3	Tafoya,Eric
Location : 066-0111 (2 items) (Total=4)				
Work Type Group : PMs (4 items)				
1	W0225250	PM FOR 66 KC 001A MATL Here	FAOMP1	Tafoya,Eric
2	W0225252	PM FOR 66 KC 001B MATL Here	FAOMP1	Tafoya,Eric
3	W0231104	PM FOR 66 EX 001	FAOMP1	Tafoya,Eric
4	W0225232	PM FOR DUPLEX 66 KC 003 MATL at Office	FAOMP1	Tafoya,Eric
Location : 066-0114 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0223465	Replace batteries in B66 fire alarm panel	FATSD	Tafoya,Eric
Location : 066-0199 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0220656	Laborers to assist plumbers by digging out christy box and soil for plumbing repair clearance.	FATSL	Tafoya,Eric
Location : 066-0427 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0231773	HVAC to perform complete evaluation of the spaces affected by the flood.	FAOMH	Tafoya,Eric
Location : 066A-0100 (1 item) (Total=2)				
Work Type Group : PMs (2 items)				
1	W0230380	Battery Bank PM Switchstation SW-A5	FATSE2	Tafoya,Eric
2	W0230486	Inspection of SW-A5 Bldg. 66A	FATSE2	Tafoya,Eric
Location : 067-1107 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231401	Grp PM Monthly -B67 FTU Unit 11/12	FAOMP2	Tafoya,Eric

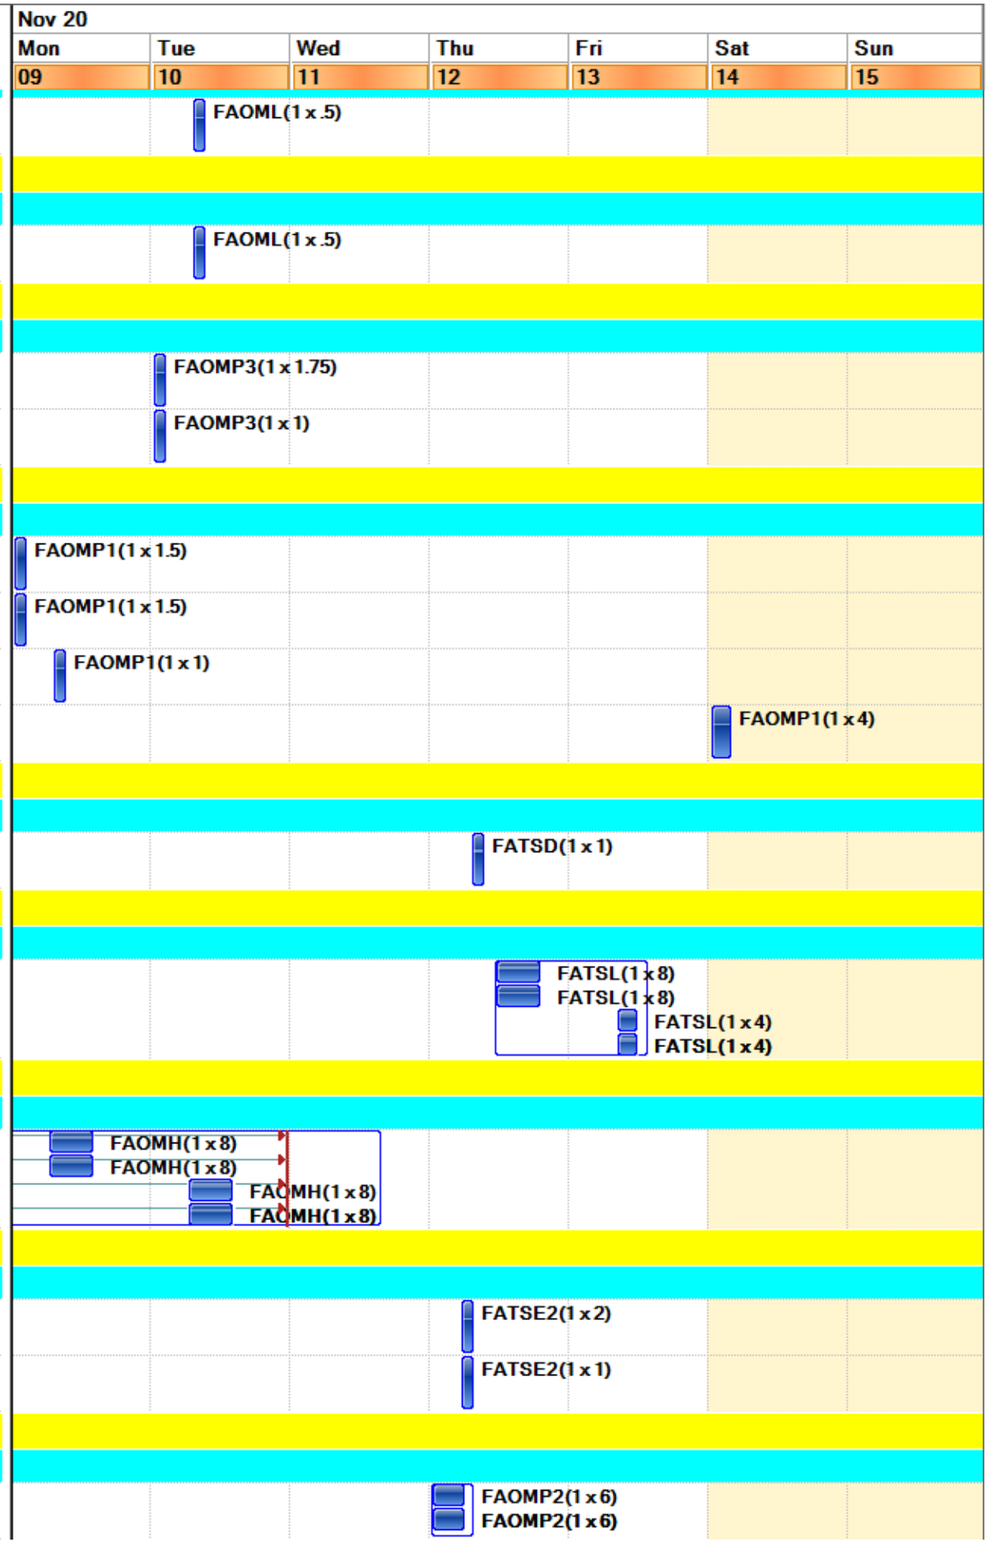

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
Location : 067-2204 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229705	Provide normal power to microscopes during e-power shutdown	FATSE1	Tafoya,Eric
Location : 067-5218 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231408	PM FOR 67 RES005 - READ LONG DESC.	FAOMP2	Tafoya,Eric
Location : 067A-0101 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231112	PM 67AEX001 NOV	FAOMP3	Tafoya,Eric
Location : 067A-0102 (2 items) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0219367	(Parent)Maintain building temperature set point and secure chiller daily at 5:30pm	FAOMH	Tafoya,Eric
2	W0219368	(Child) Start Chiller and monitor equipment until secured daily.	FMCS	Tafoya,Eric
Location : 068-0101 (2 items) (Total=2)				
Work Type Group : Code Complaint PMs (2 items)				
1	W0229804	PM NFPA72 BLDG. 68 fire alarm system ITM	FATSD	Rini,Christopher G
2	W0230071	PM NFPA25 BLDG. 68 grid booster pump ITM (weekly)	FATSD	Rini,Christopher G
Location : 068-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229936	PM NFPA25 BLDG. 68/75F sprinkler ITM	FATSD	Rini,Christopher G
Location : 068TK001 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0230059	PM NFPA25 BLDG. 68 water storage tank ITM	FATSD	Rini,Christopher G
Location : 069-0131 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230979	PM FOR 69 AC 012	FAOMH	Rini,Christopher G
Location : 070-0111B (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0227451	(Parent) Cover wood panels and glass panels with sheet rock.	FATSC	Escobedo,Carlos
Location : 070-0130 (1 item) (Total=2)				
Work Type Group : Code Complaint PMs (2 items)				

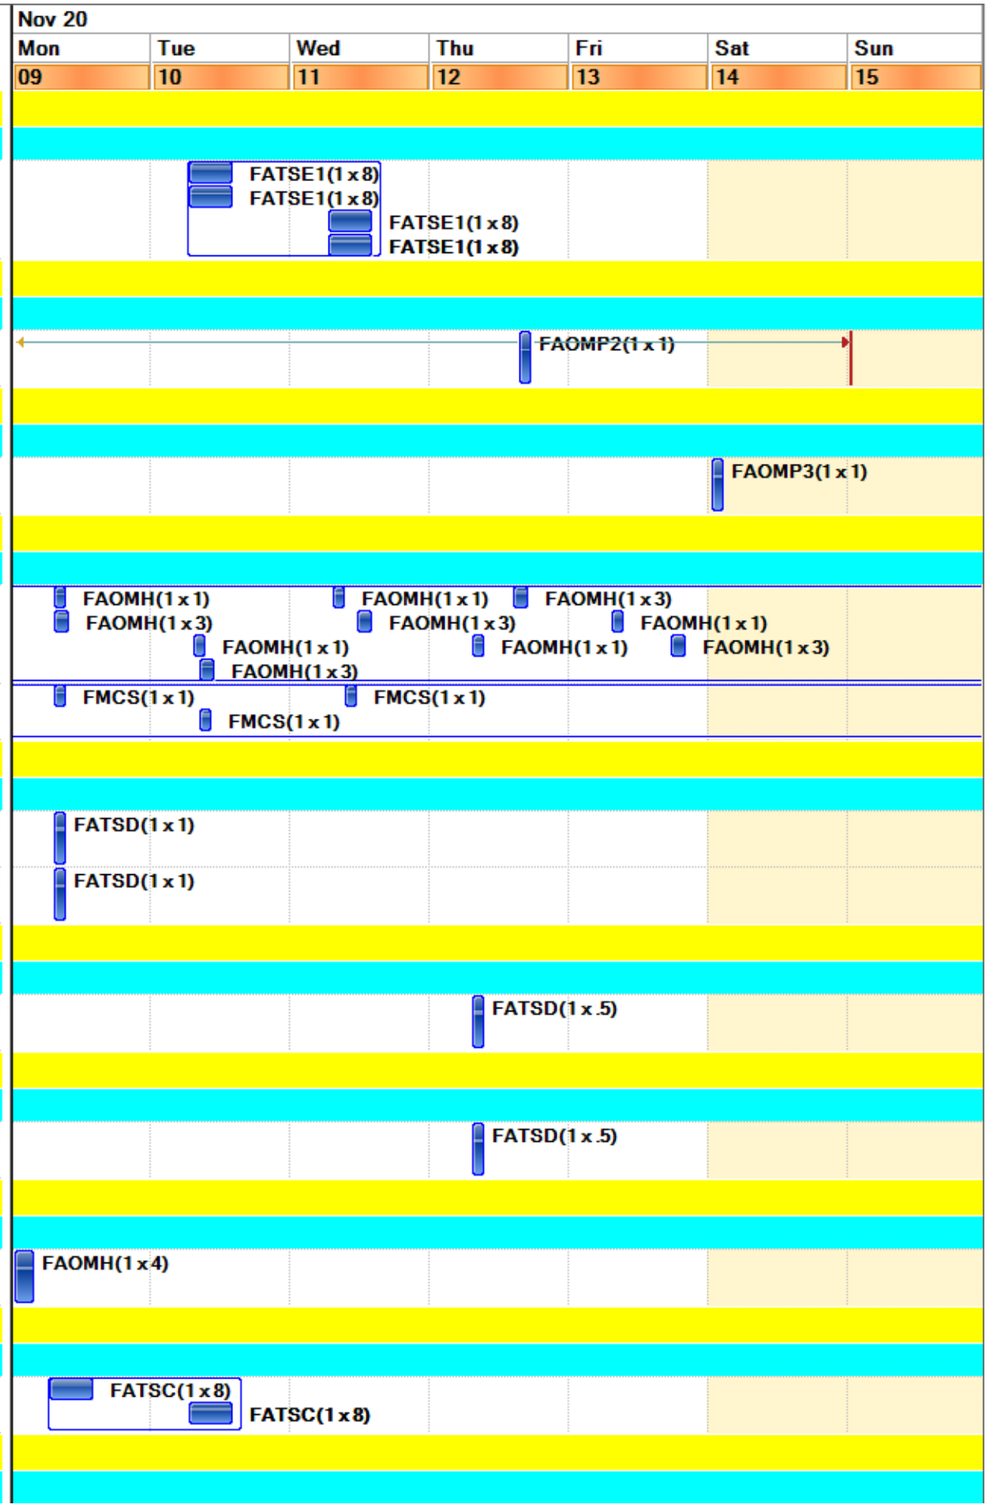

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0231106	Monthly PM for 70 EG 106	FAOMP3	Escobedo,Carlos
2	W0231110	PM FOR 70 TK 016	FAOMP3	Escobedo,Carlos
Location : 070-0150 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0232019	Relamp fixture inside the elevator.	FAOML	Escobedo,Carlos
Location : 070-0183 (2 items) (Total=2)				
Work Type Group : PMs (2 items)				
1	W0228483	PM FOR 70 BR 017 MATL in Office	FAOMP3	Escobedo,Carlos
2	W0231516	PM FOR 70 BR 014	FAOMP3	Escobedo,Carlos
Location : 070-0198 (2 items) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0231855	PM For Building 70 Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
Location : 070-0199 (2 items) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229948	PM NFPA25 BLDG. 70 sprinkler ITM	FATSD	Escobedo,Carlos
Location : 070-0199X (1 item) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0226362	(Parent) Remove and replace blower motor, belts, and sheaves.	FAOMP1	Escobedo,Carlos
2	W0228104	(Child) Provide LOTO and motor replacement support.	FATSE2	Escobedo,Carlos
Location : 070-0206 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0232023	(Child) Move tabletop from loading dock to room 206	FATSR	Escobedo,Carlos
Location : 070-0264 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0231775	Troubleshoot rooms found to be offline after outage.	FMCS	Escobedo,Carlos
Location : 070-0294 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0220739	Install two sided Exit/Bug light in Corridor 294	FATSE1	Escobedo,Carlos
Location : 070A-1105 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0231569	Relamp fixtures inside lab space. (Escort required)	FAOML	Escobedo,Carlos
Location : 070A-1109 (1 item) (Total=1)				

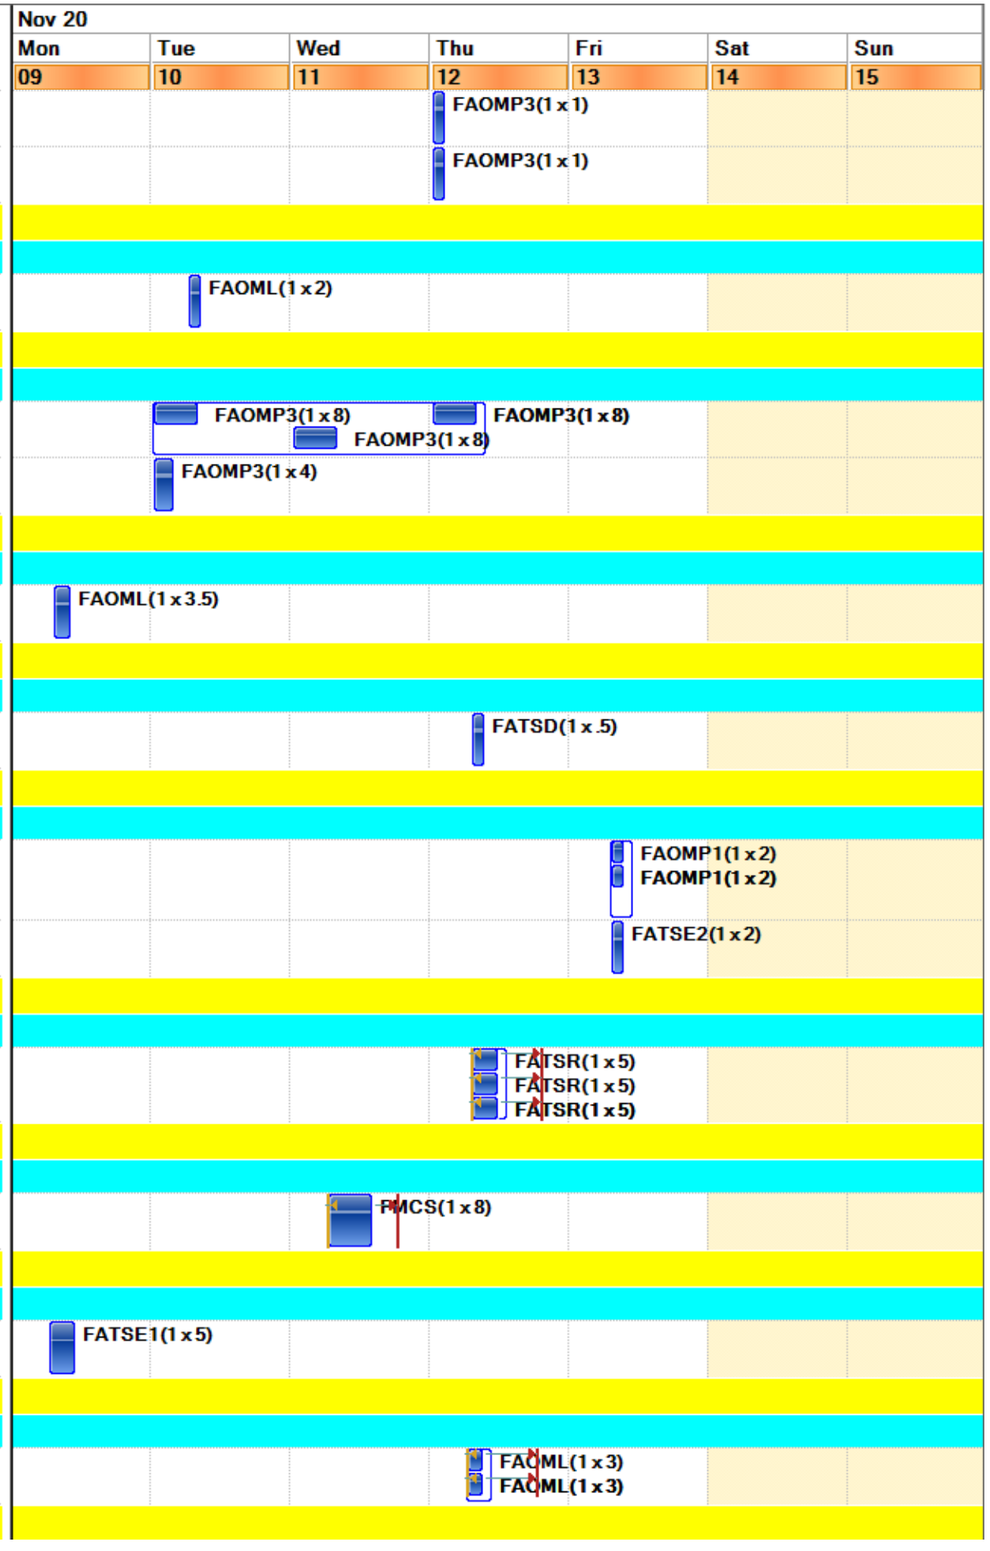

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
	Work Type Group : CMR, Etc (1 item)			
1	W0231570	Relamp light fixtures inside the lab space. (Escort required).	FAOML	Escobedo,Carlos
	Location : 070A-1109A (1 item) (Total=1)			
	Work Type Group : CMR, Etc (1 item)			
1	W0231571	Relamp biosafety cabinet. (Escort required and cabinet swiped prior to start of work)	FAOML	Escobedo,Carlos
	Location : 070A-1129 (1 item) (Total=1)			
	Work Type Group : CMR, Etc (1 item)			
1	W0229373	Move a Mass Spectrometer from hallway to Table	FATSR	Escobedo,Carlos
	Location : 070A-1196 (2 items) (Total=2)			
	Work Type Group : CMR, Etc (1 item)			
1	W0217546	Paint and patch screw holes next to each alarm bell @ B70A - 1st floor	FATSP	Escobedo,Carlos
	Work Type Group : Code Complaint PMs (1 item)			
1	W0231869	PM For Building 70A Emerg. Lights and Exit Signs	FAOML	Escobedo,Carlos
	Location : 070A-1199 (1 item) (Total=2)			
	Work Type Group : Code Complaint PMs (2 items)			
1	W0227243	PM NFPA25 BLDG. 70A sprinkler ITM	FATSD	Escobedo,Carlos
2	W0229942	PM NFPA25 BLDG. 70A sprinkler ITM	FATSD	Escobedo,Carlos
	Location : 070A-2295 (1 item) (Total=1)			
	Work Type Group : CMR, Etc (1 item)			
1	W0217545	Paint and patch screw holes next to each alarm bell @ B70A - 2nd floor	FATSP	Escobedo,Carlos
	Location : 070A-3396 (2 items) (Total=1)			
	Work Type Group : Code Complaint PMs (1 item)			
1	W0227114	PM NFPA72 BLDG. 70A/70B/70E fire alarm system ITM	FATSD	Escobedo,Carlos
	Location : 070A-4463 (2 items) (Total=1)			
	Work Type Group : CMR, Etc (1 item)			
1	W0230277	(Child) Rough in condensate drain line for 1 ton portable ac unit.	FATSF	Escobedo,Carlos
	Location : 070A-4463C (1 item) (Total=1)			
	Work Type Group : CMR, Etc (1 item)			
1	W0223706	(Child) Remove shelves prior to start of paint work and re-install when work is complete.	FATSC	Escobedo,Carlos

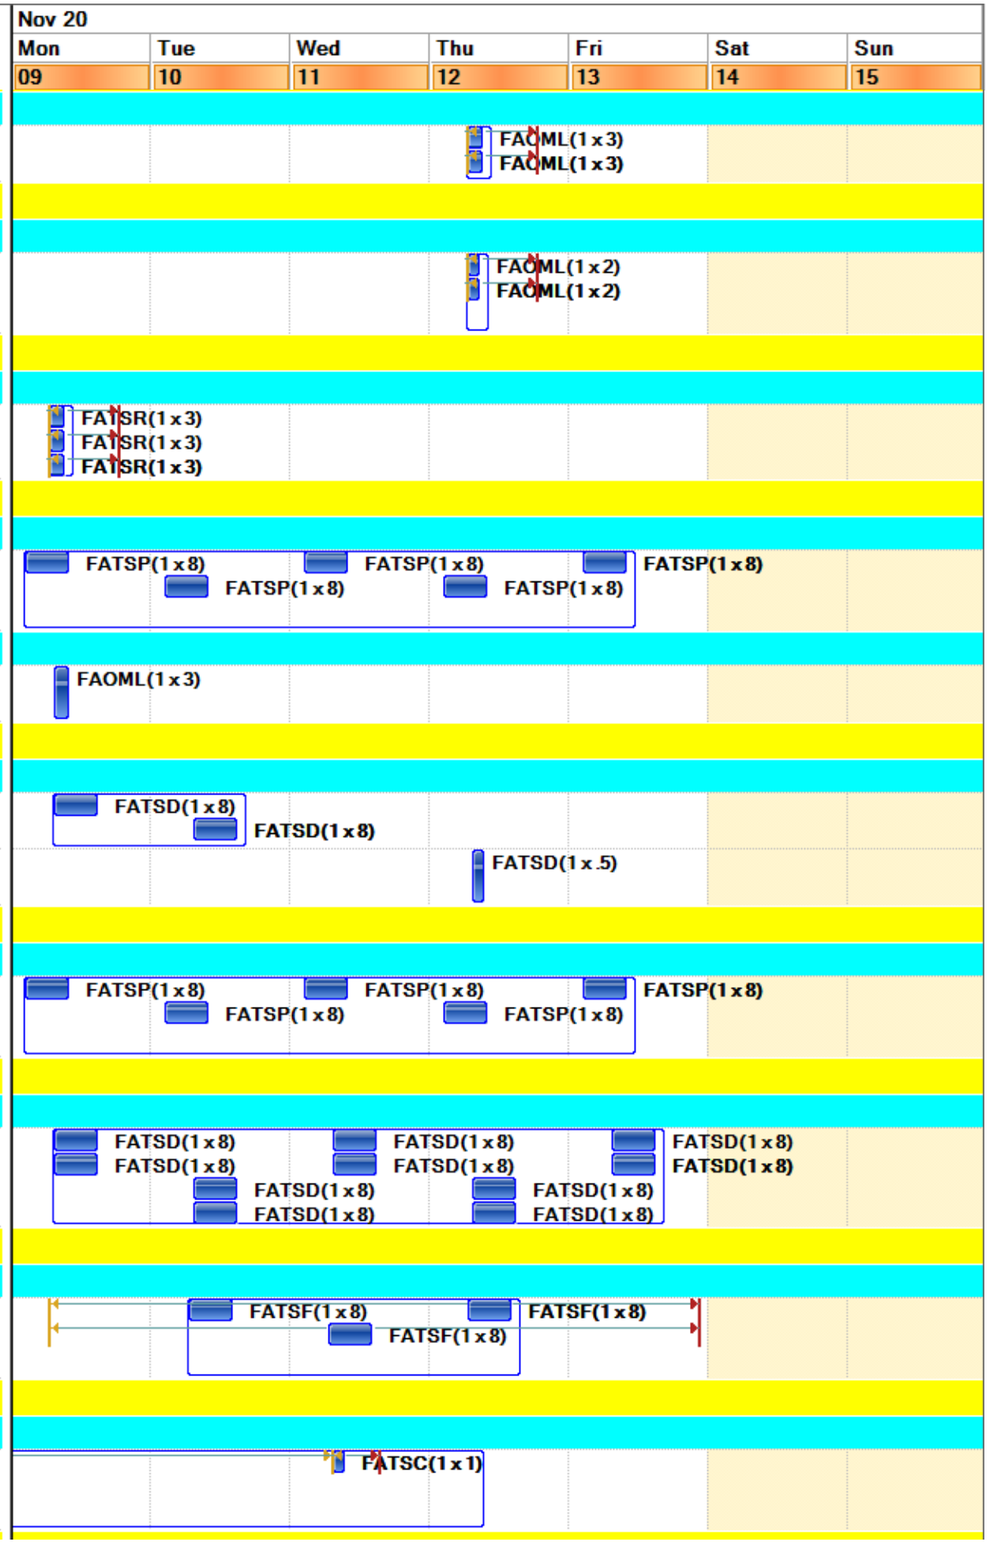

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
Location : 071-0126 (1 item) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0230106	Rigger's to move new BELLA Beamline Compressor Chamber into 71-0126	FATSR	Atkinson,Joseph
2	W0230629	FATSL to support in transport of Compressor Chamber (see attached instructions)	FATSL	Atkinson,Joseph
Location : 071-0199 (2 items) (Total=2)				
Work Type Group : PMs (2 items)				
1	W0231130	PM for TRW filter 71 FL 002 11/9 -11/15	FAOMP3	Atkinson,Joseph
2	W0231142	PM for TRW filter 71 FL 003 11/9 - 11/15	FAOMP3	Atkinson,Joseph
Location : 071K-0199 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0228574	PM FOR 71KAC 002	FAOMH	Atkinson,Joseph
Location : 071-ROF1 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229701	Troubleshoot zone 253A-D of AHU 029 - reading 63 degrees. AHU HHWV commanded to 100% open and only	FAOMH	Atkinson,Joseph
Location : 072-0100B (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230981	PM FOR 72 DSRO 001	FAOMH	Tafoya,Eric
Location : 074-0110 (1 item) (Total=2)				
Work Type Group : PMs (2 items)				
1	W0230983	BLDG 74 DAIKIN SPLIT AC	FAOMH	Atkinson,Joseph
2	W0230985	BLDG 74 DAIKIN SPLIT AC	FAOMH	Atkinson,Joseph
Location : 074-0111 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230987	BLDG 74 DAIKIN SPLIT AC	FAOMH	Atkinson,Joseph
Location : 074-0111B (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230989	BLDG 74 DAIKIN SPLIT AC	FAOMH	Atkinson,Joseph
Location : 074-0118 (2 items) (Total=7)				
Work Type Group : Code Complaint PMs (4 items)				
1	W0227478	BLDG 74 BACK FLOW PREVENTOR	FAOMP2	Atkinson,Joseph

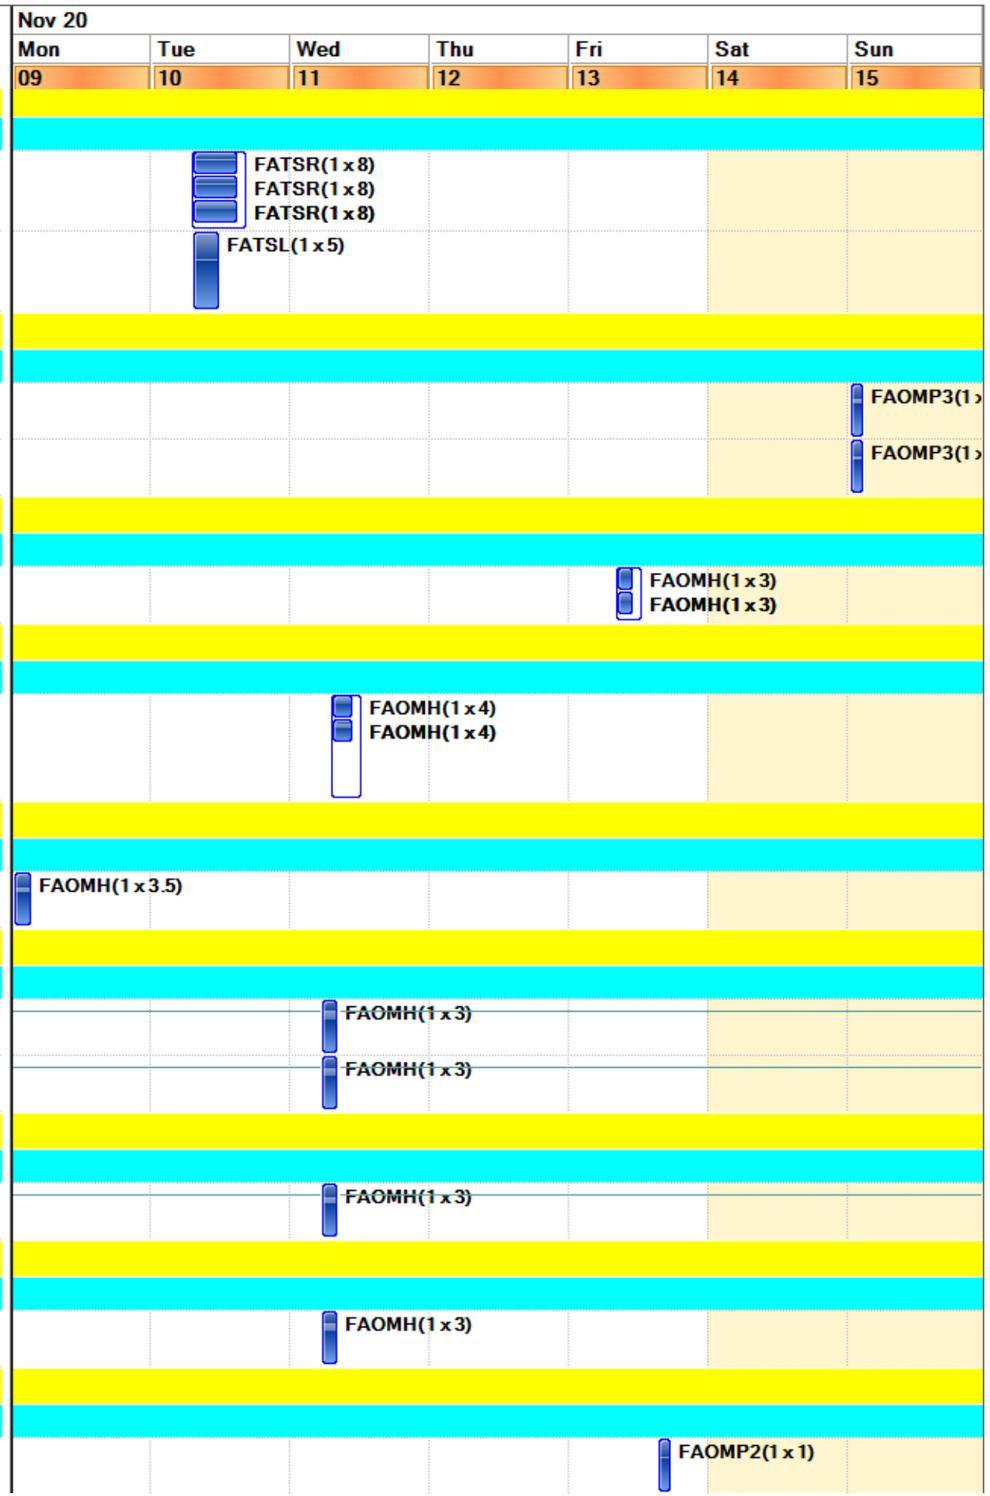

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
2	W0227480	BLDG 74 BACK FLOW PREVENTOR	FAOMP2	Atkinson,Joseph
3	W0227482	BLDG 74 BACK FLOW PREVENTOR	FAOMP2	Atkinson,Joseph
4	W0227484	BLDG 74 BACK FLOW PREVENTOR	FAOMP2	Atkinson,Joseph
Work Type Group : PMs (3 items)				
1	W0230999	BLDG 74 PIONEER AIR DRYER	FAOMH	Atkinson,Joseph
2	W0227930	BLDG 74 POWEREX AIR COMPRESSOR NOV	FAOMP2	Atkinson,Joseph
3	W0227934	BLDG 74 POWEREX AIR COMPRESSOR NOV	FAOMP2	Atkinson,Joseph
Location : 074-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229960	PM NFPA25 BLDG. 74 sprinkler ITM	FATSD	Atkinson,Joseph
Location : 075-0112F (1 item) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0212543	FATSC to install replacement glass for window kit	FATSC	Rini,Christopher G
2	W0223859	Painters to caulk around casing of new window and paint the exterior and interior portions of the do	FATSP	Rini,Christopher G
Location : 076-0123 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0213723	Check active Alarms on both systems ALC & JCI , assist other crafts on controls issues	FMCS	Rini,Christopher G
Location : 076-0199 (2 items) (Total=4)				
Work Type Group : Code Complaint PMs (3 items)				
1	W0231331	Monthly PM FOR 76 TK 013	FAOMP3	Rini,Christopher G
2	W0231333	Monthly PM FOR 76 TK 014	FAOMP3	Rini,Christopher G
3	W0229966	PM NFPA25 BLDG. 76/76L sprinkler ITM	FATSD	Rini,Christopher G
Work Type Group : PMs (1 item)				
1	W0231520	B76 Fuel Spill Containment Basin 11/9 - 11/15	FAOMP3	Rini,Christopher G
Location : 076-0221A (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229391	HVAC to troubleshoot thermostat hot temperature & battery replacement	FAOMH	Rini,Christopher G
Location : 077-0142A (1 item) (Total=1)				
Work Type Group : PMs (1 item)				

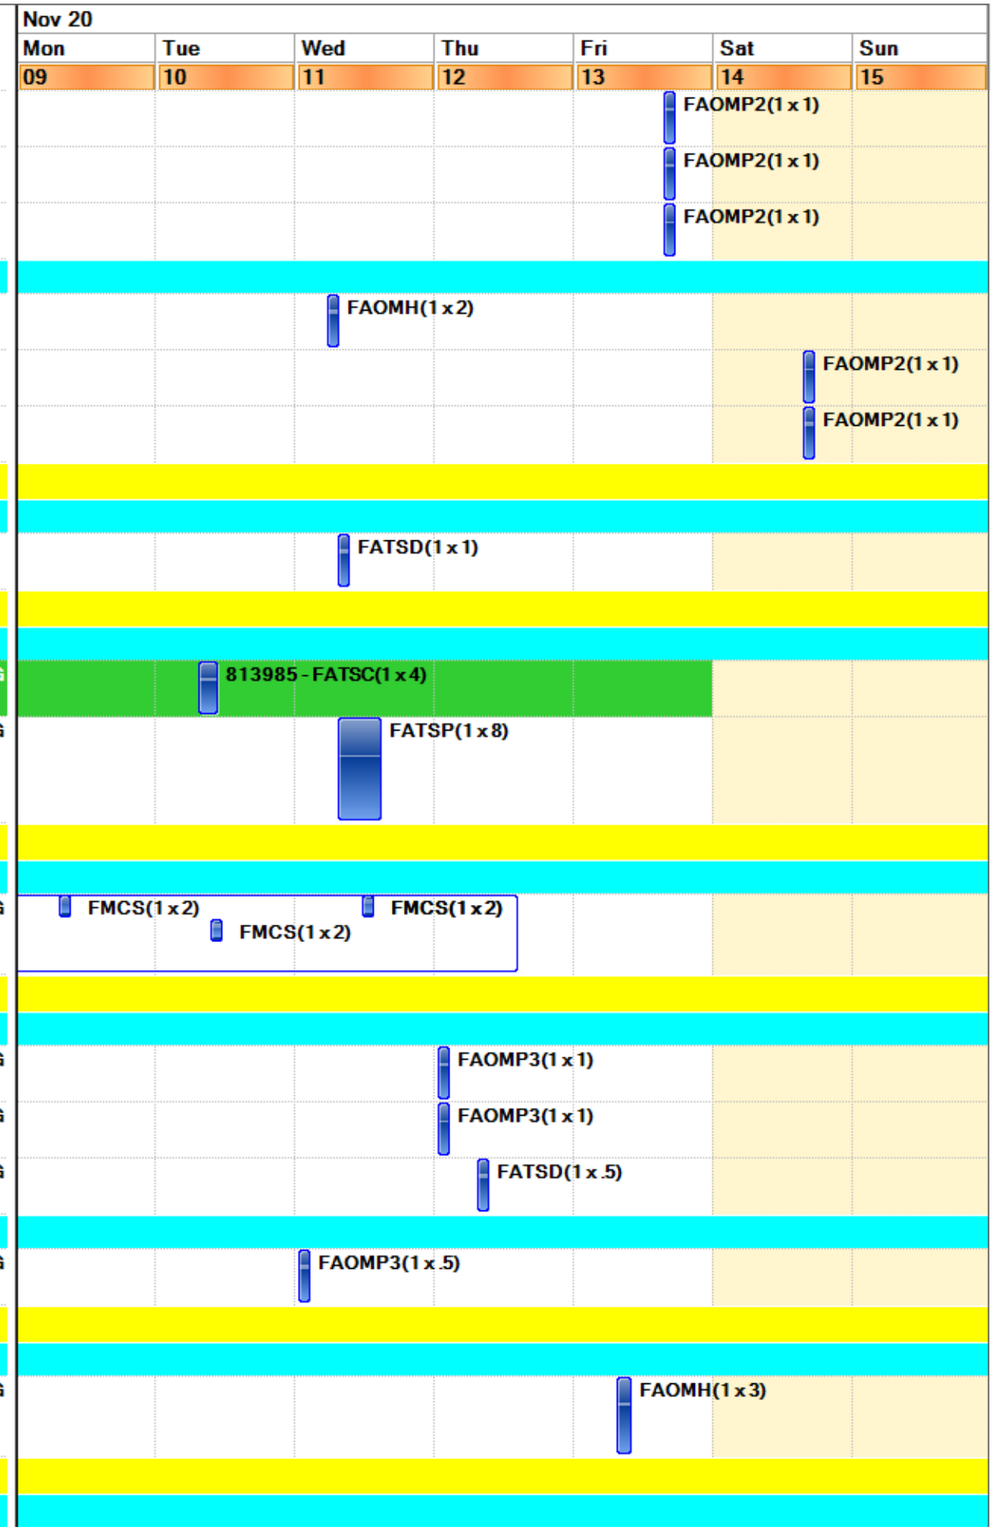

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0211501	PM FOR 77 AHU022 MATL Here	FAOMP1	Rini,Christopher G
Location : 077-0199 (2 items) (Total=2)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229972	PM NFPA25 BLDG. 77 sprinkler ITM	FATSD	Rini,Christopher G
Work Type Group : PMs (1 item)				
1	W0231001	PM FOR 77 ADR007	FAOMH	Rini,Christopher G
Location : 077-0199X (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0228732	PM FOR 77 RF 004	FAOMH	Rini,Christopher G
Location : 077A-0104 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0226062	LOTO Support for Contractor Work	FATSE1	Rini,Christopher G
Location : 077A-0199 (2 items) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229969	PM NFPA25 BLDG. 77A sprinkler ITM	FATSD	Rini,Christopher G
Location : 077J-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0227488	PM FOR 77JBFP001	FAOMP2	Rini,Christopher G
Location : 077-SKID (3 items) (Total=4)				
Work Type Group : CMR, Etc (1 item)				
1	W0207331	(Parent) Prepare chiller ARU004 for vendor Retubing and Provide vendor support as needed	FAOMH	Rini,Christopher G
Work Type Group : Code Complaint PMs (1 item)				
1	W0231510	Boiler 77 BR 004 (Laars Rheos+) PM	FAOMP3	Rini,Christopher G
Work Type Group : PMs (2 items)				
1	W0225220	PM ON 77 FL001 (PEP IMF Water Filter, Sand)	FAOMP1	Rini,Christopher G
2	W0225222	PM ON 77 FL002 (PEP IMF Water Filter, Sand)	FAOMP1	Rini,Christopher G
Location : 078-0103 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0228498	FATSE2 to troubleshoot why snorkel to HEPA Air Filter doesn't power up	FATSE2	Rini,Christopher G
Location : 078-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				

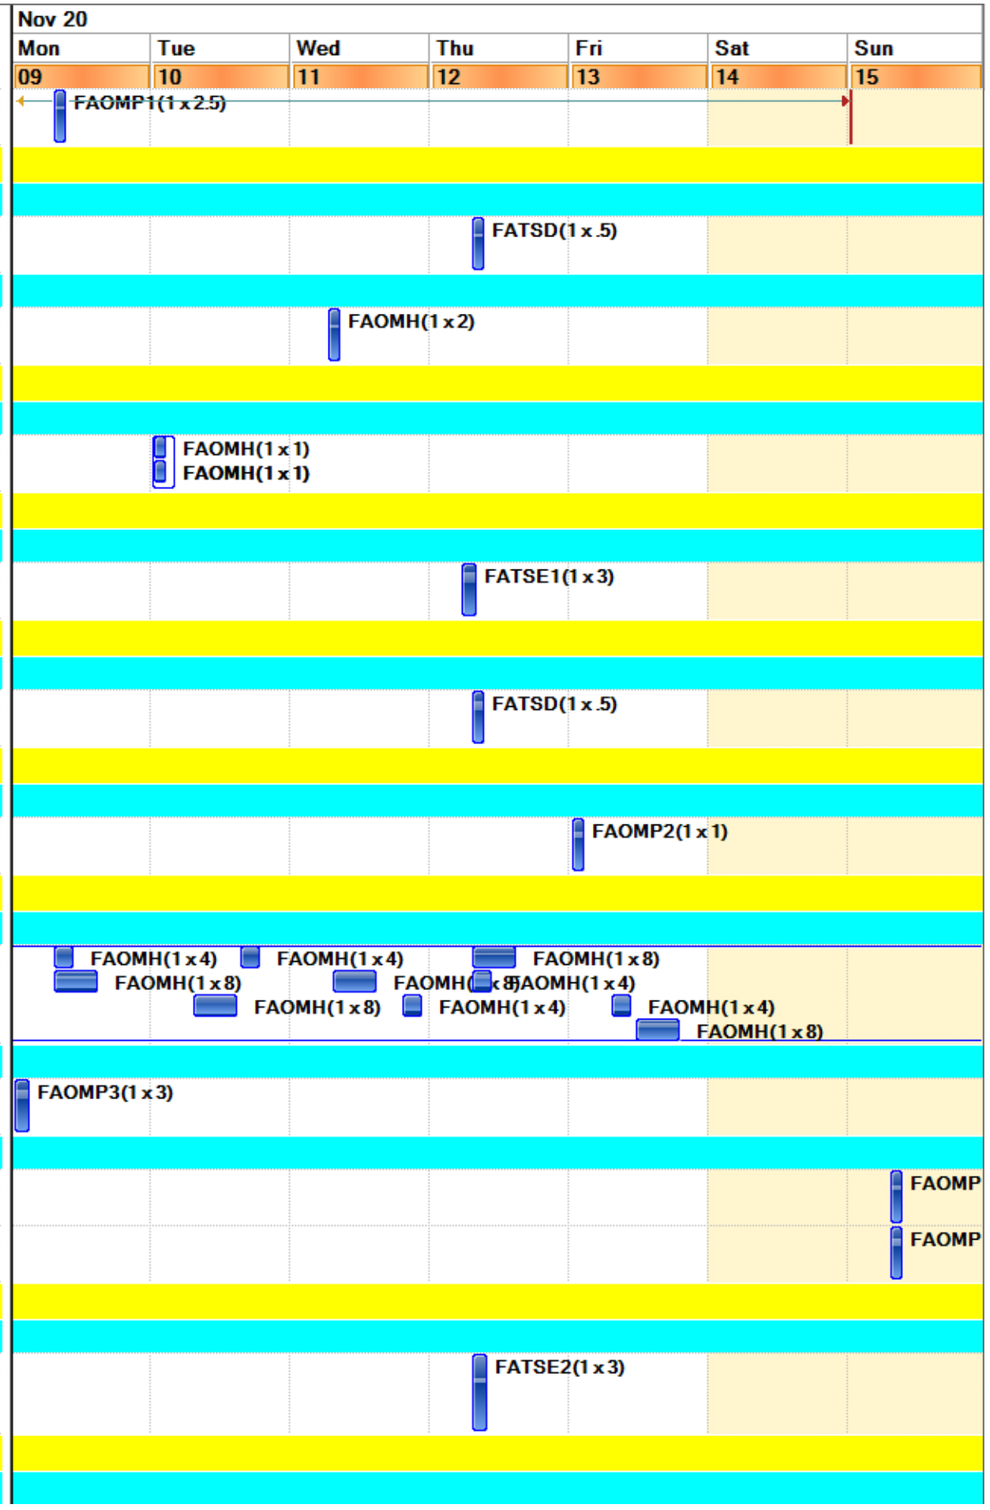

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
1	W0229975	PM NFPA25 BLDG. 78/76K sprinkler ITM	FATSD	Rini,Christopher G				FATSD(1 x .5)			
Location : 078-ROF1 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0232017	PMT's to barricade parking spaces. SEE ATTACHED SCHEMATIC	FAOMP2	Rini,Christopher G					FAOMP2(1 x 1) FAOMP2(1 x 1)		
Location : 079-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229846	PM NFPA25 BLDG. 79 sprinkler ITM	FATSD	Rini,Christopher G				FATSD(1 x .5)			
Location : 079A-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229843	PM NFPA25 BLDG. 79A sprinkler ITM	FATSD	Rini,Christopher G				FATSD(1 x .5)			
Location : 080-0010 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0231727	(Parent)Dedicated Oven Receptacles	FATSE	Reisinger,Richard I		FATSE(1 x 8)	FATSE(1 x 8)	FATSE(1 x 8)	FATSE(1 x 8)		
						FATSE(1 x 8)		FATSE(1 x 8)			
Location : 080-0028 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0227899	PM FOR 80 GP 010	FAOMP2	Reisinger,Richard I	FAOMP2(1 x .5)						
Location : 080-0110 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0231008	PM FOR 80 VAV001	FAOMH	Reisinger,Richard I					FAOMH(1 x 1)		
Location : 080-0203A (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0231017	PM FOR 80 VAV005	FAOMH	Reisinger,Richard I					FAOMH(1 x 1)		
Location : 080-0210 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0231015	PM FOR 80 VAV004	FAOMH	Reisinger,Richard I					FAOMH(1 x 1)		
Location : 080-0210A (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0231010	PM FOR 80 VAV002	FAOMH	Reisinger,Richard I					FAOMH(1 x 1)		
Location : 080-0214 (1 item) (Total=1)											
Work Type Group : PMs (1 item)											
1	W0231013	PM FOR 80 VAV003	FAOMH	Reisinger,Richard I					FAOMH(1 x 1)		
Location : 081-0101 (1 item) (Total=3)											
Work Type Group : Code Complaint PMs (3 items)											

Final Schedule

	Work Order	Description	Lead Craft	FAM Name	Nov 20 Mon 09	Tue 10	Wed 11	Thu 12	Fri 13	Sat 14	Sun 15
1	W0231083	PM FOR 76 TK 009	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1)				
2	W0231091	PM FOR 76 TK 010	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1)				
3	W0231162	PM FOR 76 TK 011	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1)				
Location : 081-0199 (1 item) (Total=6)											
Work Type Group : Code Complaint PMs (6 items)											
1	W0231081	Monthly PM for 76 EG 075	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1.75)				
2	W0231087	Monthly PM for 76 EG 093	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1.75)				
3	W0231160	Monthly PM for 76 EG 116	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1.75)				
4	W0231329	PM FOR 76 TK 008 (Monthly PM for 76 EG 067 Retired)	FAOMP3	Atkinson,Joseph			FAOMP3(1 x 1)				
5	W0231170	Monthly PM for 76 EG 117	FAOMP3	Atkinson,Joseph				FAOMP3(1 x 1.75)			
6	W0231172	PM FOR 76 TK 012	FAOMP3	Atkinson,Joseph				FAOMP3(1 x 1)			
Location : 082-0100 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0230086	PM NFPA25 BLDG. 82 grid booster pump ITM (weekly)	FATSD	Atkinson,Joseph	FATSD(1 x 1)						
Location : 083-0106 (1 item) (Total=2)											
Work Type Group : CMR, Etc (2 items)											
1	W0224209	FATSF to repair industrial cold water leak in crawl space above women's shower	FATSF	Atkinson,Joseph			FATSF(1 x 8) FATSF(1 x 8) FATSF(1 x 4) FATSF(1 x 4)				
2	W0224497	PMT's already placed an ADMIN LOTO on cold water industrial line to prevent further leaking	FAOMP1	Atkinson,Joseph			FAOMP1(1 x 1)	FAOMP1(1 x 1)			
Location : 083-0199 (1 item) (Total=1)											
Work Type Group : Code Complaint PMs (1 item)											
1	W0229990	PM NFPA25 BLDG. 83/83A sprinkler ITM	FATSD	Atkinson,Joseph			FATSD(1 x 1)				
Location : 084-0115 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0231635	Replace burnt out lamps and or/ballasts as requested by the customer/client. See long text for more	FAOML	Atkinson,Joseph	FAOML(1 x 3) FAOML(1 x 3)						
Location : 084-0195 (1 item) (Total=1)											
Work Type Group : CMR, Etc (1 item)											
1	W0230321	Replace burnt out lamps and or/ballasts as requested by the customer/client. See long text for more	FAOML	Atkinson,Joseph	FAOML(1 x 3) FAOML(1 x 3)						

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
Location : 084-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229996	PM NFPA25 BLDG. 84 sprinkler ITM	FATSD	Atkinson,Joseph
Location : 084-0369A (1 item) (Total=1)				
Work Type Group : PROJECTS (1 item)				
1	W0229328	LOTO support for contractor work.	FATSE1	Atkinson,Joseph
Location : 084B-0199X (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229993	PM NFPA25 BLDG. 84B sprinkler ITM	FATSD	Atkinson,Joseph
Location : 085-0103 (1 item) (Total=3)				
Work Type Group : PMs (3 items)				
1	W0228074	PM FOR 85 AHU001	FAOMP1	Atkinson,Joseph
2	W0228076	PM FOR 85 AHU002	FAOMP1	Atkinson,Joseph
3	W0228078	PM FOR 85 AHU003	FAOMP1	Atkinson,Joseph
Location : 085-0199 (3 items) (Total=3)				
Work Type Group : Code Complaint PMs (2 items)				
1	W0229840	PM NFPA25 BLDG. 85 HEF ITM	FATSD	Atkinson,Joseph
2	W0230005	PM NFPA25 BLDG. 85/85D wet/dry sprinkler ITM	FATSD	Atkinson,Joseph
Work Type Group : PMs (1 item)				
1	W0231518	Weekly PM test of 85 ALT 096 11/9 - 11/15	FAOMP3	Atkinson,Joseph
Location : 085-0215 (1 item) (Total=5)				
Work Type Group : PMs (5 items)				
1	W0228080	PM FOR 85 AHU004	FAOMP1	Atkinson,Joseph
2	W0228082	PM FOR 85 AHU005	FAOMP1	Atkinson,Joseph
3	W0228084	PM FOR 85 AHU006	FAOMP1	Atkinson,Joseph
4	W0227946	PM FOR 85 KC 001A	FAOMP1	Atkinson,Joseph
5	W0227948	PM FOR 85 KC 001B	FAOMP1	Atkinson,Joseph
Location : 085A-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0229999	PM NFPA25 BLDG. 85A AFFF deluge ITM	FATSD	Atkinson,Joseph
Location : 085B-0199 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				

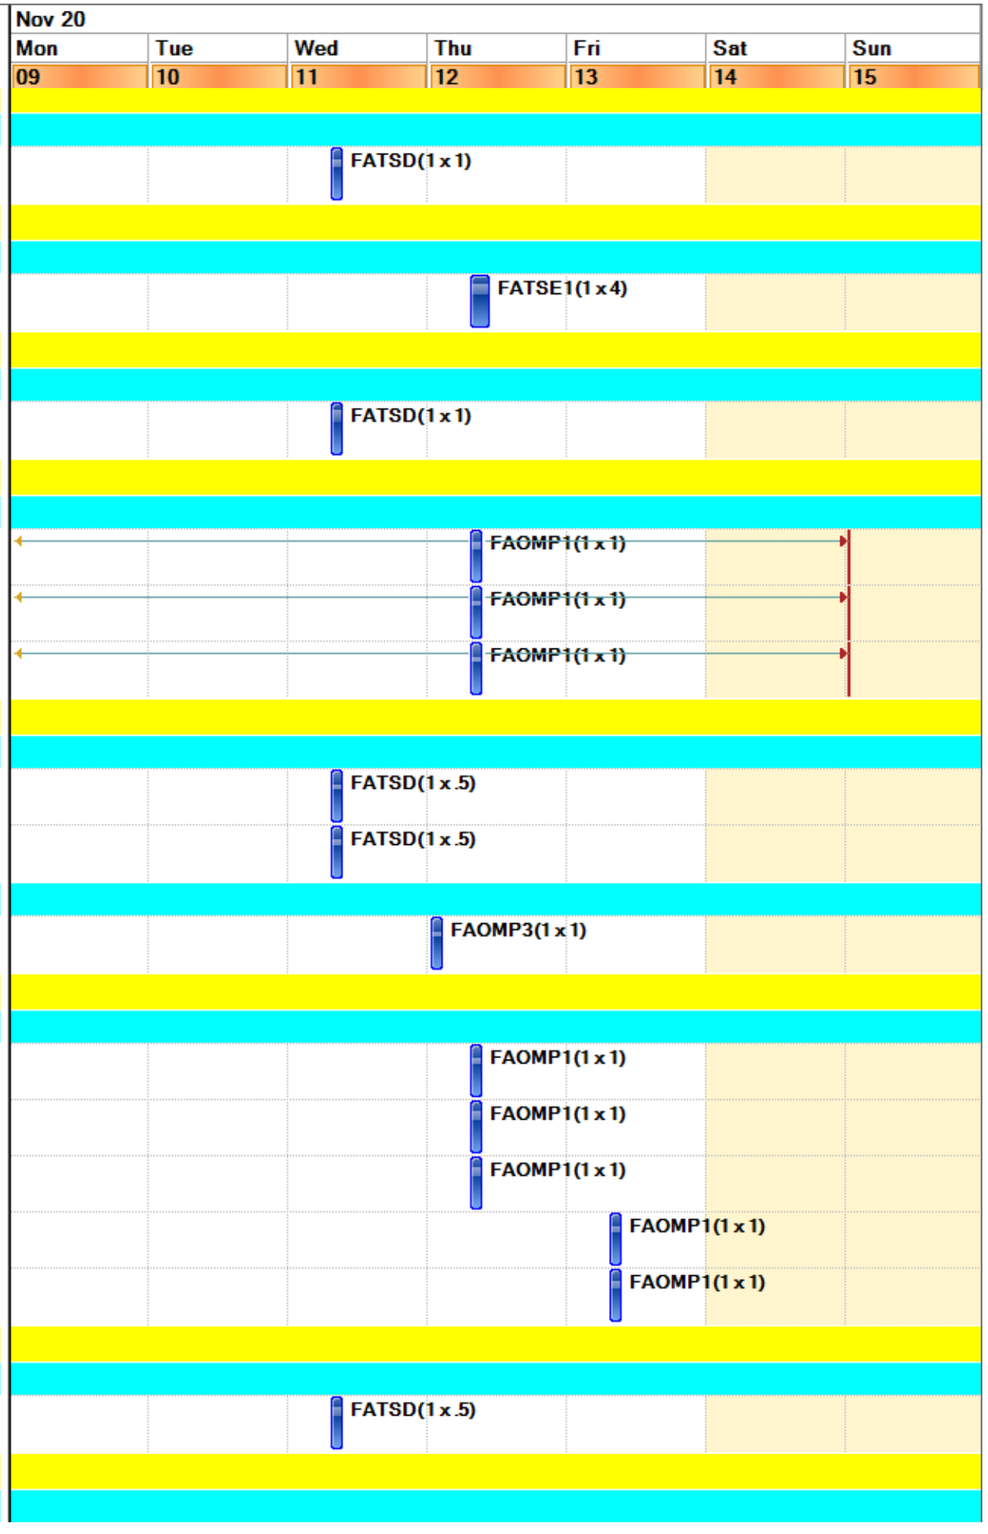

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0230002	PM NFPA25 BLDG. 85B sprinkler ITM	FATSD	Atkinson,Joseph
Location : 085D-0100 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230737	PM FOR 85DBL 001	FAOMP1	Atkinson,Joseph
Location : 085E-0100 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230739	PM FOR 85EBL 001	FAOMP1	Atkinson,Joseph
Location : 085F-0100 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230741	PM FOR 85FBL 001	FAOMP1	Atkinson,Joseph
Location : 085G-0100 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230743	PM FOR 85GBL 001	FAOMP1	Atkinson,Joseph
Location : 085H-0100 (1 item) (Total=2)				
Work Type Group : PMs (2 items)				
1	W0230745	PM FOR 85HBL 001	FAOMP1	Atkinson,Joseph
2	W0230747	PM FOR 85HBL 002	FAOMP1	Atkinson,Joseph
Location : 085J-0100 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0230749	PM FOR 85JBL 001	FAOMP1	Atkinson,Joseph
Location : 085TK003 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0231353	Monthly PM FOR 85 TK 003	FAOMP3	Atkinson,Joseph
Location : 086-0199 (2 items) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0230008	PM NFPA25 BLDG. 86 sprinkler ITM	FATSD	Atkinson,Joseph
Location : 086-ROF1 (1 item) (Total=3)				
Work Type Group : PMs (3 items)				
1	W0225889	PM-C for 86 AC 001 - "Coordinate Mon or Tues Only"	FAOMH	Atkinson,Joseph
2	W0225891	PM-C for 86 AC 002 - "Coordinate Mon or Tues Only"	FAOMH	Atkinson,Joseph
3	W0230632	PM for 86 BL 007 Need Any belt Information	FAOMP1	Atkinson,Joseph
Location : 088-0011 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				

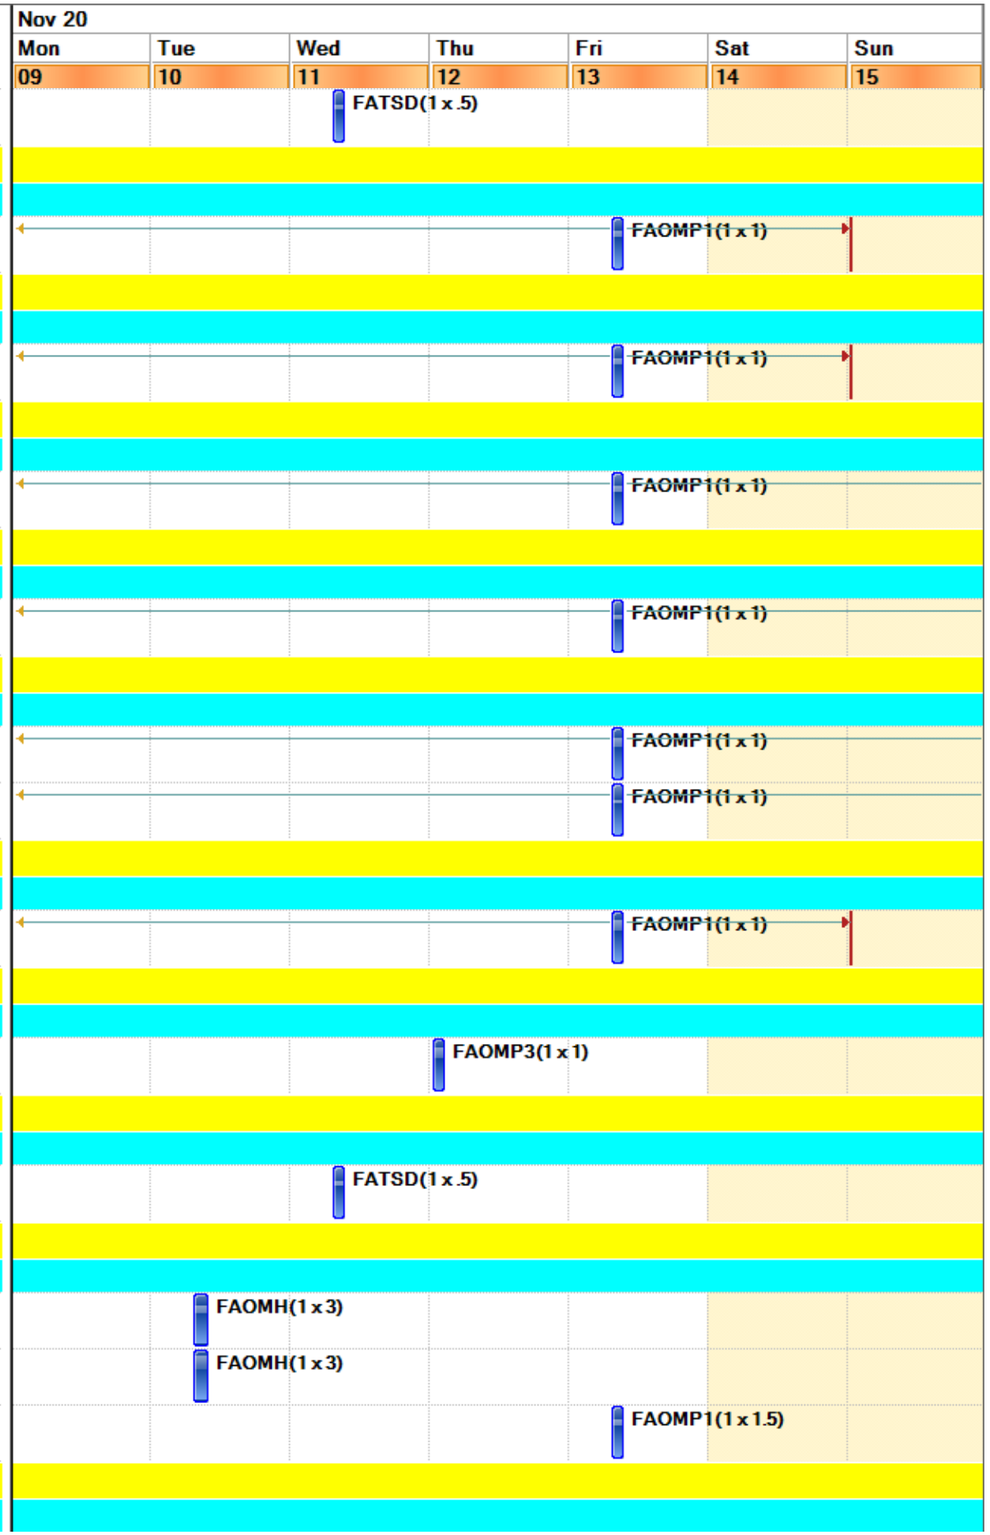

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0226862	Compile parts replacement list for leaking radiator @ B88-0011 (Asset#88 KC 008)	FAOMP1	Gutierrez,Myrna
Location : 088-0045 (1 item) (Total=3)				
Work Type Group : PMs (3 items)				
1	W0231021	PM FOR 88 DSRO 001	FAOMH	Gutierrez,Myrna
2	W0231023	PM FOR 88 DSRO 002	FAOMH	Gutierrez,Myrna
3	W0231025	PM FOR 88 DSRO 003	FAOMH	Gutierrez,Myrna
Location : 088-0100 (1 item) (Total=1)				
Work Type Group : Code Complaint PMs (1 item)				
1	W0231857	PM For Building 88 Emerg. Lights and Exit Signs	FAOML	Gutierrez,Myrna
Location : 088-0161 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0230317	Fork lift metal rad crate from B88 to B85	FATSR	Gutierrez,Myrna
Location : 088-0199 (2 items) (Total=2)				
Work Type Group : CMR, Etc (1 item)				
1	W0229684	Investigate LN2 tank over pressurizing.	FAOMP1	Gutierrez,Myrna
Work Type Group : Code Complaint PMs (1 item)				
1	W0230011	PM NFPA25 BLDG. 88/88B/88C/88D sprinkler ITM	FATSD	Gutierrez,Myrna
Location : 090-1048 (1 item) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0230101	(Parent) Mount camera between two monitors.	FATSC	Gutierrez,Myrna
2	W0231577	(Child) Raise overhead light fixture in the BASO conference room.	FAOML	Gutierrez,Myrna
Location : 090-1999 (1 item) (Total=3)				
Work Type Group : PROJECTS (3 items)				
1	W0230119	(Child) PSPS Dry Run support; walk-down affected building/equipment, and start-up B90 equipment.	FAOMP1	Gutierrez,Myrna
2	W0230135	(Child) PSPS Dry Run Support; drive fuel tanker truck	FATSR	Gutierrez,Myrna
3	W0230159	(Child)PSPS Dry Run support; Monitor building systems and provide troubleshooting support if needed.	FMCS	Gutierrez,Myrna
Location : 090-2012 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				

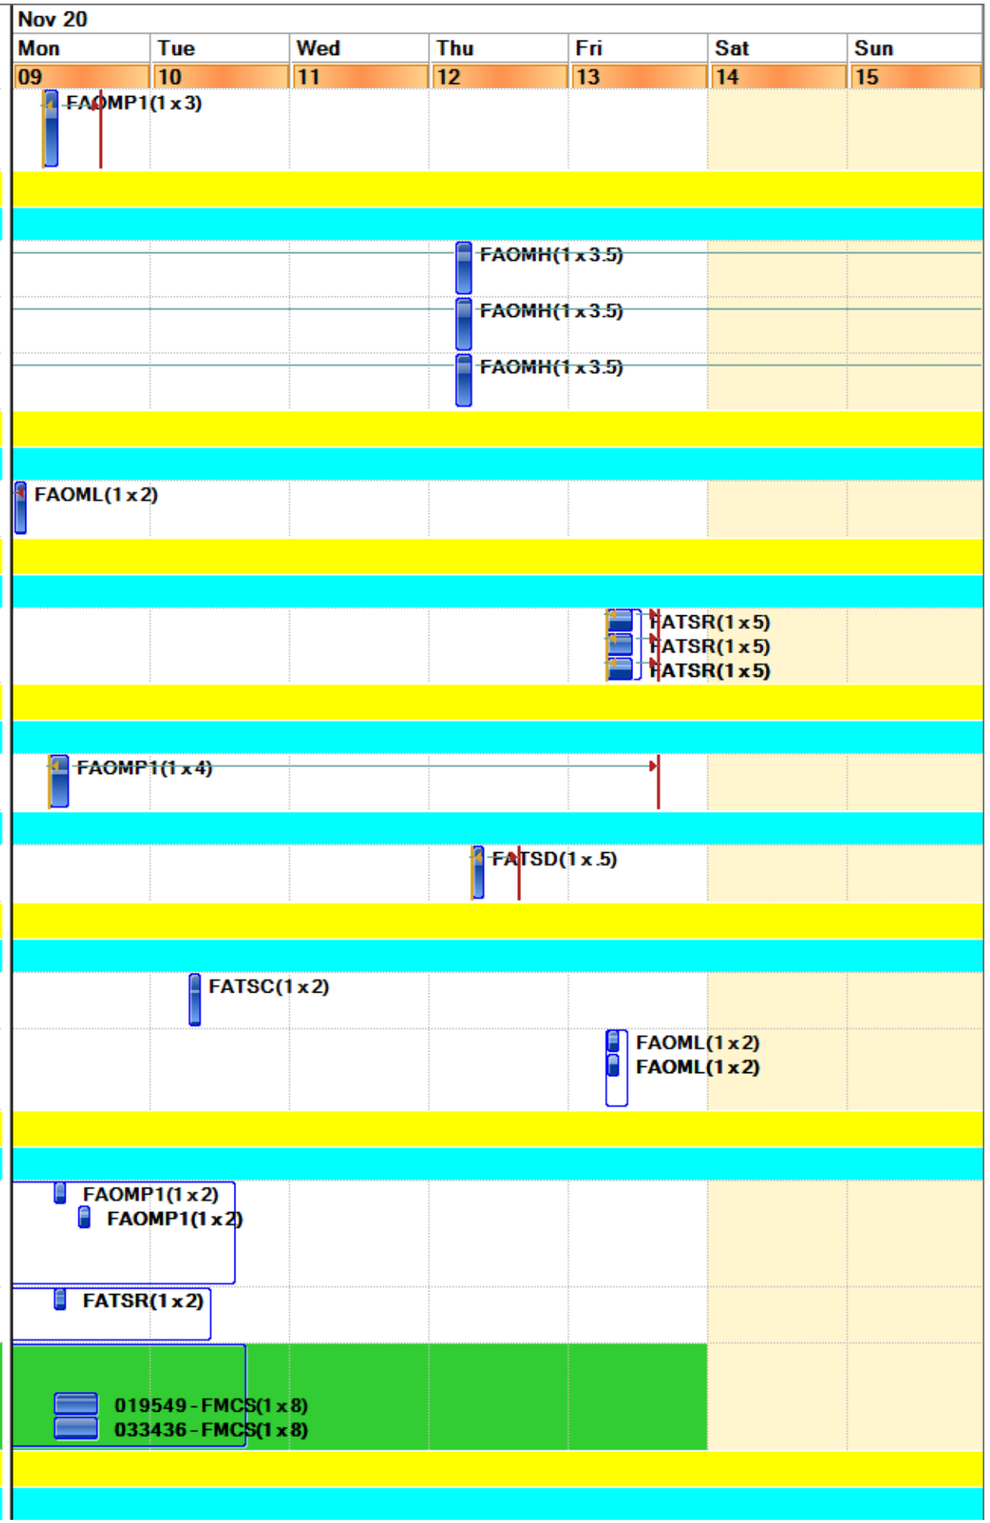

Final Schedule

	Work Order	Description	Lead Craft	FAM Name
1	W0231795	Pick Up Fans at B90-2012	FAOMP1	Gutierrez,Myrna
Location : 090-2086 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0231551	Repair office lights.	FAOML	Gutierrez,Myrna
Location : 090-2997 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0217499	Remove and replace 2nd floor north stairwell door.	FATSC	Gutierrez,Myrna
Location : 090-ROF1 (1 item) (Total=3)				
Work Type Group : PMs (3 items)				
1	W0231027	PM FOR 90 AC 043	FAOMH	Gutierrez,Myrna
2	W0231029	PM FOR 90 AC 044	FAOMH	Gutierrez,Myrna
3	W0231031	PM FOR 90 DSRO 001	FAOMH	Gutierrez,Myrna
Location : 090X-0104 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0221785	(Parent) Lay concrete blocks across test bed floor	FATSL	Gutierrez,Myrna
Location : 091-0130 (1 item) (Total=2)				
Work Type Group : CMR, Etc (2 items)				
1	W0231612	FATSF - ID areas affected by utility shutoff w/ PMTs,Bldg Manager. Meet in 091 lobby on 11/10 at 9am	FATSF	Reisinger,Richard I
2	W0231613	ID areas affected by utility shutoff w/ Plumber's, Bldg Manager @ B91-130. Meet at 091 lobby at 9am.	FAOMP1	Reisinger,Richard I
Location : 091-0161 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0229586	Add oil for Vacuum Pump in Mechanical/Plumbing Room @ B91-161	FAOMP1	Reisinger,Richard I
Location : 091-0199 (1 item) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0212070	Take pictures and verify panels in building 90	FATSE1	Reisinger,Richard I
Location : 091U-0101 (2 items) (Total=1)				
Work Type Group : CMR, Etc (1 item)				
1	W0213917	(Parent) Remove and clean strainer	FAOMP1	Reisinger,Richard I
Location : CRP-304 (1 item) (Total=1)				

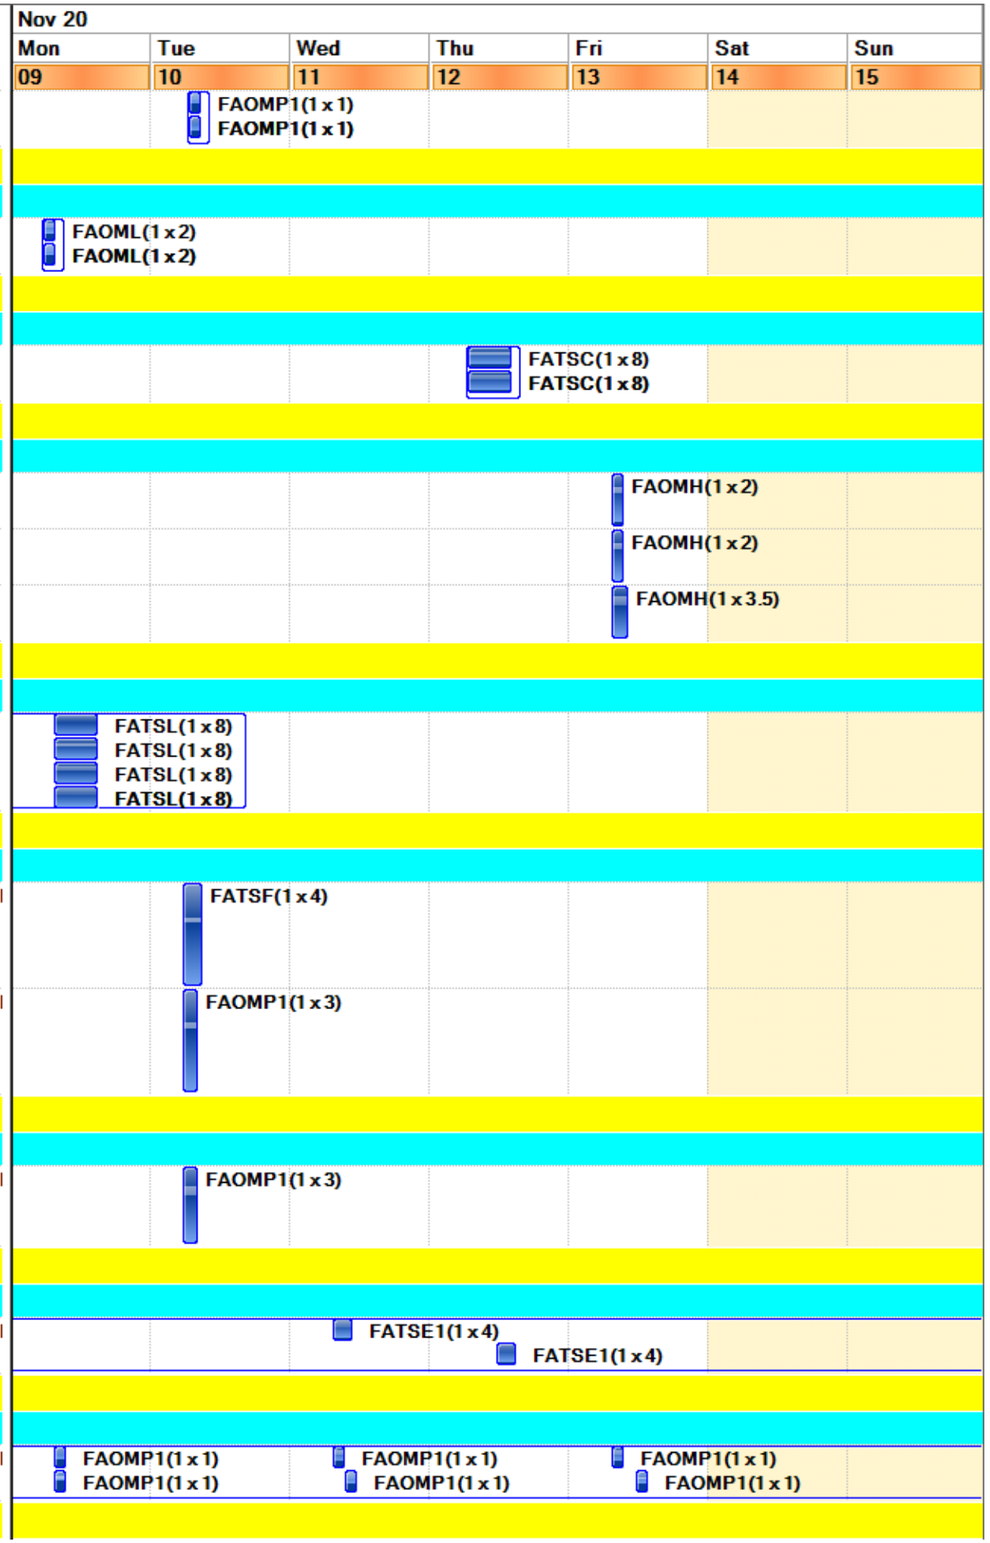

Final Schedule
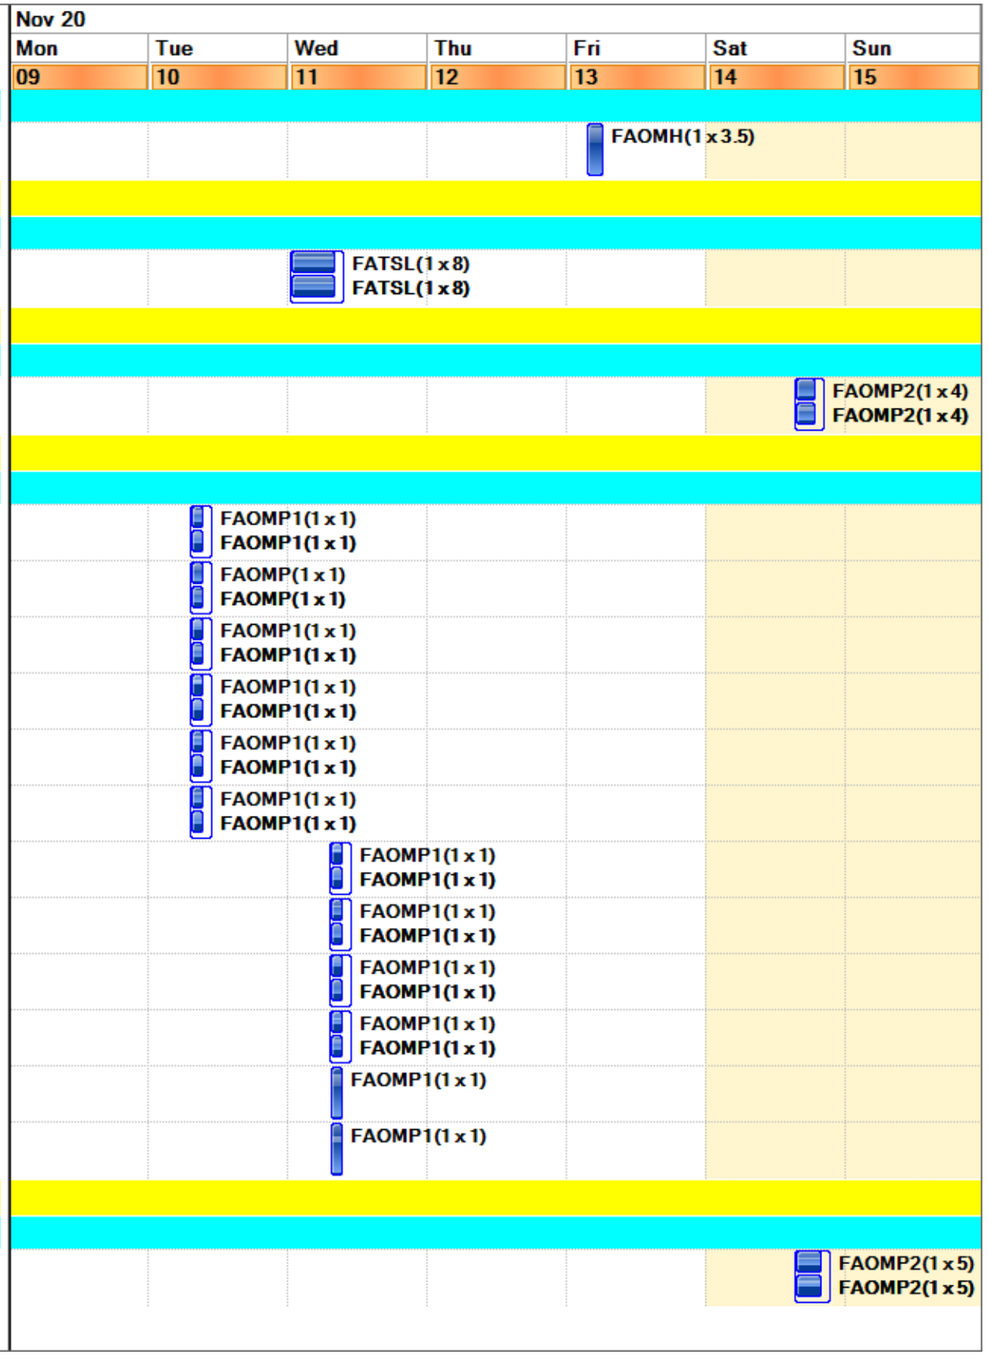
	Work Order	Description	Lead Craft	FAM Name
Work Type Group : PMs (1 item)				
1	W0230954	PM FOR 50E DSRO 001	FAOMH	Gutierrez,Myrna
Location : HSITE2010 (2 items) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231413	Roadway/Sidewalk/Shelter Inspection Zone 2	FATSL	Gutierrez,Myrna
Location : HSITE30 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231419	Monthly Gas/Water mtr readings - NOV 17th	FAOMP2	Tafoya,Eric
Location : HSITE3010 (2 items) (Total=12)				
Work Type Group : PMs (12 items)				
1	W0231225	PM FOR 00 HY 001 (GP1)	FAOMP1	Gutierrez,Myrna
2	W0231227	PM FOR 00 HY 002 (GP1)	FAOMP1	Gutierrez,Myrna
3	W0231229	PM FOR 00 HY 003 (GP1)	FAOMP1	Gutierrez,Myrna
4	W0231231	PM FOR 00 HY 004 (GP1)	FAOMP1	Gutierrez,Myrna
5	W0231233	PM FOR 00 HY 006 (GP1)	FAOMP1	Gutierrez,Myrna
6	W0231235	PM FOR 00 HY 008 (GP1)	FAOMP1	Gutierrez,Myrna
7	W0231237	PM FOR 00 HY 010 (GP1)	FAOMP1	Gutierrez,Myrna
8	W0231239	PM FOR 00 HY 011 (GP1)	FAOMP1	Gutierrez,Myrna
9	W0231241	PM FOR 00 HY 012 (GP1)	FAOMP1	Gutierrez,Myrna
10	W0231243	PM FOR 00 HY 013 (GP1)	FAOMP1	Gutierrez,Myrna
11	W0231245	PM FOR 00 HY 014 (GP1)	FAOMP1	Gutierrez,Myrna
12	W0231247	PM FOR 00 HY 016 (GP1)	FAOMP1	Gutierrez,Myrna
Location : HSITE40 (1 item) (Total=1)				
Work Type Group : PMs (1 item)				
1	W0231416	Monthly Electrical mtr readings NOV 17th	FAOMP2	Tafoya,Eric