Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro	Jun 20 Mon 22	Tue 23	Wed 24	Thu 25	Fri 26	Sat 27	Sun 28
Location : 001-0401 (0 item) (Total=1)											
FAM Name : Bradford,Adam B (0 item)											
1	W0220682	PM NFPA72 BLDG. 01 fire alarm system ITM(Donner Weekly)	FATSD	Code Complaint PMs					FATSD(1 x 1)		
Location : 002-0129A (0 item) (Total=1)											
FAM Name : Reisinger,Richard D. (0 item)											
1	W0217180	PM FOR 02 TK 009	FAOMP3	Code Complaint PMs		FAOMP3(1 x 1)					
Location : 002-0129E (0 item) (Total=2)											
FAM Name : Reisinger,Richard D. (0 item)											
1	W0217178	Monthly PM: 02 EG 068: READ LONG DESCRIPTION!	FAOMP3	Code Complaint PMs		FAOMP3(1 x 1.5)					
2	W0214827	PM FOR 02 EX 001	FAOMP1	PMs							FAOMP1(1 x
Location : 002-0130 (0 item) (Total=4)											
FAM Name : Reisinger,Richard D. (0 item)											
1	W0215692	LOTO, remove and replace motor for GP-011	FATSE2	CMR, Etc	FATSE2(1 x 5) FATSE2(1 x 5)						
2	W0217415	PMT to replace pump/motor. FATSE to assist. MATERIAL UNDER W0215692	FAOMP1	CMR, Etc	FAOMP1(1 x 5) FAOMP1(1 x 5)						
3	W0218804	Replace pressure control switch @B02-0130	FAOMH	CMR, Etc		FAOMH(1 x 8) FAOMH(1 x 8)					
4	W0219809	Replace Amplifier for 02 TK 006 @ B002-0130.	FAOMP2	CMR, Etc		FAOMP2(1 x 4)					
Location : 002A-ROF1 (0 item) (Total=1)											
FAM Name : Reisinger,Richard D. (0 item)											
1	W0214422	PM FOR 02ABL 001	FAOMP2	PMs							FAOMP2(1 x
Location : 002-ROF1 (1 item) (Total=1)											
FAM Name : Reisinger,Richard D. (1 item)											
1	W0218812	Bldg. 02 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs		056508 - FAOMP1(1 x 1)					
Location : 006-1000 (0 item) (Total=3)											
FAM Name : Reisinger,Richard D. (0 item)											
1	W0220272	QEW2 escort and contractor support for ALS electrical tunnel work activities	FATSE2	PROJECTS	FATSE2(1 x 4) FATSE2(1 x 4)						

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
2	W0220898	Install gutters and unistrut supports for radiation safety shutters (RSS)	FATSE1	CMR, Etc
3	W0220891	LOTO, remove and replace transformer Bank 317.	FATSE1	CMR, Etc
Location : 006-1095 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216425	PM FOR 06 BFP002 CITY WATER ; JANITOR'S ROOM	FAOMP1	Code Complaint PMs
Location : 006-1999 (1 item) (Total=2)				
FAM Name : Reisinger,Richard D. (1 item)				
1	W0218814	Bldg. 06 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
2	W0216843	PM NFPA25 BLDG. 6 sprinkler ITM	FATSD	Code Complaint PMs
Location : 006-2144 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0208228	FATSD FSD NOT WORKING	FATSD	CMR, Etc
Location : 006-2145A (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216429	PM FOR 06 BFP006 hot & industrial; Machine Rm.	FAOMP1	Code Complaint PMs
Location : 006-2221 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216479	PM FOR 06 EX 002	FAOMP1	PMs
Location : 006-2263 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0208239	FATSD FSD NOT WORKING	FATSD	CMR, Etc
Location : 007-0100 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220107	Replace 5 sprinkler gauges	FATSF	CMR, Etc
Location : 015-0100 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0215934	Survey all HVAC equipment on roof @ B15 (2 Tech's: 1 for 8 hours, 1 for 3 hours in 1 day)	FAOMH	PROJECTS

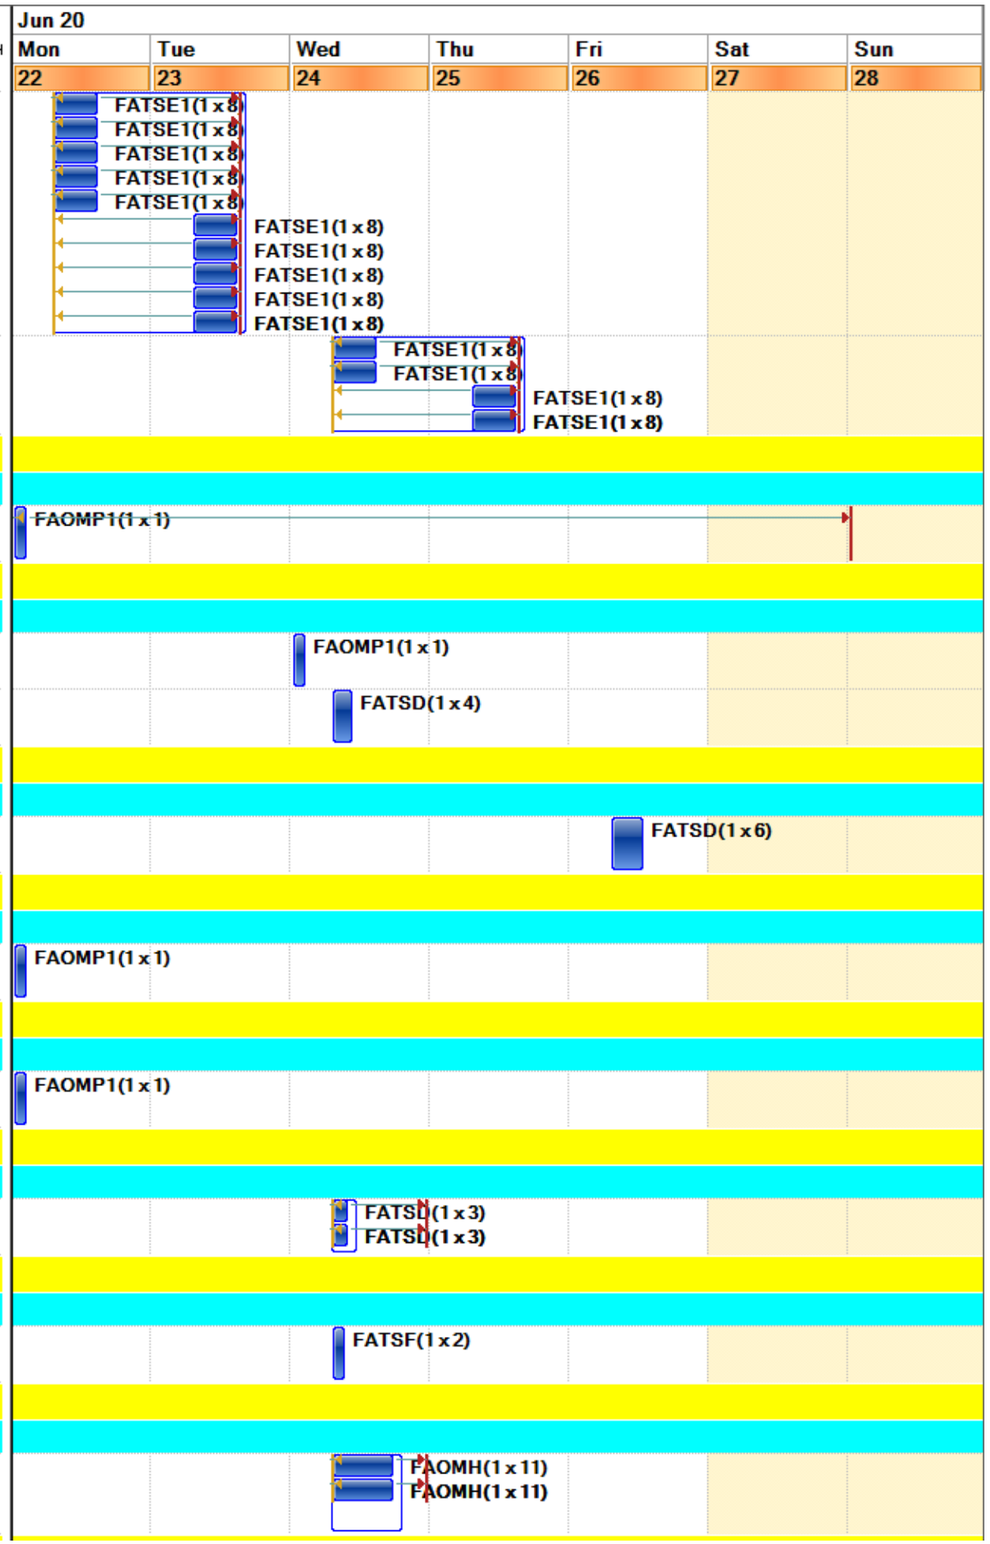

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
Location : 015-0162 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216849	PM NFPA25 BLDG. 15 preaction ITM	FATSD	Code Complaint PMs
Location : 015-0198 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0217024	PM NFPA25 BLDG. 15 sprinkler ITM	FATSD	Code Complaint PMs
Location : 015-ROF2 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0214788	PM for 015 BL 004	FAOMP2	PMs
Location : 017-0101 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220102	REPLACE 4 GAUGES	FATSF	CMR, Etc
Location : 026-0011 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0214831	PM FOR 26 EX 001	FAOMP1	PMs
Location : 027-0101 (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220103	REPLACE Sprinkler 5 GAUGES	FATSF	CMR, Etc
Location : 030-0142 (0 item) (Total=4)				
FAM Name : Bradford,Adam B (0 item)				
1	W0216509	PM for 30 FL 006	FAOMP3	PMs
2	W0192664	(Parent) Replace oil level sensor on 30 MP 002 @ B30-0142	FAOMP1	CMR, Etc
3	W0215928	Implement LOTO permit and activities to lock out and restart pump safely	FATSE2	CMR, Etc
4	W0216511	PM for 30 FL 007	FAOMP3	PMs
Location : 030-0307 (0 item) (Total=1)				
FAM Name : Bradford,Adam B (0 item)				
1	W0204991	Carpenters to install seismic anchors for 2 cabinets. (see attachments)	FATSC	CMR, Etc
Location : 030-0400 (0 item) (Total=5)				
FAM Name : Bradford,Adam B (0 item)				
1	W0216521	PM for 30 FL 005	FAOMP3	PMs
2	W0216513	PM for 30 FL 001	FAOMP2	PMs

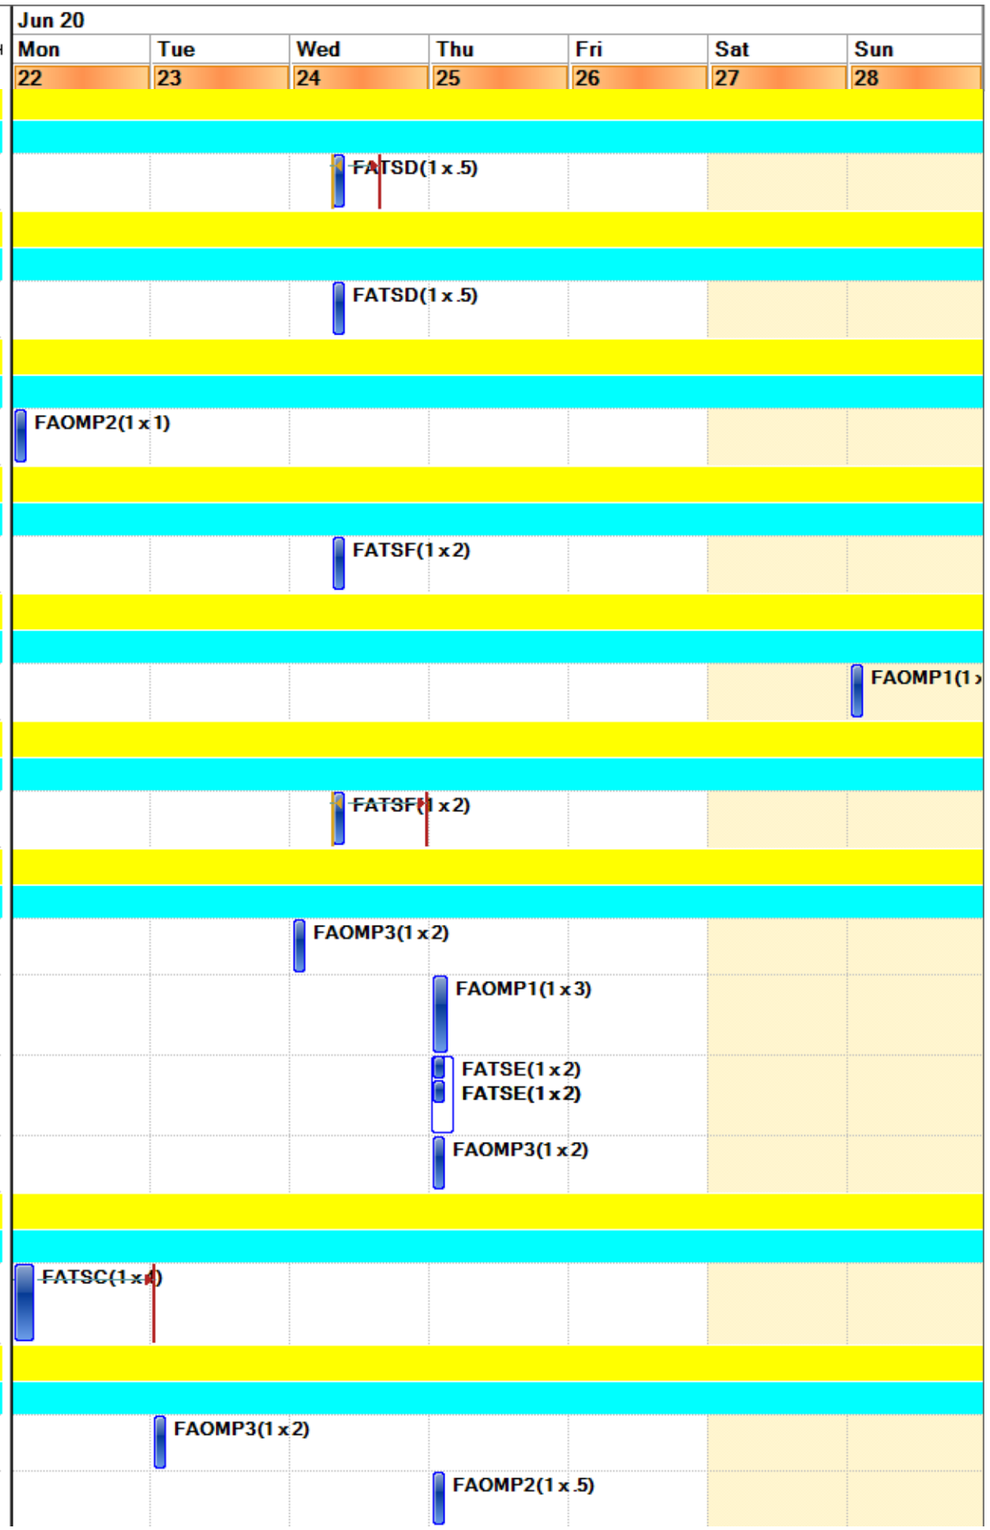

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro	Jun 20 Mon 22	Tue 23	Wed 24	Thu 25	Fri 26	Sat 27	Sun 28
3	W0216515	PM for 30 FL 002	FAOMP2	PMs				FAOMP2(1 x .5)			
4	W0216517	PM for 30 FL 003	FAOMP2	PMs				FAOMP2(1 x .5)			
5	W0216519	PM for 30 FL 004	FAOMP2	PMs				FAOMP2(1 x .5)			
Location : 030A-0199 (1 item) (Total=1)											
FAM Name : Bradford,Adam B (1 item)											
1	W0218808	Bldg. 30 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs			FAOMP1(1 x 1)				
Location : 031-0102 (0 item) (Total=1)											
FAM Name : Escobedo,Carlos (0 item)											
1	W0214426	PM FOR 31 BL 001	FAOMP2	PMs							FAOMP2(1 x
Location : 031-0199 (0 item) (Total=2)											
FAM Name : Escobedo,Carlos (0 item)											
1	W0216858	PM NFPA25 BLDG. 31/31A sprinkler ITM	FATSD	Code Complaint PMs	FATSD(1 x .5)						
2	W0214428	PM FOR 31 BL 002	FAOMP2	PMs							FAOMP2(1 x
Location : 033-R403 (0 item) (Total=4)											
FAM Name : Bradford,Adam B (0 item)											
1	W0215038	PM for 33 BR 001 MATL at Stores	FAOMP3	PMs		FAOMP3(1 x 8)					
2	W0216588	PM for 33 GP 001	FAOMP2	PMs		FAOMP2(1 x 2)					
3	W0216592	PM for 33 GP 002	FAOMP2	PMs		FAOMP(1 x 2)					
4	W0215040	PM for 33 BR 002 MATL at Stores	FAOMP3	PMs			FAOMP3(1 x 8)				
Location : 033-R499 (0 item) (Total=1)											
FAM Name : Bradford,Adam B (0 item)											
1	W0220730	OCx - B33 Roof AHU-1 & 2 Modify 33-AHU-MGR Logic to add variable ignores to T&R block	FMCS	CMR, Etc		FMCS(1 x 3) FMCS(1 x 3)					
Location : 033U-0101 (0 item) (Total=10)											
FAM Name : Bradford,Adam B (0 item)											
1	W0216594	PM for 33UGP 001	FAOMP2	PMs		FAOMP2(1 x 2)					
2	W0216596	PM for 33UGP 002	FAOMP2	PMs		FAOMP2(1 x 2)					
3	W0216598	PM for 33UGP 003	FAOMP2	PMs		FAOMP2(1 x 2)					
4	W0216600	PM for 33UGP 004	FAOMP2	PMs		FAOMP2(1 x 2)					
5	W0216602	PM for 33UGP 005	FAOMP2	PMs			FAOMP2(1 x 2)				

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
6	W0216604	PM for 33UGP 006	FAOMP2	PMs
7	W0216606	PM for 33UGP 007	FAOMP2	PMs
8	W0216608	PM for 33UGP 008	FAOMP2	PMs
9	W0216610	PM for 33UGP 009	FAOMP2	PMs
10	W0216612	PM for 33UGP 010	FAOMP2	PMs
Location : 033U-0198X (0 item) (Total=1)				
FAM Name : Bradford,Adam B (0 item)				
1	W0216614	PM for 33UGP 011	FAOMP2	PMs
Location : 034-0100 (0 item) (Total=2)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220648	Calibrate belly heaters on 34 ARU003	FAOMH	CMR, Etc
2	W0220649	Calibrate belly heaters on 34 ARU004	FAOMH	CMR, Etc
Location : 034-0100B (0 item) (Total=1)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220138	Troubleshoot ARU 002 in alarm for low oil pressure	FAOMH	CMR, Etc
Location : 034PIT001 (1 item) (Total=1)				
FAM Name : Reisinger,Richard D. (1 item)				
1	W0218816	Bldg. 34 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 034-ROF1 (0 item) (Total=2)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216457	PM FOR 34 CT 001	FAOMP1	PMs
2	W0216459	PM FOR 34 CT 002	FAOMP1	PMs
Location : 036-0101 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0218074	Inspection of SW-A1&A2 Bldg. 36	FATSE2	PMs
Location : 036A-0101 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0217967	Inspection of Grizzly Peak Substation	FATSE2	PMs
Location : 037-0199 (0 item) (Total=2)				
FAM Name : Reisinger,Richard D. (0 item)				

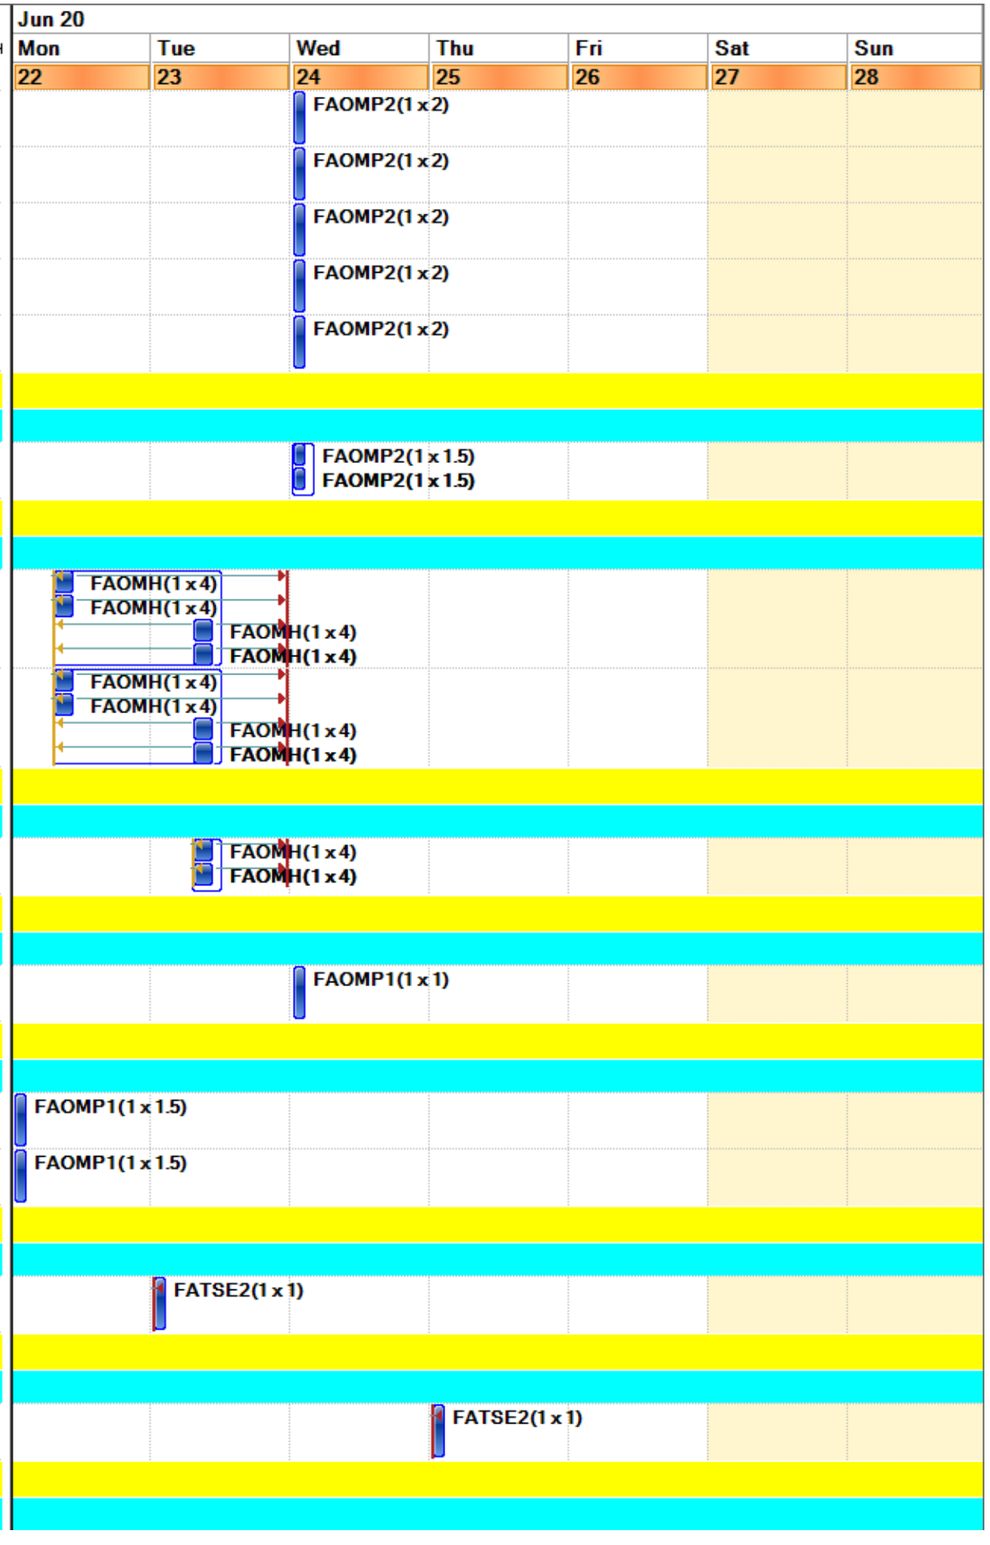

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0216861	PM NFPA25 BLDG. 37/34 sprinkler ITM	FATSD	Code Complaint PMs
2	W0217018	PM NFPA25 BLDG. 37 deluge ITM	FATSD	Code Complaint PMs
Location : 037TK101 (1 item) (Total=1)				
FAM Name : Reisinger,Richard D. (1 item)				
1	W0218818	Bldg. 37 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 043-0101 (0 item) (Total=4)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0216485	PM FOR 43 FL 001	FAOMP3	PMs
2	W0216487	PM FOR 43 FL 002	FAOMP3	PMs
3	W0216489	PM FOR 43 FL 003	FAOMP3	PMs
4	W0216491	PM FOR 43 FL 004	FAOMP3	PMs
Location : 046-0101 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0220106	Replace 19 Sprinkler Gauges	FATSF	CMR, Etc
Location : 046-ROF1 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0199509	Replace the reversing valve on AC 041 B46	FAOMH	CMR, Etc
Location : 047-0112A (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0220854	Remedy slow draining sink and non-functional disposal @ B47-0112A	FATSF	CMR, Etc
Location : 050A-ROF1 (1 item) (Total=1)				
FAM Name : Escobedo,Carlos (1 item)				
1	W0218820	Bldg. 50A PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 050B-0198X (0 item) (Total=2)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0220790	Onicron flowmeter recalibration under no flow conditions; turn off pump and shut off valves	FAOMP1	PROJECTS
2	W0218517	Remove control wires from FPU units and starters for GP23, GP24, GP25, GP26	FATSE2	PROJECTS
Location : 050B-0299 (1 item) (Total=3)				
FAM Name : Escobedo,Carlos (2 items)				

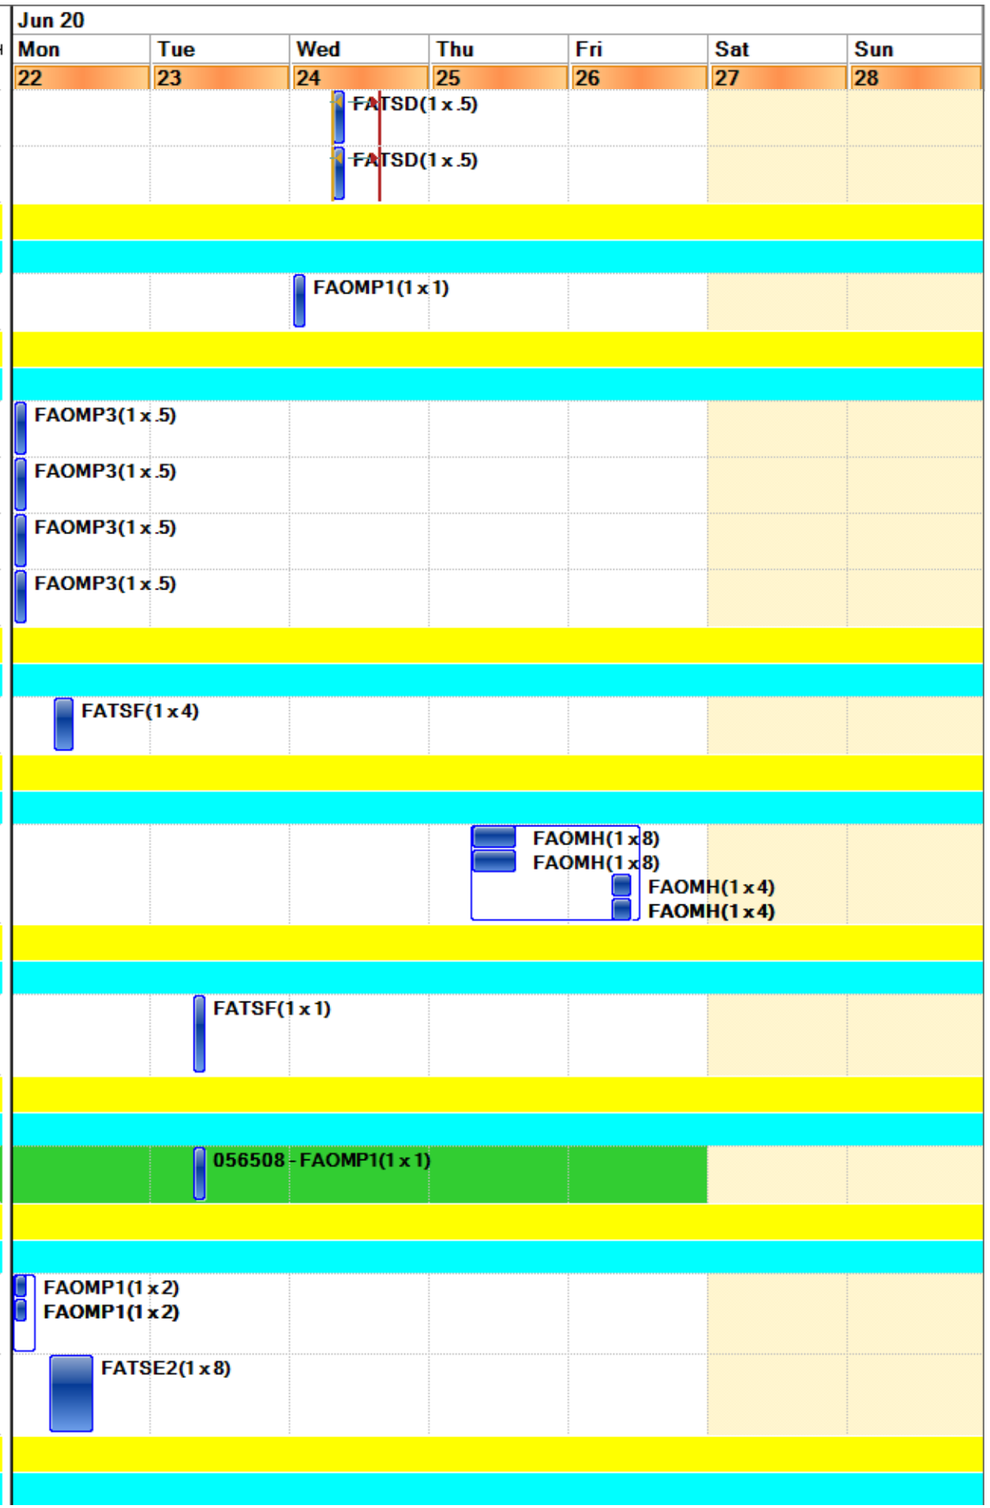

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0213282	LOTO Support: Bypass blowers and GPs	FAOMP1	PROJECTS
2	W0218822	Bldg. 50B PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
3	W0212227	LOTO Support for contractor work	FATSE2	PROJECTS
Location : 050B-1245 (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0220801	LOTO & remove receptacles from IT racks. LOTO & remove e -receptacle to above grid location.	FATSE1	CMR, Etc
Location : 050B-1275 (1 item) (Total=2)				
FAM Name : Escobedo,Carlos (1 item)				
1	W0211689	Troubleshoot/investigate to determine scope of work to remove EPO system line 1 & 3 from RM1275	FATSE2	CMR, Etc
2	W0220806	Check in with Michael Magstadt, open ceiling tiles and layout for scanning	FATSE1	CMR, Etc
Location : 050B-2239A (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0216331	PM FOR 50BAHU033	FAOMP1	PMs
Location : 050B-2239B (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0216333	PM FOR 50BAHU034	FAOMP1	PMs
Location : 050B-2245 (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0216335	PM FOR 50BAHU035	FAOMP1	PMs
Location : 050-OPEN (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0220868	Walk building common and non-lab areas and remove and replace burnt out lamps as necessary.	FAOML	CMR, Etc
Location : 053-0101 (0 item) (Total=2)				
FAM Name : Reisinger,Richard D. (0 item)				
1	W0220871	Cut a hole under window sill as shown on picture attached. Since no reference dwg or information fou	FATSC	PROJECTS
2	W0220105	Replace 5 Sprinkler gauges	FATSF	CMR, Etc
Location : 054-0111 (0 item) (Total=1)				

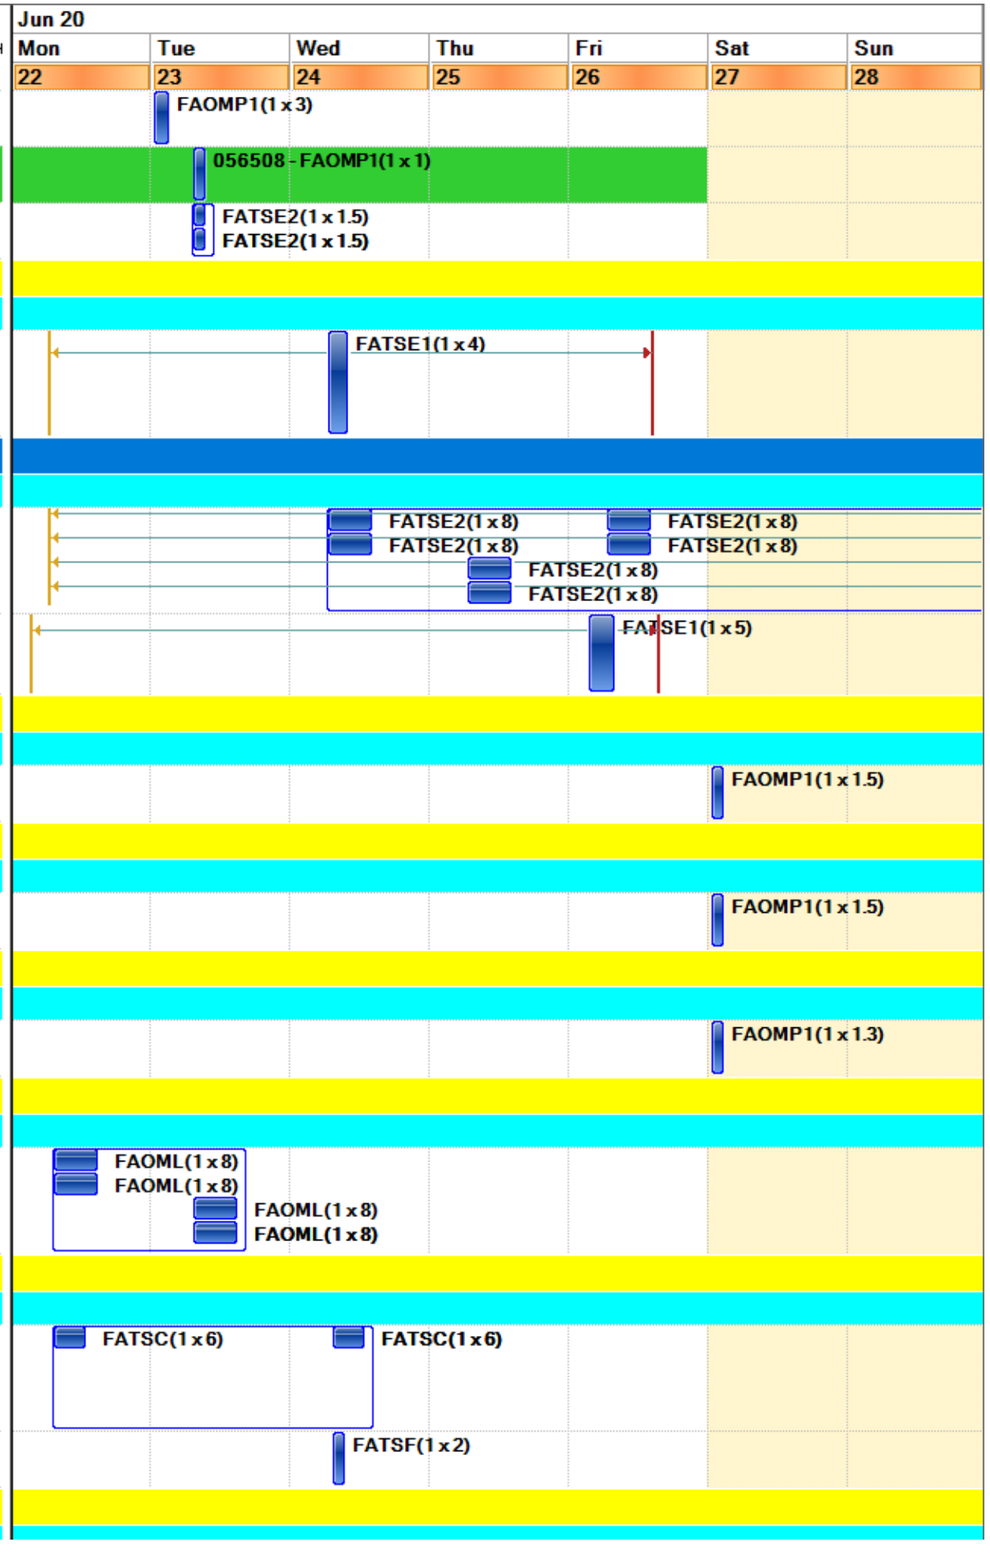

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0220878	Mitigate floor drain(s) that is clogged in the main kitchen area of cafeteria.	FATSF	CMR, Etc
Location : 055-0100 (0 item) (Total=2)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220115	Replace 5 Sprinkler Gauges	FATSF	CMR, Etc
2	W0210190	Create labels for Fire Alarm Devices that match the drawings	FATSD	CMR, Etc
Location : 055A-0101 (0 item) (Total=1)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220066	LOTO and electrical support for MRI unit	FATSE2	CMR, Etc
Location : 055A-ROF1 (0 item) (Total=1)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220776	Troubleshoot AC 001; ice on evaporator and blower was not running.	FAOMH	CMR, Etc
Location : 058-0101 (0 item) (Total=1)				
	FAM Name : Atkinson,Joseph (0 item)			
1	W0216766	PM NFPA72 BLDG. 58 fire alarm Audible & Function Testing	FATSD	Code Complaint PMs
Location : 058-0199 (0 item) (Total=2)				
	FAM Name : Atkinson,Joseph (0 item)			
1	W0216493	PM FOR 58 FL 002	FAOMP1	PMs
2	W0216495	PM FOR 58 FL 003	FAOMP1	PMs
Location : 059-0199X (1 item) (Total=1)				
	FAM Name : Schroeter,Peter James (1 item)			
1	W0207061	PM for 59 FL 001	FAOMP1	PMs
Location : 059-1001 (0 item) (Total=1)				
	FAM Name : Schroeter,Peter James (0 item)			
1	W0217162	Replace addressable module (HTRI-D)	FATSD	CMR, Etc
Location : 059-1002 (0 item) (Total=1)				
	FAM Name : Schroeter,Peter James (0 item)			
1	W0197213	PM for 59 BL 014 Needs a Lift/Use Lift There, See Jeff Grounds/Ernest Jew	FAOMP1	PMs
Location : 059-1003 (1 item) (Total=2)				
	FAM Name : Schroeter,Peter James (1 item)			

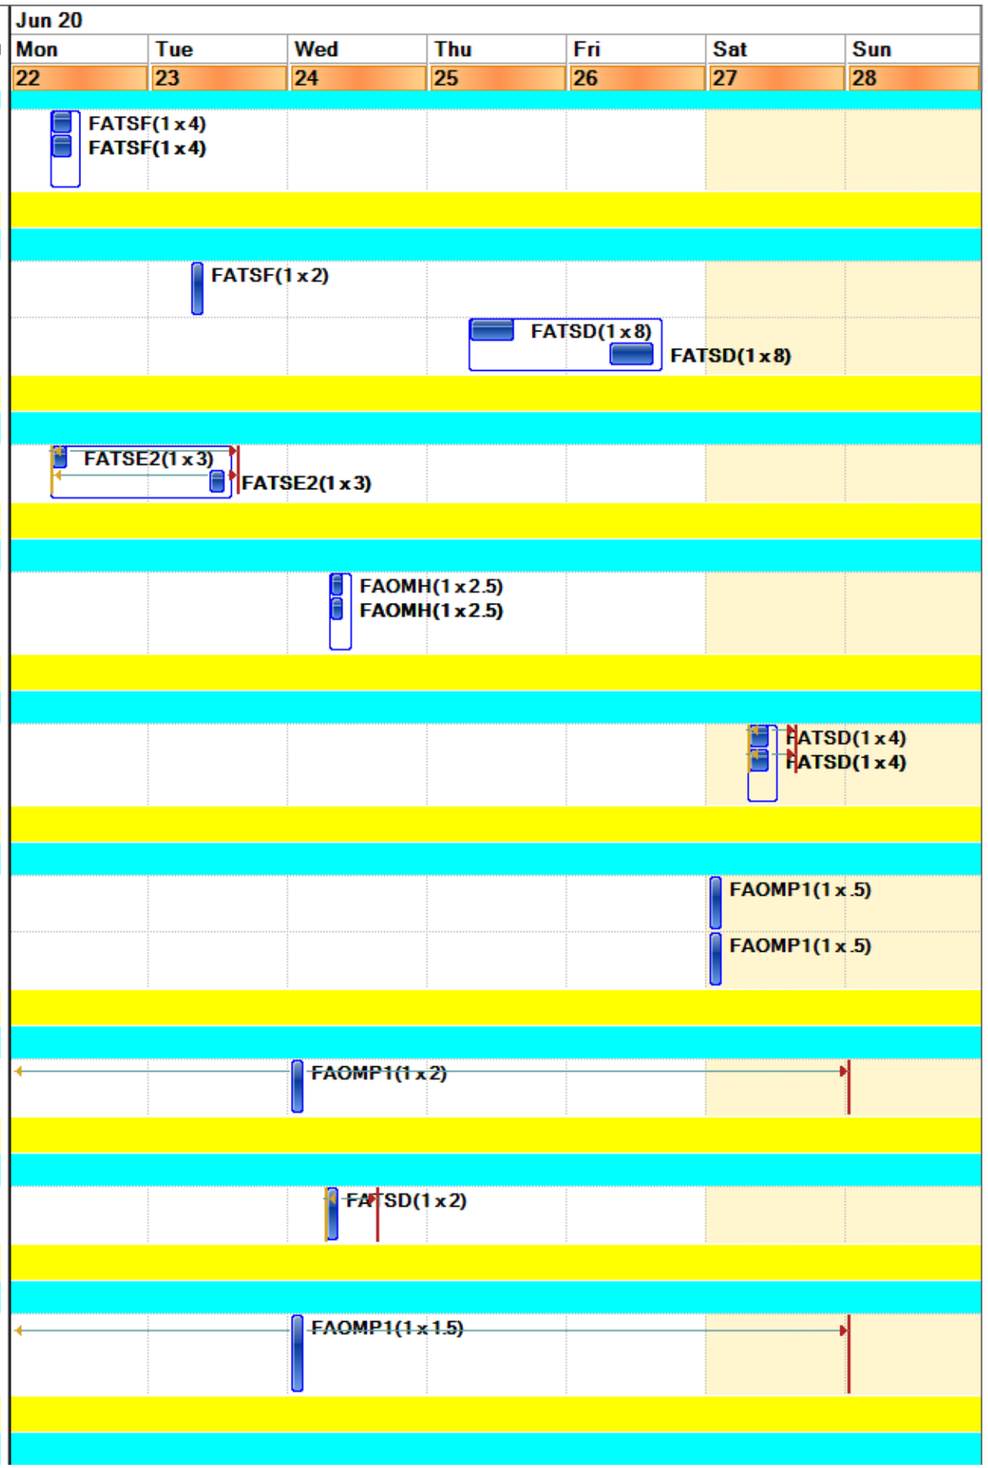

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0217428	Disarm fire alarm points and functions as per construction manager instructions. (On going until Nov	FATSD	PROJECTS
2	W0218810	Bldg. 59 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 059-1201 (0 item) (Total=1)				
FAM Name : Schroeter,Peter James (0 item)				
1	W0209374	PM FOR 59 PV 001	FAOMP1	Code Complaint PMs
Location : 060-0101 (0 item) (Total=1)				
FAM Name : Gutierrez,Myrna (0 item)				
1	W0220116	Replace 7 Sprinkler gauges	FATSF	CMR, Etc
Location : 060-0199X (0 item) (Total=1)				
FAM Name : Gutierrez,Myrna (0 item)				
1	W0216274	PM All building Eye Washes and Showers	FAOMP2	CMR, Etc
Location : 062-0033 (1 item) (Total=1)				
FAM Name : Rini,Christopher G (1 item)				
1	W0218824	Bldg. 62/62F PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 062-0199 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0216898	PM NFPA25 BLDG. 62/62A/62F sprinkler ITM	FATSD	Code Complaint PMs
Location : 062-0361 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0219032	Troubleshoot whistling noise coming from thermostat in 62-0361	FAOMH	CMR, Etc
Location : 062B-0100 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0216778	PM NFPA72 BLDG. 62B fire alarm system ITM	FATSD	Code Complaint PMs
Location : 062B-0199 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0216901	PM NFPA25 BLDG. 62B preaction ITM	FATSD	Code Complaint PMs
Location : 064-0101 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0220114	Replace 6 Sprinkler Gauges	FATSF	CMR, Etc
Location : 064-0195 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				

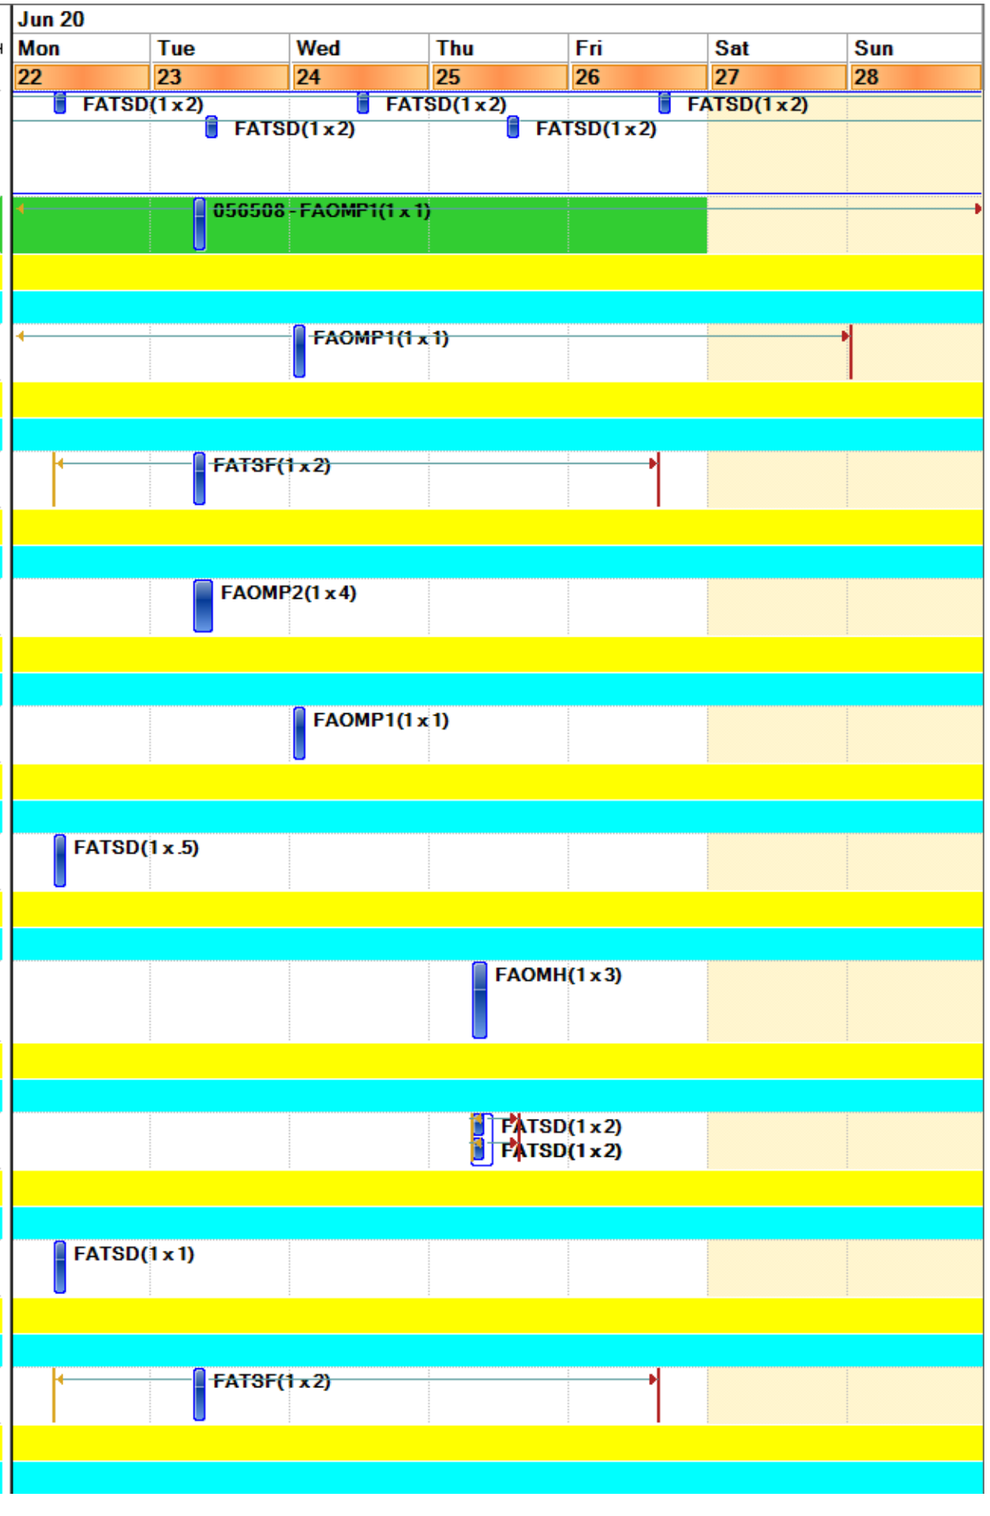

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0216769	PM NFPA72 BLDG. 64/56 fire alarm Audible & Function Testing	FATSD	Code Complaint PMs
Location : 065-0102 (1 item) (Total=3)				
FAM Name : Schroeter,Peter James (2 items)				
1	W0215238	(Child) FATSC remove/re-install cabinets for FATSF to replace deficient sprinkler heads	FATSC	CMR, Etc
2	W0184838	(Parent) replace deficient sprinkler heads	FATSF	CMR, Etc
3	W0215761	Fire Alarm to drain sprinkler system to allow Plumbers to do repair.	FATSD	CMR, Etc
Location : 066-0111 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0214835	PM FOR 66 EX 001	FAOMP1	PMs
Location : 066-0199 (0 item) (Total=2)				
FAM Name : Rini,Christopher G (0 item)				
1	W0216912	PM NFPA25 BLDG. 66 sprinkler ITM	FATSD	Code Complaint PMs
2	W0215243	Install conduit and enclosures for wireless access points on B66 Roof and SW-A5 Wall.	FATSE1	CMR, Etc
Location : 066-0381 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0213680	Replace (10) old Smoke Detectors that have trouble resetting after activation	FATSD	CMR, Etc
Location : 066A-0100 (0 item) (Total=1)				
FAM Name : Rini,Christopher G (0 item)				
1	W0213682	Replace (2) old Smoke Detectors that have trouble resetting after activation	FATSD	CMR, Etc
Location : 067-1999 (0 item) (Total=3)				
FAM Name : (0 item)				
1	W0220677	OCx - B67 CHW Plant Investigate FPU panels: power, comm, i/o	FMCS	CMR, Etc
FAM Name : Tafoya,Eric (0 item)				
1	W0216915	PM NFPA25 BLDG. 67/67A/67L sprinkler ITM	FATSD	Code Complaint PMs
2	W0219365	Identify wiring from B67 TGMS system to the Text notification system.	FMCS	CMR, Etc
Location : 067-5208 (1 item) (Total=1)				
FAM Name : Tafoya,Eric (1 item)				

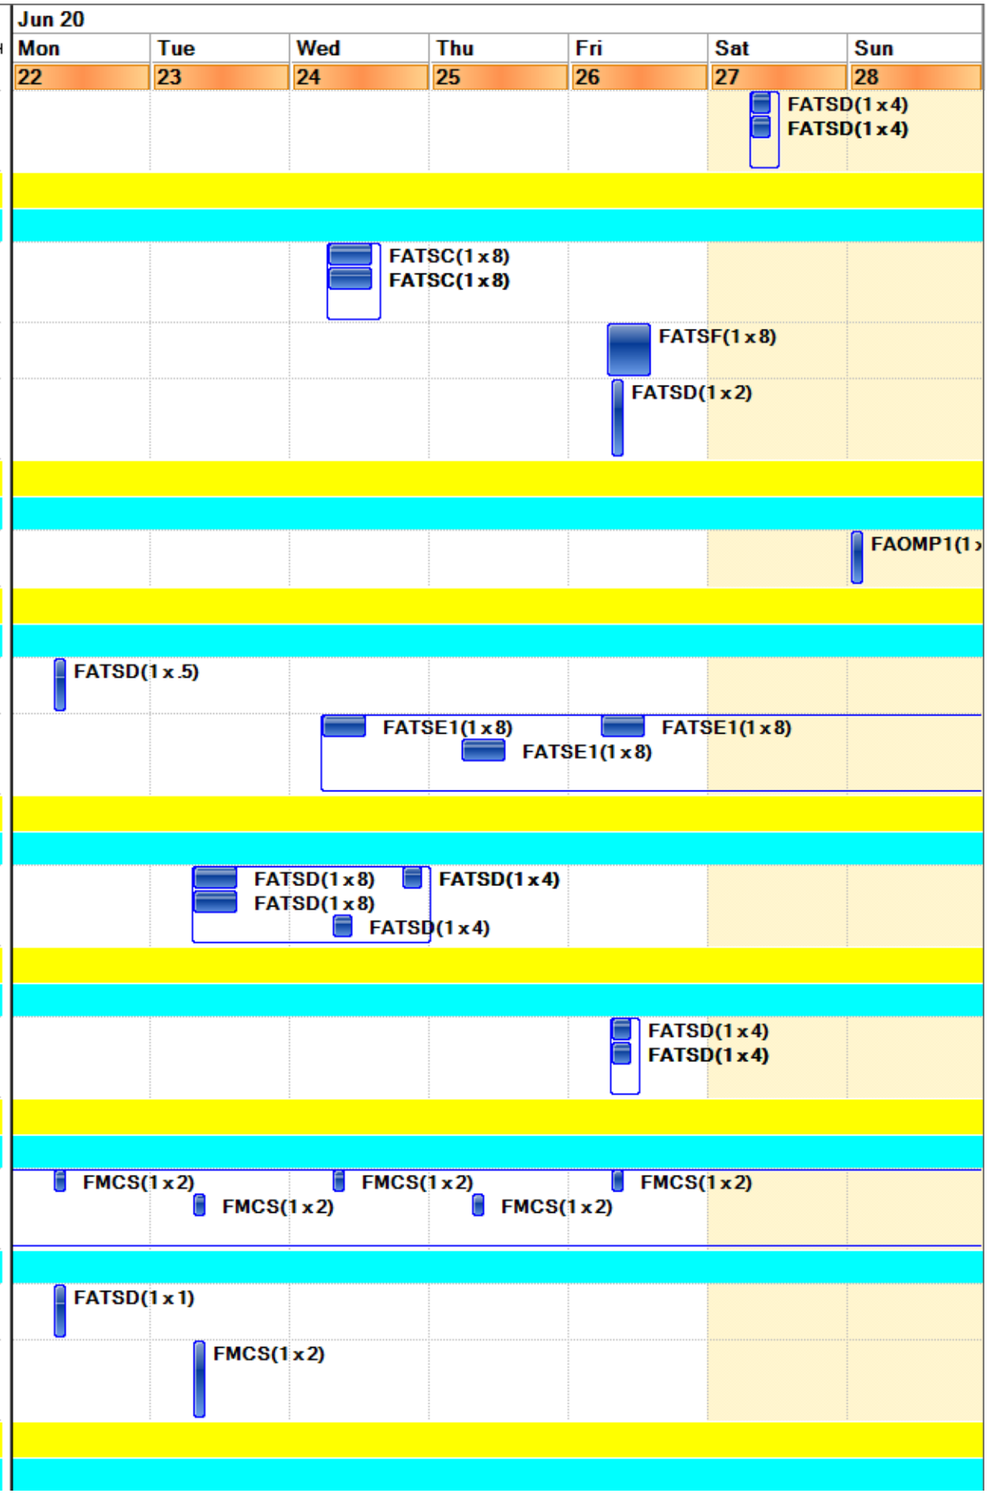

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0201244	Seismically secure optical table per engineering specifications and penetration permit.	FATSC	CMR, Etc
Location : 067A-0101 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216477	PM 67AEX001 June	FAOMP1	PMs
Location : 067A-0102 (1 item) (Total=3)				
FAM Name : Tafoya,Eric (1 item)				
1	W0219367	(Parent)Maintain building temperature set point and secure chiller daily at 5:30pm	FAOMH	CMR, Etc
2	W0219368	(Child) Start Chiller and monitor equipment until secured daily.	FMCS	CMR, Etc
3	W0218828	Bldg. 67A PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 067A-0199 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216455	PM FOR 67A BGM001	FAOMP1	PMs
Location : 067A-0201 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216670	PM for 67AKC001	FAOMP1	PMs
Location : 067-ROF1 (1 item) (Total=1)				
FAM Name : Tafoya,Eric (1 item)				
1	W0218826	Bldg. 67 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 068-0101 (1 item) (Total=1)				
FAM Name : Rini,Christopher G (2 items)				
1	W0217067	PM NFPA25 BLDG. 68 grid booster pump ITM (weekly)	FATSD	Code Complaint PMs
Location : 070-0129A (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0213320	Patch and paint walls after shelf removal.	FATSP	CMR, Etc
Location : 070-0130 (1 item) (Total=1)				
FAM Name : Escobedo,Carlos (2 items)				
1	W0182733	(Parent) Replace fire sprinkler heads as per fire sprinkler ITM findings.	FATSF	CMR, Etc
Location : 070-0199 (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0220723	Replace 7 Sprinkler Gauges	FATSF	CMR, Etc
Location : 070-0199X (0 item) (Total=1)				

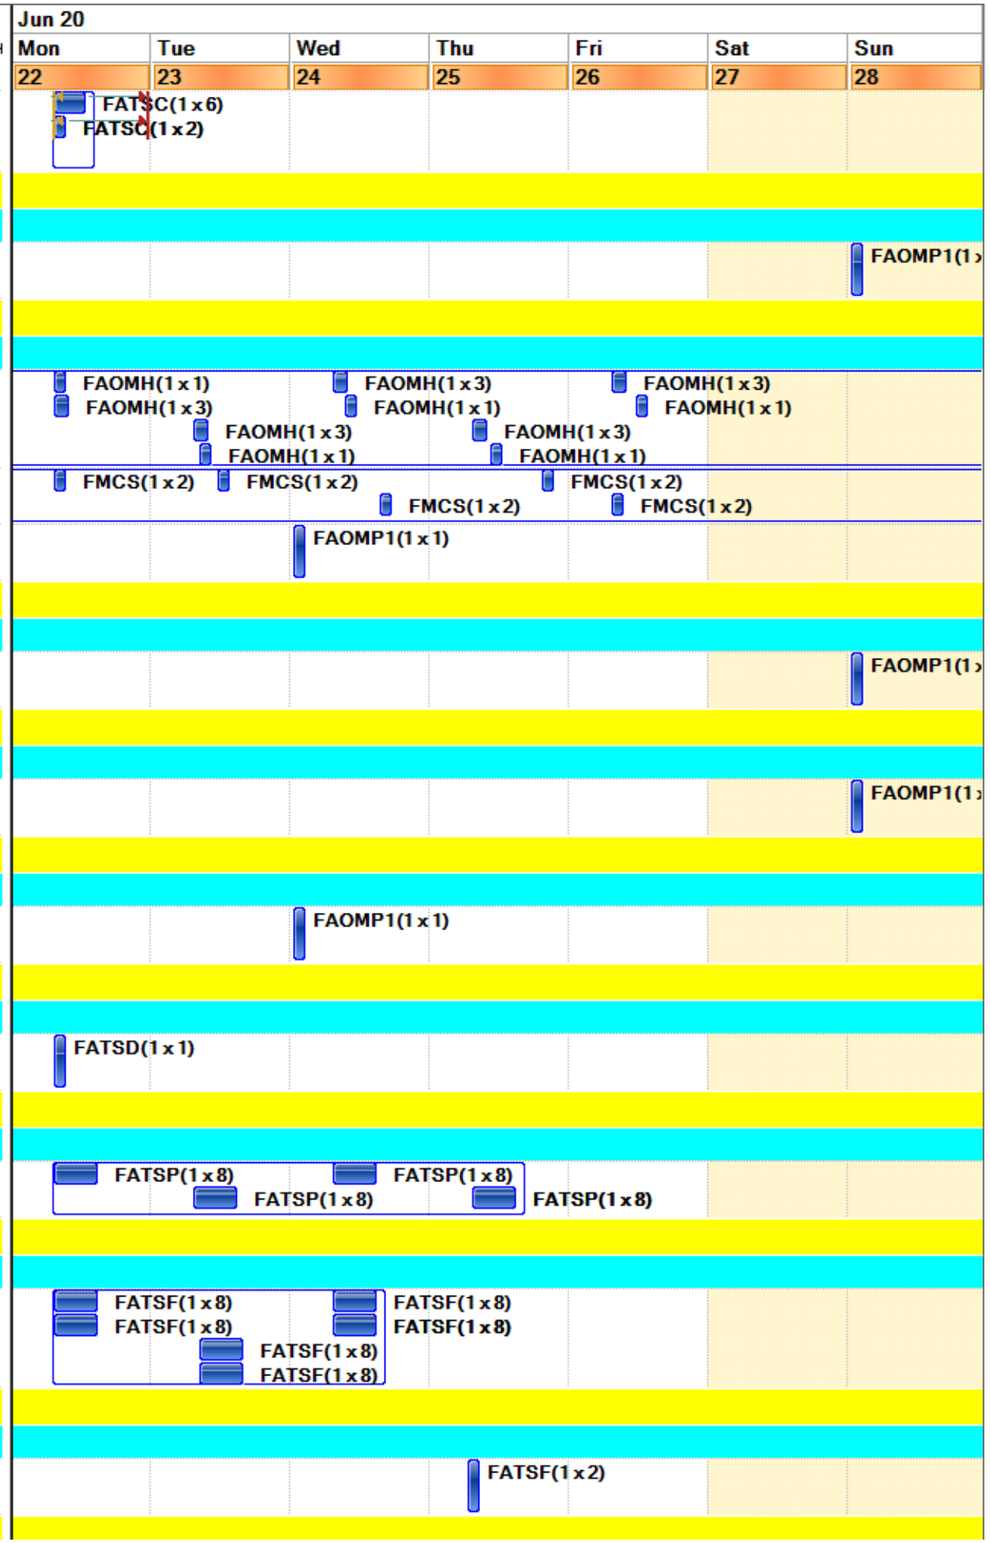

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
	FAM Name : Escobedo,Carlos (0 item)			
1	W0153948	(Child) Isolate and drain 1st floor, 2nd floor, B70 2nd fl annex fire sprinkler system.	FATSD	CMR, Etc
	Location : 070A-0199X (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0220903	(Child) Investigate, identify isolation points, and provide procedures for FTU pump replacement.	FAOMP1	CMR, Etc
	Location : 070A-1199 (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0214815	PM FOR 70ACT 002	FAOMP1	PMs
	Location : 070A-2217 (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0214624	PM FOR 70ABL 069 A31 2ea 6/23	FAOMP1	PMs
	Location : 070A-2275C (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0220006	Troubleshoot blower motor.	FATSE2	CMR, Etc
	Location : 070A-2295 (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0217568	Install missing cover plate	FATSE1	CMR, Etc
	Location : 070A-3329 (1 item) (Total=1)			
	FAM Name : Escobedo,Carlos (1 item)			
1	W0218830	Bldg. 70/70A PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
	Location : 070A-4457A (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0214616	PM FOR 70ABL 065 6/23	FAOMP1	PMs
	Location : 070A-4463B (0 item) (Total=1)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0217170	Inspect coils in 4463B and 4463C, cut ductwork and brush/clean hot water coil.	FAOMH	CMR, Etc
	Location : 070A-ROF1 (0 item) (Total=19)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0214620	PM FOR 70ABL 067 6/23	FAOMP1	PMs
2	W0214626	PM FOR 70ABL 071 6/23	FAOMP1	PMs

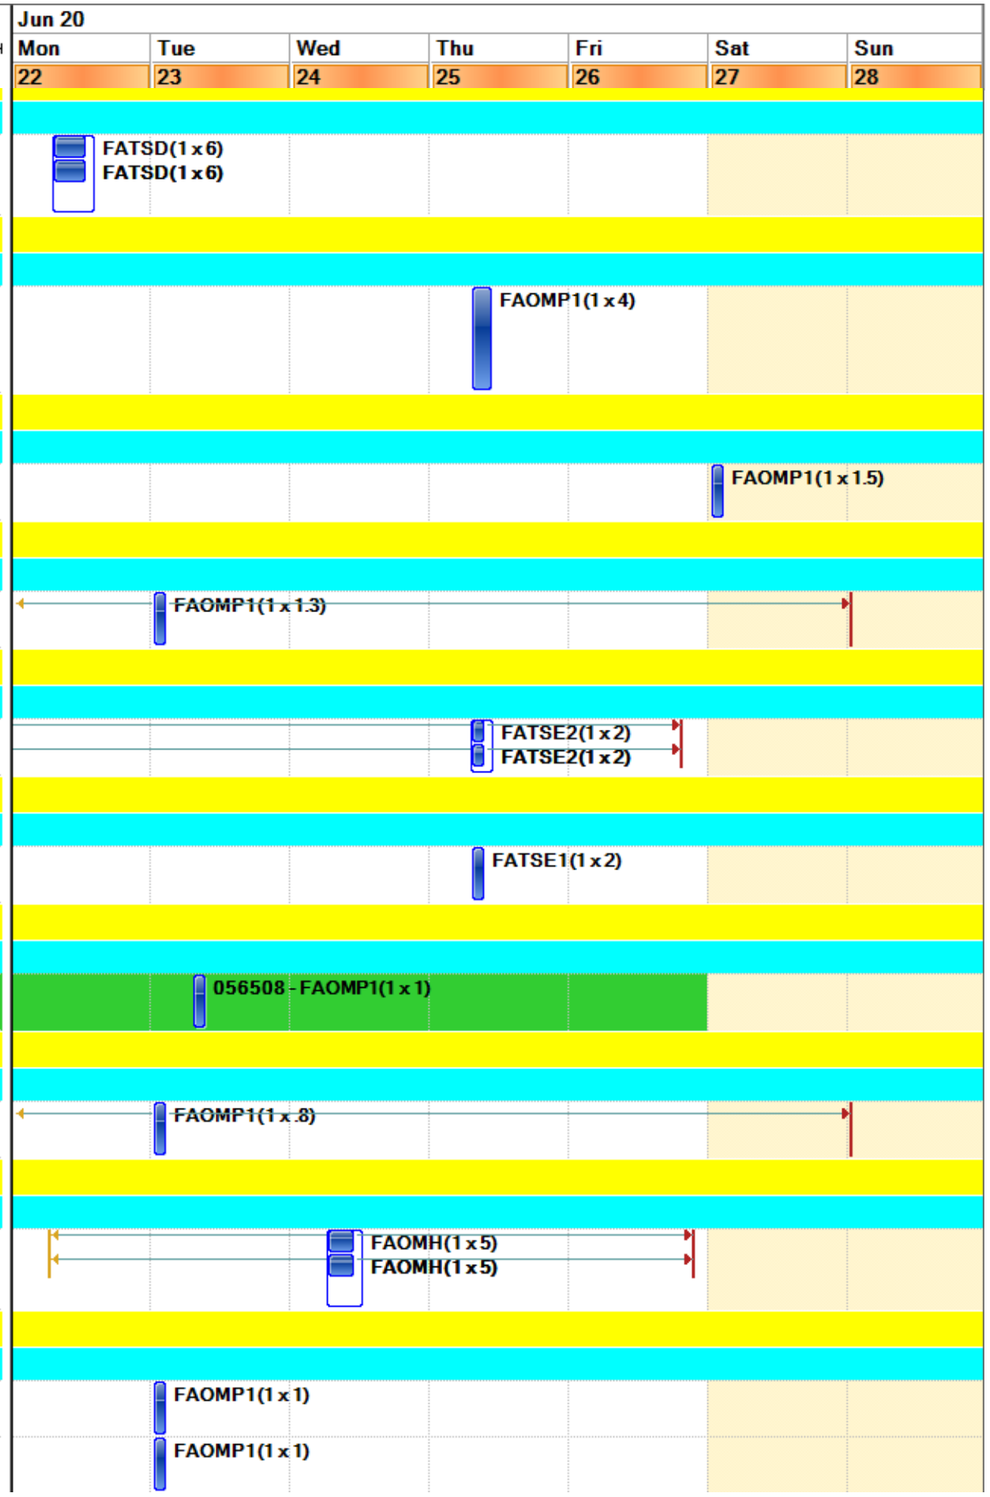

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro	Jun 20 Mon 22	Tue 23	Wed 24	Thu 25	Fri 26	Sat 27	Sun 28
3	W0214628	PM FOR 70ABL 072 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
4	W0214630	PM FOR 70ABL 073 A32 1ea 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
5	W0214632	PM FOR 70ABL 074 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
6	W0214634	PM FOR 70ABL 075 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
7	W0214636	PM FOR 70ABL 080 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
8	W0214638	PM FOR 70ABL 081 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
9	W0214640	PM FOR 70ABL 082 A24 2 ea. 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
10	W0214642	PM FOR 70ABL 083 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
11	W0214644	PM FOR 70ABL 084 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
12	W0214646	PM FOR 70ABL 085 AX26 2ea. 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
13	W0214648	PM FOR 70ABL 086 A28 2ea 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
14	W0214650	PM FOR 70ABL 087 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
15	W0214652	PM FOR 70ABL 088 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
16	W0214654	PM FOR 70ABL 089 A42 2ea 6/23	FAOMP1	PMs		FAOMP1(1 x 1)					
17	W0214690	PM FOR 70ABL 058 6/23	FAOMP1	PMs		FAOMP1(1 x .5)					
18	W0216295	QEW2 Support/ PMT Blower PM's at Bldg 70A 6/23	FATSE2	COORD PMs		FATSE2(1 x 8) FATSE2(1 x 8)					
19	W0220870	Walk building common and non-lab areas and remove and replace burnt out lamps as necessary.	FAOML	CMR, Etc				FAOML(1 x 8) FAOML(1 x 8)	FAOML(1 x 8) FAOML(1 x 8)		
Location : 070-ROF1 (0 item) (Total=1)											
FAM Name : Escobedo,Carlos (0 item)											
1	W0220869	Walk building common and non-lab areas and remove and replace burnt out lamps as necessary.	FAOML	CMR, Etc				FAOML(1 x 8) FAOML(1 x 8)	FAOML(1 x 8) FAOML(1 x 8)		
Location : 071-0001 (0 item) (Total=1)											
FAM Name : Atkinson,Joseph (0 item)											
1	W0220113	Replace 4 Sprinkler gauges	FATSF	CMR, Etc		FATSF(1 x 2)					
Location : 071-0002D (0 item) (Total=1)											
FAM Name : Atkinson,Joseph (0 item)											

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0204185	Install Exit Bug light combo on concrete wall next to B71 West end roll up door	FATSE1	CMR, Etc
Location : 071-0121 (0 item) (Total=5)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0216648	PM FOR 71 GP 059	FAOMP1	PMs
2	W0216650	PM FOR 71 GP 060	FAOMP1	PMs
3	W0216652	PM FOR 71 GP 061	FAOMP1	PMs
4	W0216654	PM FOR 71 GP 062	FAOMP1	PMs
5	W0216656	PM FOR 71 GP 063	FAOMP1	PMs
Location : 071-0199 (0 item) (Total=2)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0218757	PM for TRW filter 71 FL 002 6/22 - 6/28	FAOMP3	PMs
2	W0218759	PM for TRW filter 71 FL 003 6/22 - 6/28	FAOMP3	PMs
Location : 071-0261 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0216451	PM FOR 71 BFP009	FAOMP1	Code Complaint PMs
Location : 071B-ROF1 (0 item) (Total=2)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0215666	Make electrical terminations for motor for 71B BL 038	FATSE2	CMR, Etc
2	W0216756	Install motor for BL-038 Located on B-71B Roof	FAOMP1	CMR, Etc
Location : 071-ROF1 (1 item) (Total=1)				
FAM Name : Atkinson,Joseph (1 item)				
1	W0218832	Bldg. 71 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
Location : 072-0119 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216785	PM NFPA72 BLDG. 72 fire alarm system ITM	FATSD	Code Complaint PMs
Location : 072-0199V (0 item) (Total=2)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216937	PM NFPA25 BLDG. 72/72A/72B/72C sprinkler ITM	FATSD	Code Complaint PMs
2	W0217003	PM NFPA25 BLDG. 72A/72B preaction ITM	FATSD	Code Complaint PMs
Location : 072C-0169 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				

Jun 20

Mon	Tue	Wed	Thu	Fri	Sat	Sun
22	23	24	25	26	27	28

FATSE1(1 x 4)

FAOMP1(1 x 1.5)

FAOMP1(1 x 1.5)

FAOMP1(1 x 1.5)

FAOMP1(1 x 1.5)

FAOMP1(1 x 1.5)

FAOMP3(1 x

FAOMP3(1 x

FAOMP1(1 x 1)

FATSE2(1 x 2)
FATSE2(1 x 2)

FAOMP1(1 x 1)
FAOMP1(1 x 1)

056508 - FAOMP1(1 x 1)

FATSD(1 x 1)

FATSD(1 x 1)

FATSD(1 x 1)

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
1	W0216497	PM FOR 72CFL 001	FAOMP3	PMs
Location : 072C-0173 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0216499	PM FOR 72CFL 002	FAOMP3	PMs
Location : 072C-ROF1 (0 item) (Total=1)				
FAM Name : Tafoya,Eric (0 item)				
1	W0220777	(Child) Investigate isolation points and provide procedure for draining system for TRW piping repair	FAOMP1	CMR, Etc
Location : 073-0199 (0 item) (Total=2)				
FAM Name : Tafoya,Eric (0 item)				
1	W0212604	Release LOTO on 6/24 at 7:30am - (Parent) LOTO Support for Contractor Work	FATSE2	PROJECTS
2	W0217000	PM NFPA25 BLDG. 73/73A sprinkler ITM	FATSD	Code Complaint PMs
Location : 074-0199 (0 item) (Total=1)				
FAM Name : Lucacher,Robert Howard (0 item)				
1	W0216940	PM NFPA25 BLDG. 74 sprinkler ITM	FATSD	Code Complaint PMs
Location : 076-0199 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0218761	B76 Fuel Spill Containment Basin 6/22 - 6/28	FAOMP3	PMs
Location : 076-0234 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0218796	Replace lamps with LEDs in 234 and 235 for PSPS FEE	FAOML	CMR, Etc
Location : 076-0235 (0 item) (Total=1)				
FAM Name : Atkinson,Joseph (0 item)				
1	W0217371	Data Log PNL E447A	FATSE2	CMR, Etc
Location : 077-0119 (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0216791	PM NFPA72 BLDG. 77/79/79A fire alarm system ITM	FATSD	Code Complaint PMs
Location : 077-0199X (0 item) (Total=1)				
FAM Name : Escobedo,Carlos (0 item)				
1	W0205282	PM FOR 77 RF 004 "Weekly"	FAOMH	PMs
Location : 077A-0199 (0 item) (Total=1)				

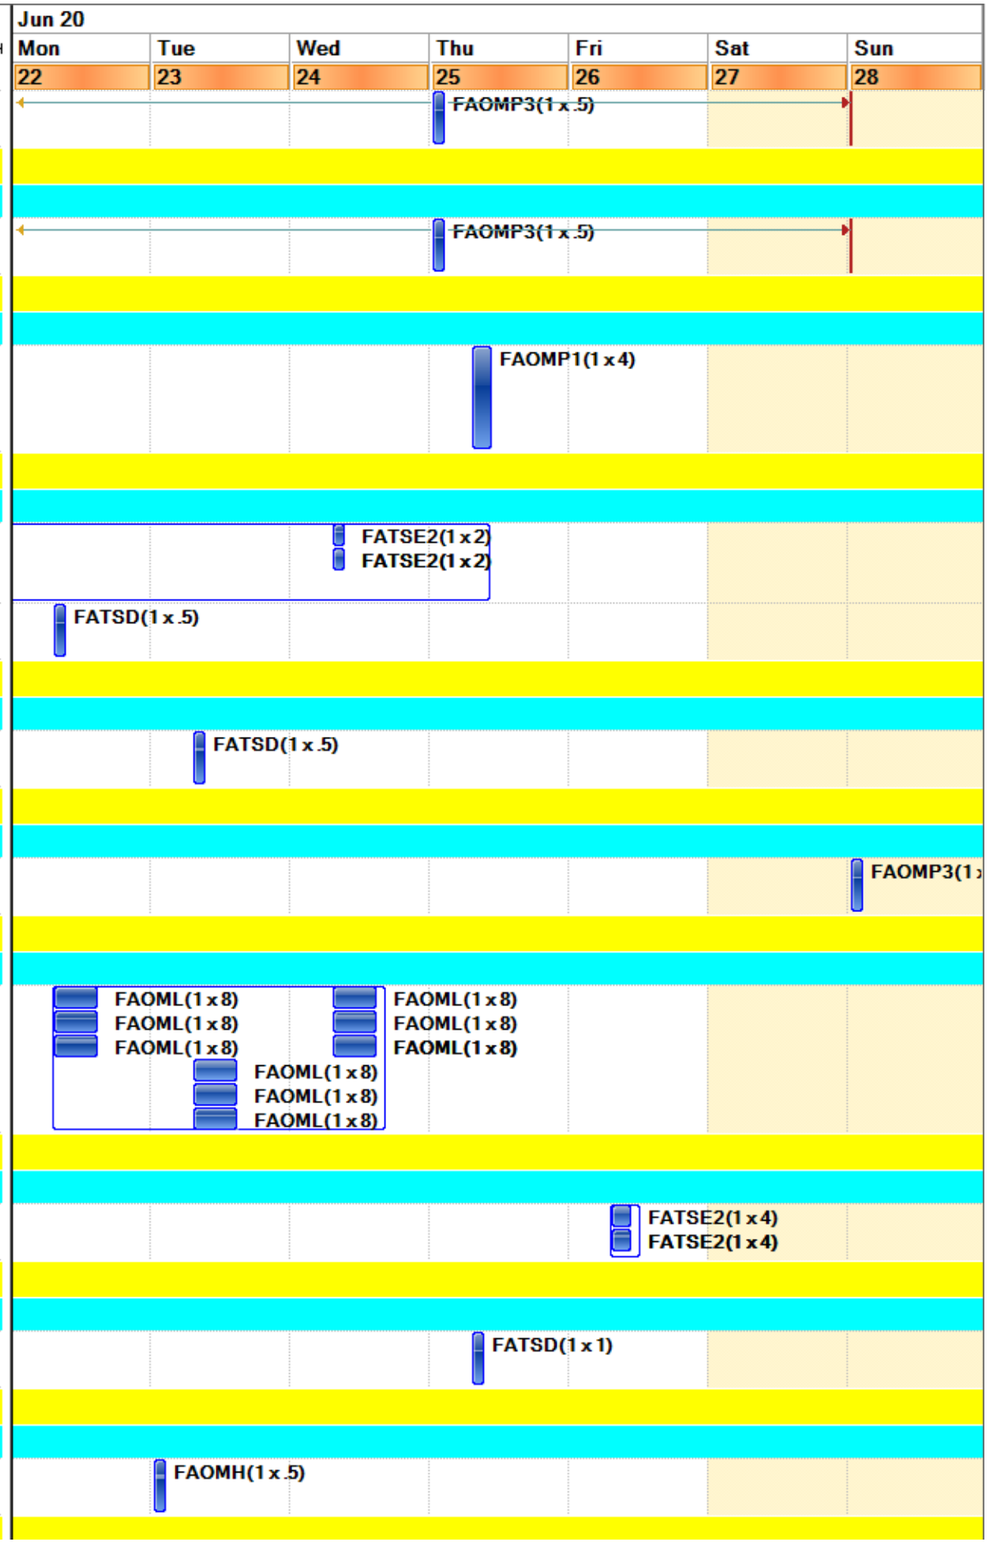

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
	FAM Name : Escobedo,Carlos (0 item)			
1	W0220035	URGENT FMCS to perform check on the logic and figure out why the chilled water pump (for the chiller	FMCS	CMR, Etc
	Location : 077-SKID (0 item) (Total=2)			
	FAM Name : Escobedo,Carlos (0 item)			
1	W0216481	PM ON 77 FL001 (PEP IMF Water Filter, Sand)	FAOMP3	PMs
2	W0216483	PM ON 77 FL002 (PEP IMF Water Filter, Sand)	FAOMP3	PMs
	Location : 080-0199 (0 item) (Total=2)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0216958	PM NFPA25 BLDG. 80 sprinkler ITM	FATSD	Code Complaint PMs
2	W0216961	PM NFPA25 BLDG. 80A sprinkler ITM	FATSD	Code Complaint PMs
	Location : 080-0202 (0 item) (Total=1)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0220901	Troubleshoot ice machine, not functioning properly @ B80-0202	FAOMH	CMR, Etc
	Location : 080-0210 (0 item) (Total=1)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0219027	Space to hot/cold, need to troubleshoot.	FAOMH	CMR, Etc
	Location : 080-ROF1 (0 item) (Total=3)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0216369	PM FOR 80 AHU006	FAOMP2	PMs
2	W0216371	PM FOR 80 BL 050	FAOMP2	PMs
3	W0216373	PM FOR 80 BL 049	FAOMP2	PMs
	Location : 082-0100 (0 item) (Total=2)			
	FAM Name : Rini,Christopher G (0 item)			
1	W0217082	PM NFPA25 BLDG. 82 grid booster pump ITM (weekly)	FATSD	Code Complaint PMs
2	W0220112	Replace 4 Sprinkler Gauges	FATSF	CMR, Etc
	Location : 083-0150 (0 item) (Total=1)			
	FAM Name : Lucacher,Robert Howard (0 item)			
1	W0216589	PM FOR 83 IX 001	FAOMP2	PMs
	Location : 083-0199 (0 item) (Total=1)			
	FAM Name : Lucacher,Robert Howard (0 item)			

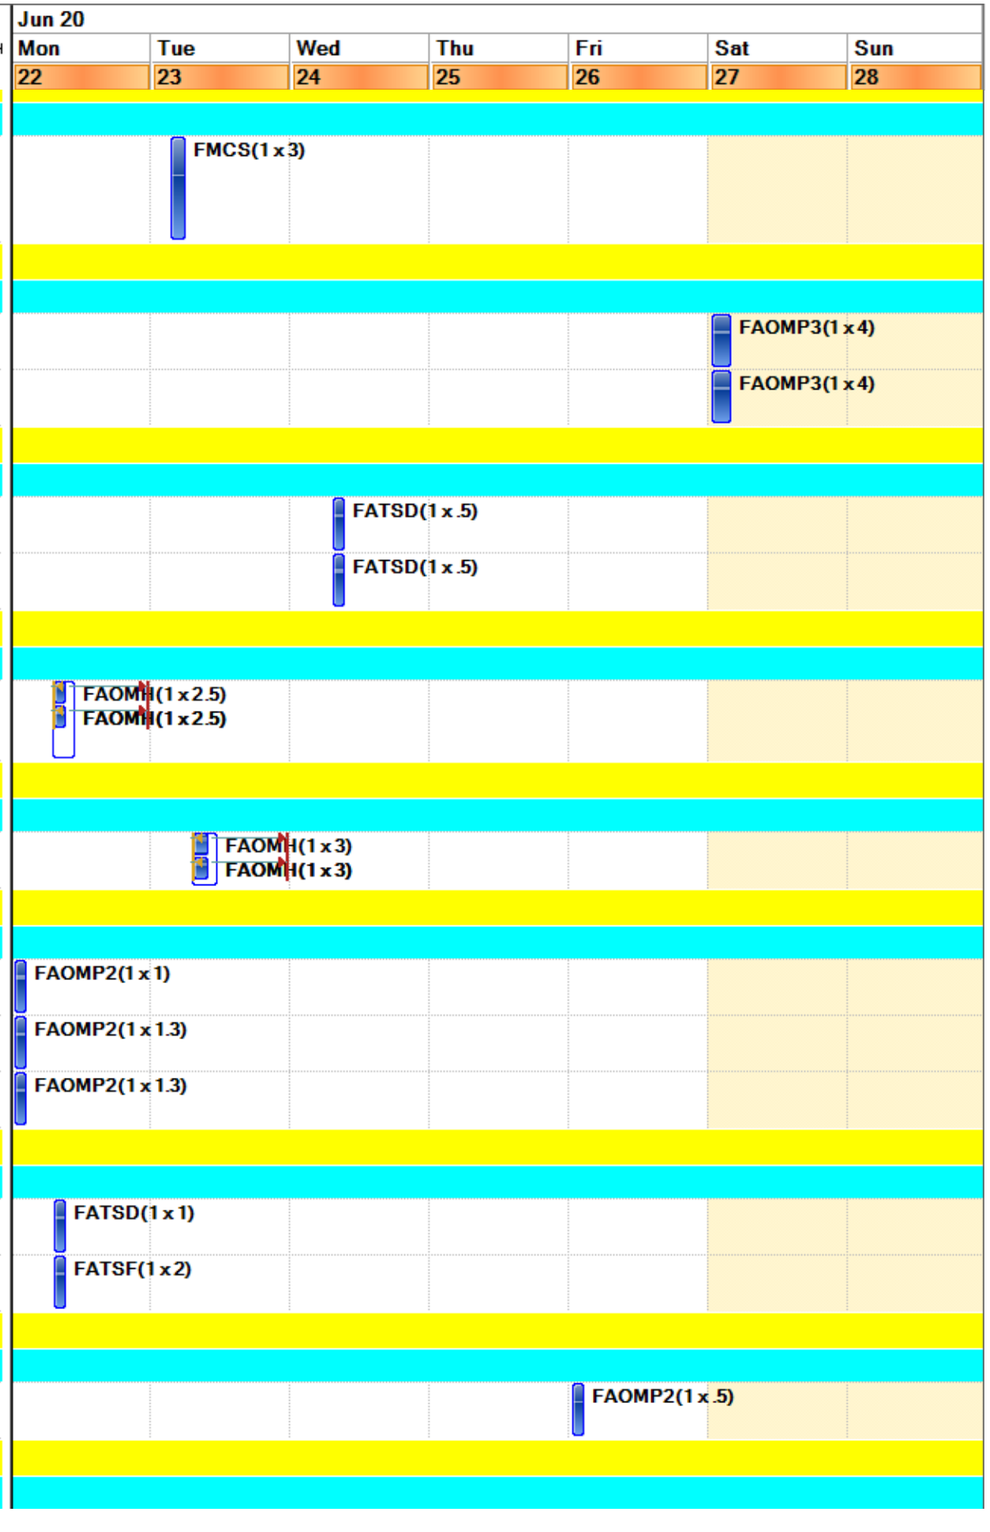

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro	Jun 20 Mon 22	Tue 23	Wed 24	Thu 25	Fri 26	Sat 27	Sun 28
1	W0216970	PM NFPA25 BLDG. 83/83A sprinkler ITM	FATSD	Code Complaint PMs		FATSD(1 x .5)					
Location : 084-0100 (0 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0215791	Remove and replace all Exit lights in B84, refeed new Exit/Bug light combos from normal power source	FATSE1	CMR, Etc			FATSE1(1 x 8) FATSE1(1 x 8)	FATSE1(1 x 8) FATSE1(1 x 8)	FATSE1(1 x 8) FATSE1(1 x 8)		
Location : 084-0104 (0 item) (Total=2)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0216501	PM FOR 84 FL 001	FAOMP2	PMs						FAOMP2(1 x 1)	
2	W0216503	PM FOR 84 FL 002	FAOMP2	PMs						FAOMP2(1 x 1)	
Location : 084-0106 (0 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0218468	PM FOR 84 BR 011 MATL in Stores	FAOMP3	PMs				FAOMP3(1 x 4)			
Location : 084-0199 (0 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0216976	PM NFPA25 BLDG. 84 sprinkler ITM	FATSD	Code Complaint PMs	FATSD(1 x .5)						
Location : 084B-0091 (1 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (1 item)											
1	W0218834	Bldg. 84/84B PM Monthly Vibration Survey by Vendor	FAOMP1	PMs			FAOMP1(1 x 1)				
Location : 084B-0199X (0 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0216973	PM NFPA25 BLDG. 84B sprinkler ITM	FATSD	Code Complaint PMs	FATSD(1 x .5)						
Location : 084B-0200 (0 item) (Total=1)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0216533	PM FOR 84BGP 005	FAOMP2	PMs						FAOMP2(1 x .5)	
Location : 084B-ROF1 (0 item) (Total=3)											
FAM Name : Lucacher,Robert Howard (0 item)											
1	W0218520	HYPERCHLORINATION FOR 84B CT 001/002	FAOMP1	PMs		FAOMP1(1 x 1.5)					
2	W0214817	PM FOR 84BCT 001	FAOMP1	PMs			FAOMP1(1 x 6) FAOMP1(1 x 6)				
3	W0214819	PM FOR 84BCT 002	FAOMP1	PMs				FAOMP1(1 x 6) FAOMP1(1 x 6)			
Location : 085-0101 (0 item) (Total=1)											
FAM Name : Atkinson,Joseph (0 item)											
1	W0216799	PM NFPA72 BLDG. 85 & 85B fire alarm system ITM	FATSD	Code Complaint PMs				FATSD(1 x 1)			
Location : 085-0103 (0 item) (Total=1)											

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
	FAM Name : Atkinson,Joseph (0 item)			
1	W0218753	PM FOR 85 BR 001	FAOMP3	PMs
	Location : 085-0199 (0 item) (Total=3)			
	FAM Name : Atkinson,Joseph (0 item)			
1	W0216812	PM NFPA25 BLDG. 85 HEF ITM	FATSD	Code Complaint PMs
2	W0216985	PM NFPA25 BLDG. 85/85D wet/dry sprinkler ITM	FATSD	Code Complaint PMs
3	W0218755	Weekly PM test of 85 ALT 096 6/22 - 6/28	FAOMP3	PMs
	Location : 085A-0199 (0 item) (Total=1)			
	FAM Name : Atkinson,Joseph (0 item)			
1	W0216979	PM NFPA25 BLDG. 85A AFFF deluge ITM	FATSD	Code Complaint PMs
	Location : 085B-0199 (0 item) (Total=1)			
	FAM Name : Atkinson,Joseph (0 item)			
1	W0216982	PM NFPA25 BLDG. 85B sprinkler ITM	FATSD	Code Complaint PMs
	Location : 086-0199 (0 item) (Total=3)			
	FAM Name : (0 item)			
1	W0220678	OCx- B86 Weekly Ongoing Monitoring	FMCS	CMR, Etc
	FAM Name : Bradford,Adam B (0 item)			
1	W0216271	PM All Eye Washes and Showers B86	FAOMP2	PMs
2	W0216988	PM NFPA25 BLDG. 86 sprinkler ITM	FATSD	Code Complaint PMs
	Location : 086-ROF1 (0 item) (Total=1)			
	FAM Name : Bradford,Adam B (0 item)			
1	W0216197	PM for 86 HU 002 (Sched Mon or Tue) PLEASE UPDATE JOB STEPS SINCE MATERIALS ADDED (SCOTT)	FAOMH	COORD PMs
	Location : 088-0011 (0 item) (Total=1)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0214912	PM FOR 88 KC 008 MATL at Stores	FAOMP3	PMs
	Location : 088-0199 (0 item) (Total=1)			
	FAM Name : Reisinger,Richard D. (0 item)			
1	W0216991	PM NFPA25 BLDG. 88/88B/88C/88D sprinkler ITM	FATSD	Code Complaint PMs
	Location : 088CGT001 (1 item) (Total=1)			
	FAM Name : Reisinger,Richard D. (1 item)			
1	W0218805	Bldg. 88 PM Monthly Vibration Survey by Vendor	FAOMP1	PMs
	Location : 090-0001 (0 item) (Total=3)			

Jun 20

Mon	Tue	Wed	Thu	Fri	Sat	Sun
22	23	24	25	26	27	28

FAOMP3(1 x 2.5)

FATSD(1 x 1)

FATSD(1 x 1)

FAOMP3(1 x 1)

FATSD(1 x 1)

FATSD(1 x 1)

FMCS(1 x 2) FMCS(1 x 2) FMCS(1 x 2) FMCS(1 x 2) FMCS(1 x 2)

FAOMP2(1 x 4)

FATSD(1 x 1)

FAOMH(1 x 4)

FAOMP3(1 x 5)

FATSD(1 x 1)

056508 - FAOMP1(1 x 1)

Final Schedule

	Work Order	Description	Lead Craft	Work Type Gro
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220111	Replace 5 Sprinkler Gauges	FATSF	CMR, Etc
2	W0211575	PM FOR 90 AHU001 MATL at Stores	FAOMP3	PMs
3	W0193530	Brush down exterior of building	FATSL	CMR, Etc
Location : 090-0026G (0 item) (Total=1)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0216806	PM NFPA72 BLDG. 90X fire alarm system ITM	FATSD	Code Complaint PMs
Location : 090-0027A (0 item) (Total=7)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0216570	PM FOR 90 GP 001	FAOMP3	PMs
2	W0216572	PM FOR 90 GP 002	FAOMP3	PMs
3	W0216574	PM FOR 90 GP 008	FAOMP3	PMs
4	W0216576	PM FOR 90 GP 010	FAOMP3	PMs
5	W0216578	PM FOR 90 GP 018	FAOMP3	PMs
6	W0216580	PM FOR 90 GP 019	FAOMP3	PMs
7	W0216582	PM FOR 90 GP 020	FAOMP3	PMs
Location : 090-2056H (0 item) (Total=1)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220698	Ceiling air supply vent is very noisy; investigate and mitigate as needed.	FAOMH	CMR, Etc
Location : 090X-0101 (0 item) (Total=1)				
	FAM Name : Gutierrez,Myrna (0 item)			
1	W0220108	Replace 9 sprinkler gauges	FATSF	CMR, Etc
Location : 091-0192 (0 item) (Total=1)				
	FAM Name : Bradford,Adam B (0 item)			
1	W0217039	PM NFPA25 BLDG. 91 sprinkler ITM	FATSD	Code Complaint PMs
Location : 091-0267 (0 item) (Total=1)				
	FAM Name : Bradford,Adam B (0 item)			
1	W0218879	Troubleshoot 91-RAM-010.	FMCS	CMR, Etc
Location : 091U-0101 (0 item) (Total=4)				

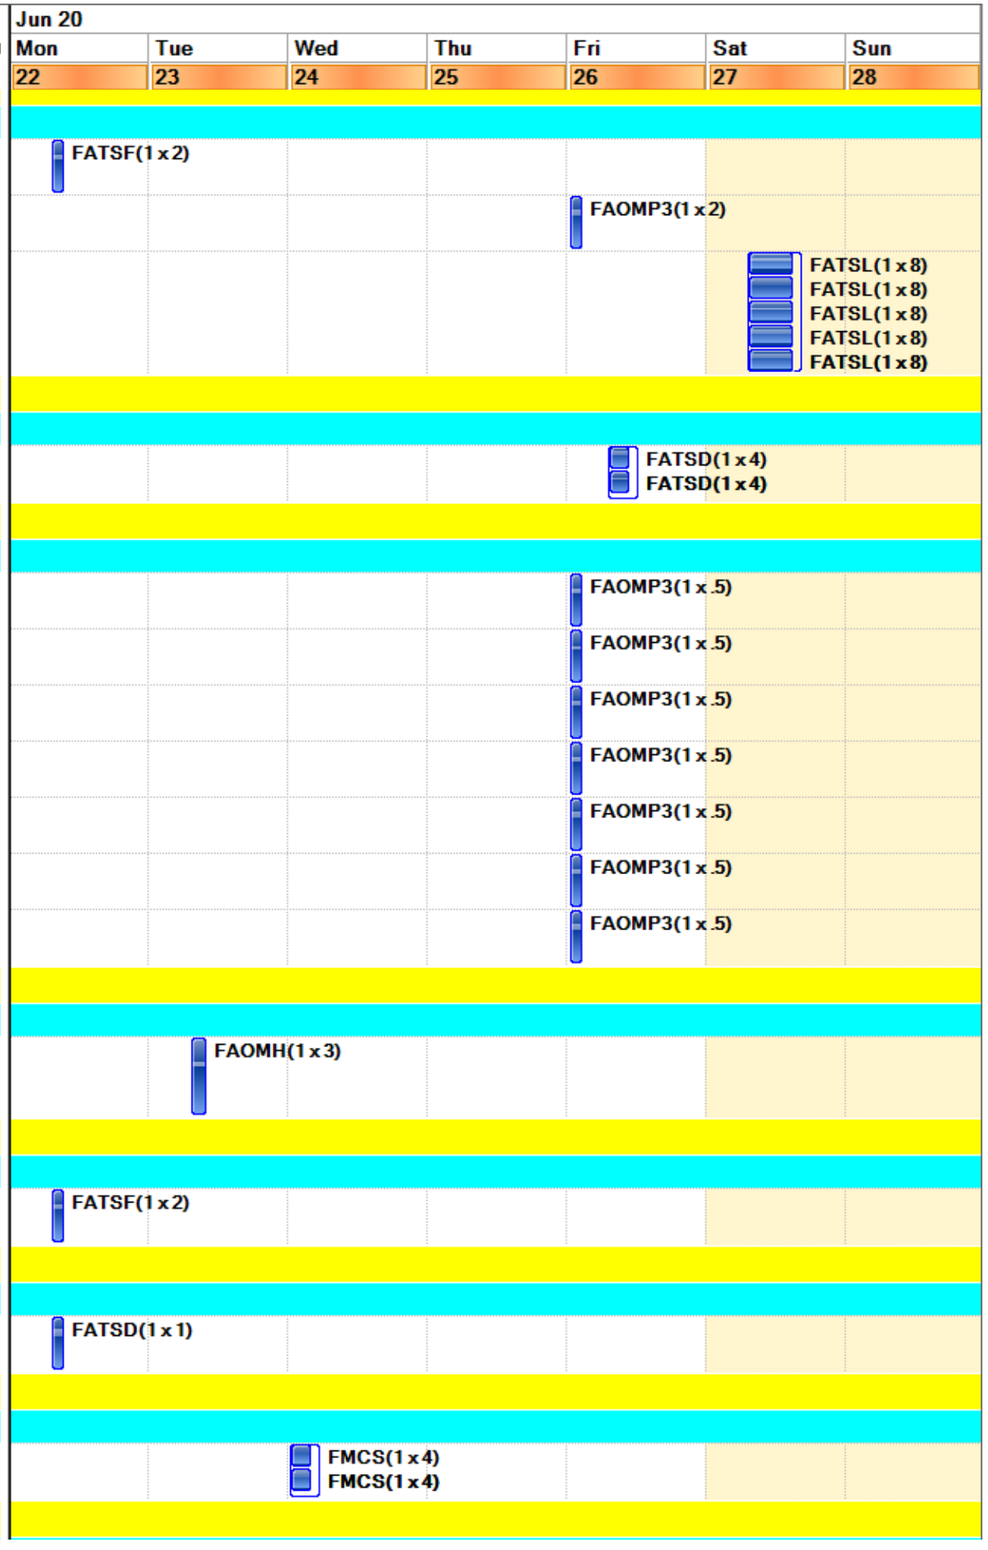

Final Schedule
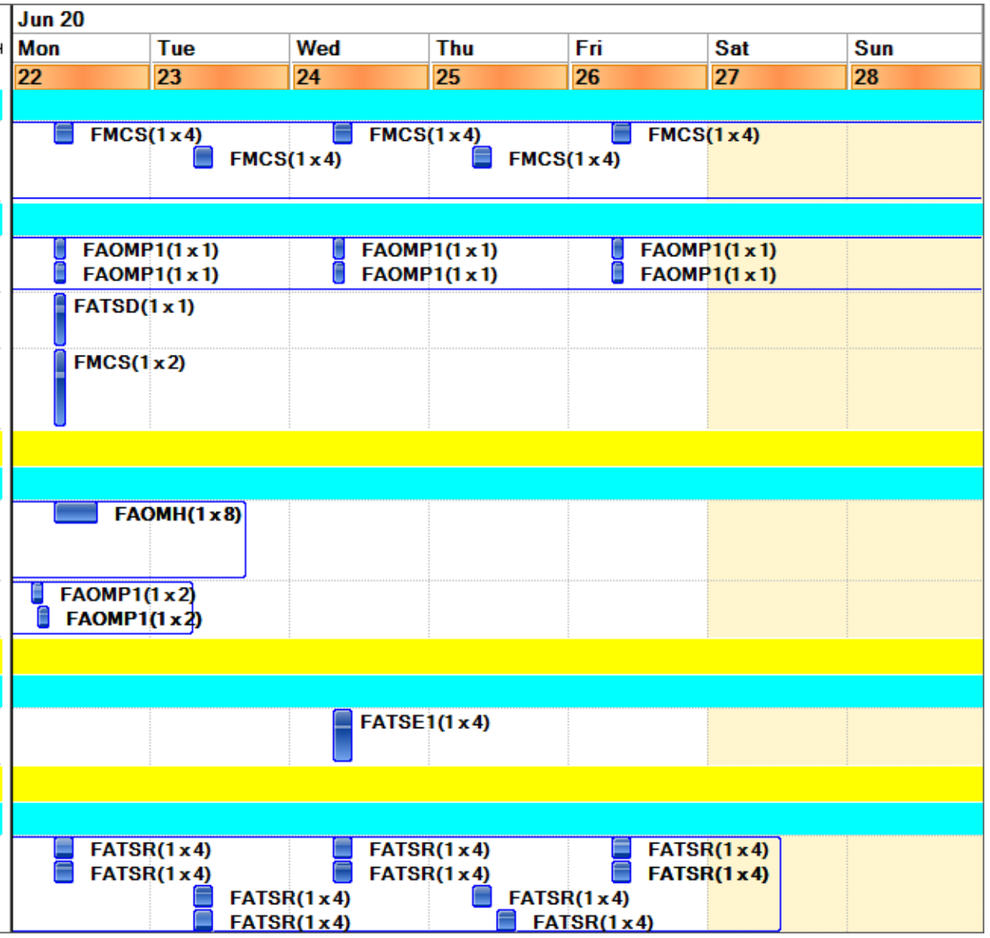
	Work Order	Description	Lead Craft	Work Type Gro
FAM Name : (0 item)				
1	W0220671	OCx - MUP CHW Plant ARU-2 shouldn't run in partial free cooling mode	FMCS	CMR, Etc
FAM Name : Bradford,Adam B (0 item)				
1	W0213917	(Parent) Remove and clean strainer	FAOMP1	CMR, Etc
2	W0217043	PM NFPA25 BLDG. 91U sprinkler ITM	FATSD	Code Complaint PMs
3	W0220139	Troubleshoot/repair TWS closed isolation valve with feedback status saying open	FMCS	CMR, Etc
Location : 091U-0199X (1 item) (Total=2)				
FAM Name : Bradford,Adam B (1 item)				
1	W0218522	(Child) Perform temporary chiller start up per manufacturers specifications.	FAOMH	PROJECTS
2	W0217650	(Child) Provide temp chiller start up support.	FAOMP1	PROJECTS
Location : 091X-0199X (0 item) (Total=1)				
FAM Name : Bradford,Adam B (0 item)				
1	W0207979	Install exterior light fixture in Gas Cage area.	FATSE1	CMR, Etc
Location : HSITE2020 (0 item) (Total=1)				
FAM Name : Schroeter,Peter James (0 item)				
1	W0219046	Arrange tools and materials in and around Conex boxes located at new B31 location.	FATSR	CMR, Etc