PM-31 PROGRAM MATRIX MODULE

POSITIVE INPUT TERMINALS

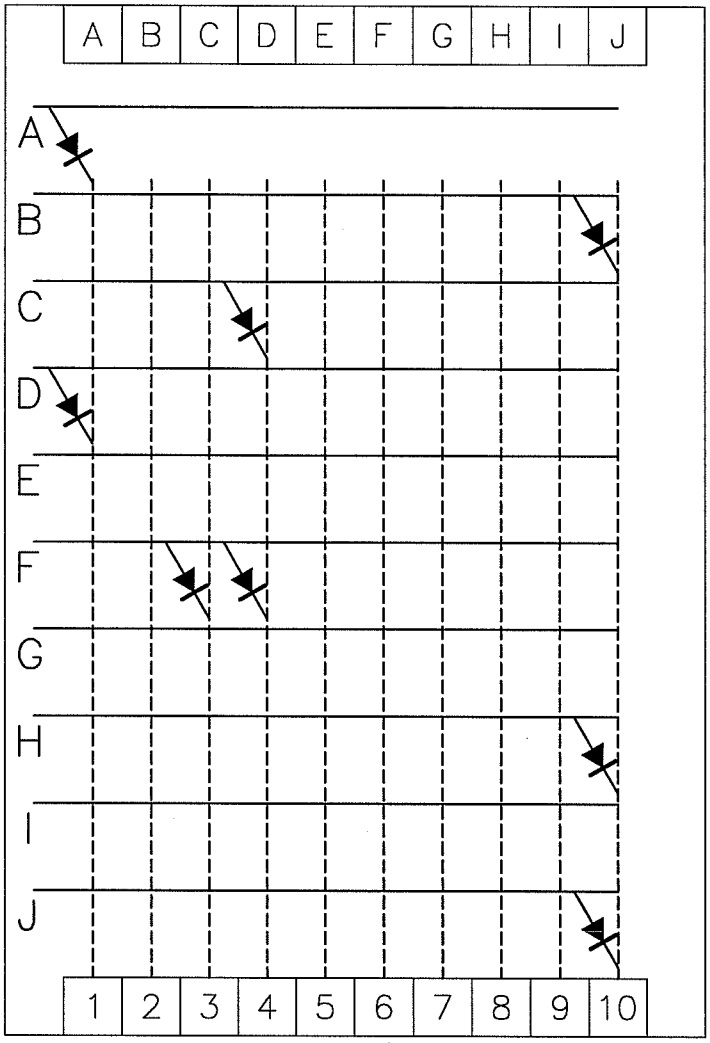

PM-31
MOD MOD

OUTPUT TERMINALS TO CONTROLLED DEVICES

INSTALL DIODES AS NEEDED

10 INPUTS – 10 OUTPUTS OR ANY COMBINATION

(OCCUPIES 2 MODULE SPACES)

LBNL ELECTRICAL STANDARDS **FIRE ALARM SYSTEM** **PM-31 PROGRAM MATRIX MODULE**	DRAWN BY	DATE
	CHECKED BY	
	APPROVED BY	
	CAD FILE PATH	
	SCALE NTS	
UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY FACILITIES DIVISION	DRAWING NO. FA145	SHEET
	PROJECT NO.	

T:\groups\ELECT\Romy\STD\Fire Alarm\FA145 PM-31 PROGRAM MATRIX MODULE.dwg