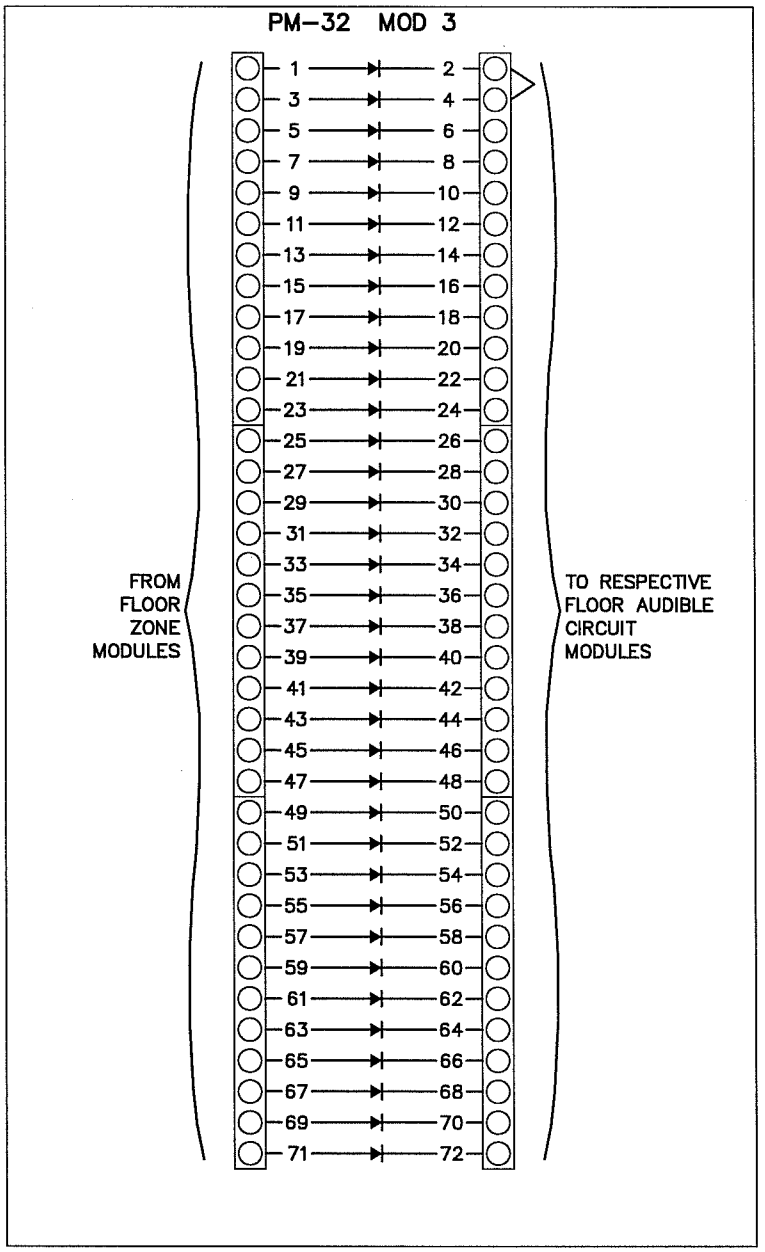

USED FOR SIGNAL ISOLATION

INSTALL DIODES AS NEEDED

36 INPUTS – 36 OUTPUTS OR ANY COMBINATION

LBNL ELECTRICAL STANDARDS
FIRE ALARM SYSTEM
PM-32 PROGRAM MATRIX MODULE

DRAWN BY	DATE
CHECKED BY	
APPROVED BY	
CAD FILE PATH	
SCALE NTS	
DRAWING NO. FA151	SHEET
PROJECT NO.	

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY

FACILITIES DIVISION

T:\groups\ELECT\Romy\STD\Fire Alarm\FA151 PM-32 PROGRAM MATRIX MODULE.dwg