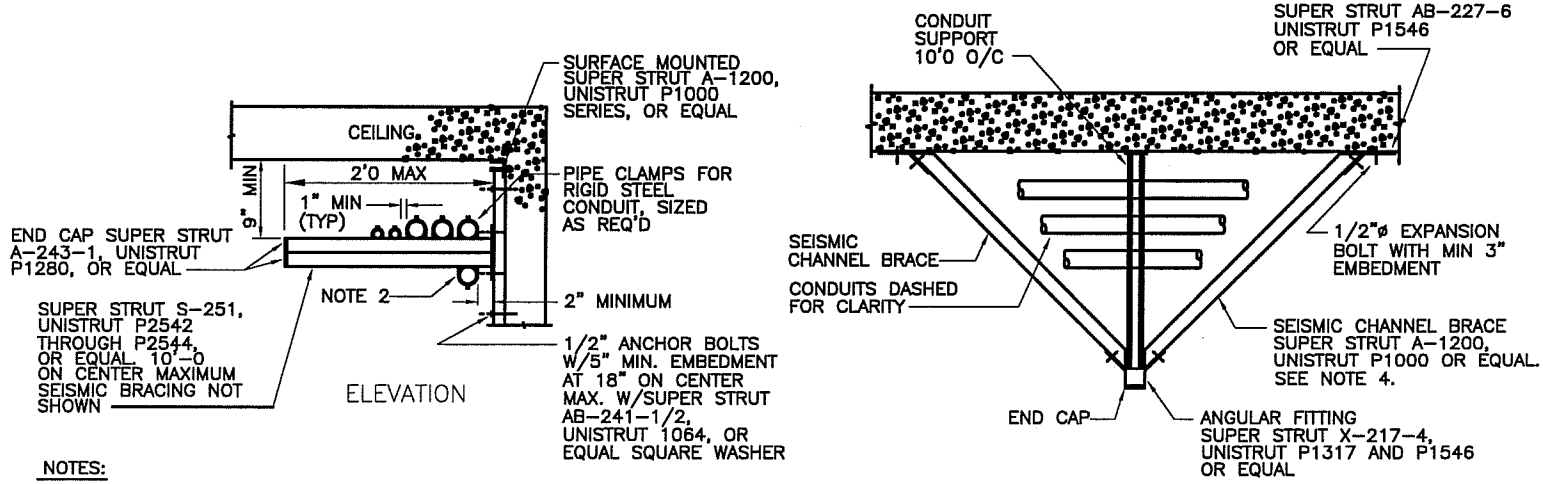

NOTES:

1. HARDWARE SHALL BE HOT DIP GALVANIZED AFTER FABRICATION EXCEPT FITTINGS MAY BE ZINC PLATED.
2. MAX LOAD(CONDUIT AND FILL) PER UNIT TO BE 1000 LBS. CONTRACTOR TO PROVIDE CALCULATIONS WHEN LOAD EXCEEDS 1000 LBS.
3. HOLE SIZES ON FITTINGS SHALL BE 9/16"ø WITH 1/2" HEX HEAD CAP SCREW 15/16" LONG AND 1/2" CLAMP NUT WITH SPRING
4. SEISMIC CHANNEL BRACING REQUIRED AT INTERVALS OF 60' MAX FOR ZONE 3 AND 40' MAX FOR ZONE 4.

5 CONDUIT RACK SEISMIC ZONES 3 & 4

LBNL ELECTRICAL STANDARDS

INSTALLATION DETAILS

CONDUIT RACK SEISMIC ZONES 3 & 4

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY

FACILITIES DIVISION

DRAWN BY		DATE
CHECKED BY		
APPROVED BY		
CAD FILE PATH		
SCALE	NTS	
DRAWING NO.	INS108	SHEET
PROJECT NO.		

T:\groups\ELECT\Romy\STD\Installation\INS108 CONDUIT RACK SEISMIC ZONES 3 & 4.dwg