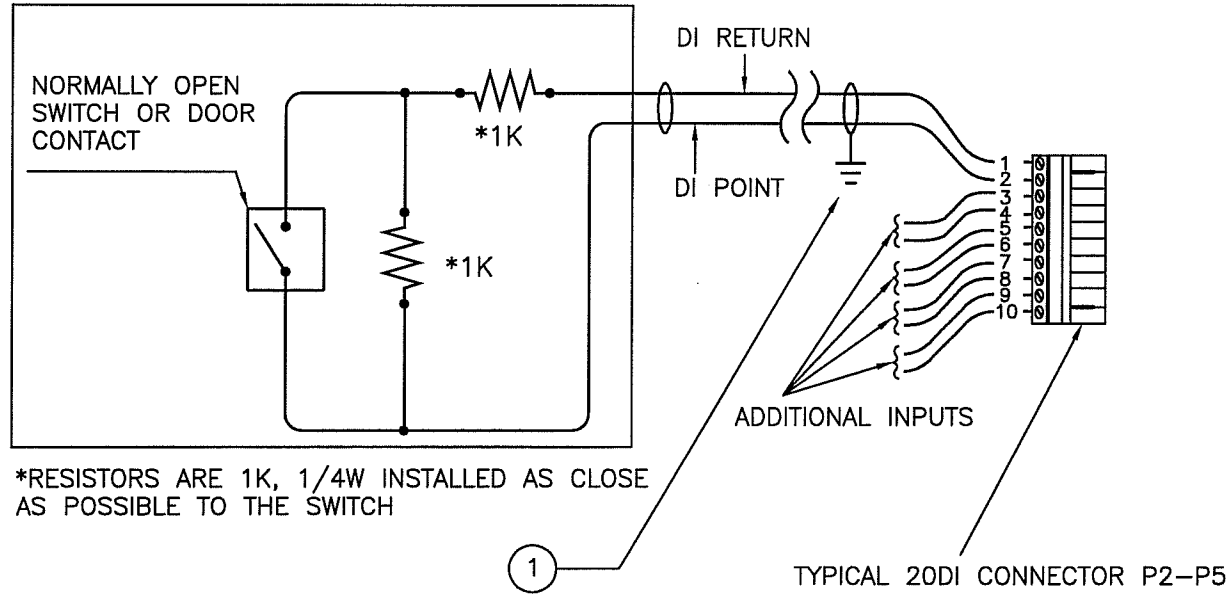

*RESISTORS ARE 1K, 1/4W INSTALLED AS CLOSE AS POSSIBLE TO THE SWITCH

4–STATE SUPERVISED DIGITAL INPUT	
STATE	RESISTANCE AT INPUT
CLOSED	1,000 OHM
OPEN	2,000 OHM
LINE OPEN	INFINITE
LINE SHORT	0

2 TYP 20DI SUPERVISED SWITCH INPUT

SCALE: NONE

LBNL ELECTRICAL STANDARDS
SECURITY CARD ACCESS
TYP 20DI SUPERVISED SWITCH INPUT

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DIVISION

DRAWN BY
CHECKED BY
APPROVED BY
CAD FILE PATH
SCALE NTS
DATE
DRAWING NO. SEC144
PROJECT NO.
SHEET

T:\groups\ELECT\Romy\STD\Security Card\SEC144 TYP 20DI SUPERVISED SWITCH INPUT.dwg