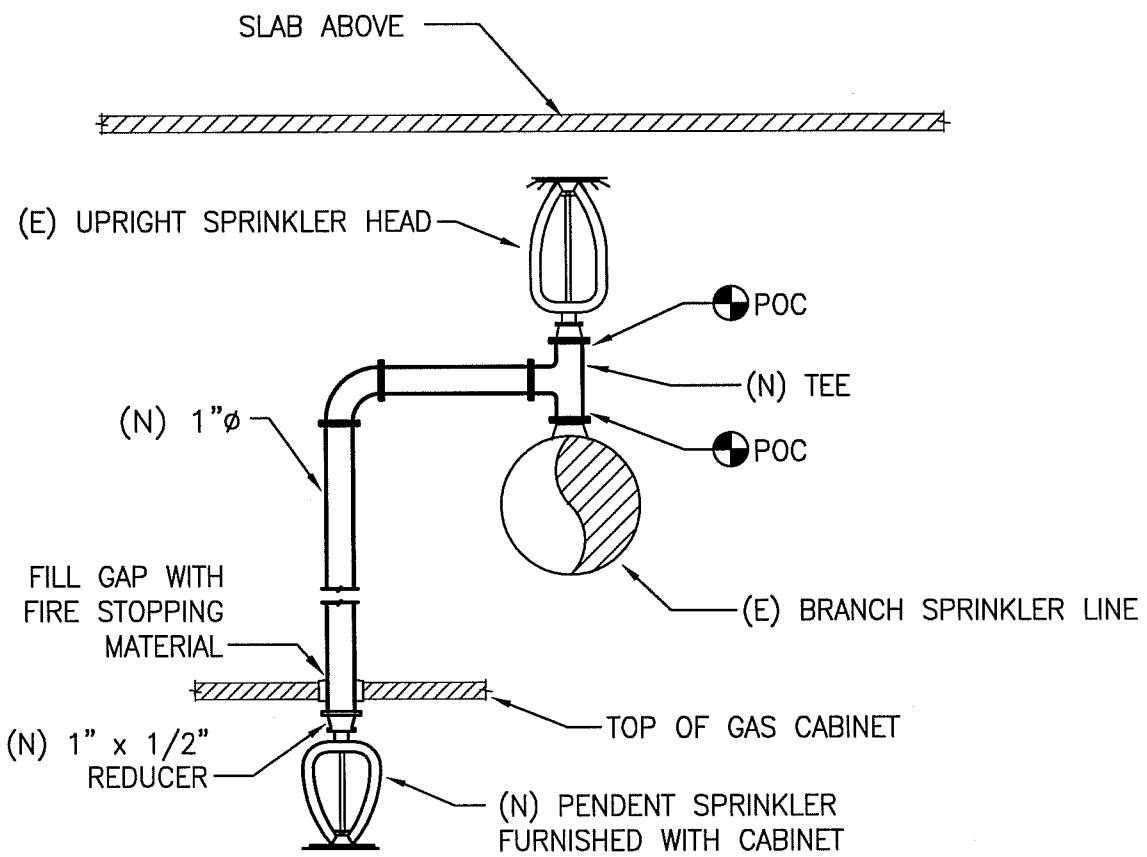

(N) SPRINKLER PIPES SHALL BE TESTED AT 200 PSI FOR 2 HOURS OR 50 PSIG ABOVE STATIC PRESSURE IF STATIC PRESSURE IS ABOVE 150 PSI.

X / XX

SPRINKLER CONNECTION DETAIL

SCALE: NTS

LBNL STANDARD SPRINKLER CONNECTION DETAIL	DRAWN BY	DATE
	CHECKED BY	
	APPROVED BY	
	CAD FILE PATH	
	SCALE NTS	
UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY FACILITIES DIVISION	DRAWING NO. FP105	SHEET
	PROJECT NO.	

T:\groups\ELECT\Romy\Mech_IHEM\FireProtection\FP105 FIRE-SPR-5.dwg