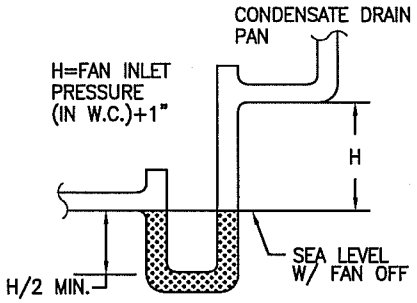

TRAP FOR DRAW-THRU UNIT, FAN OFF

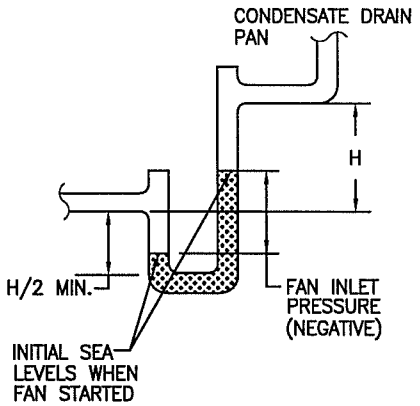

TRAP FOR DRAW-THRU UNIT, FAN OFF

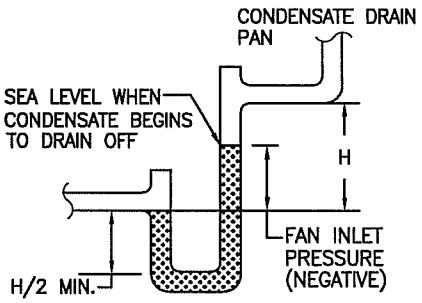

TRAP FOR DRAW-THRU UNIT, CONDENSATE BEGINNING TO DRAIN AWAY

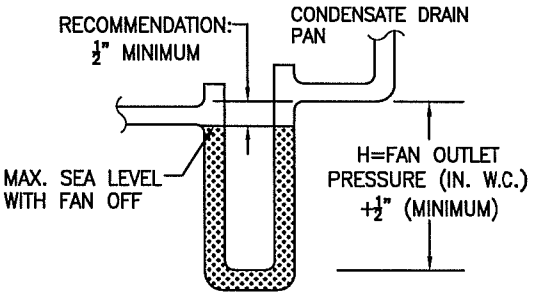

TRAP FOR BLOW-THRU UNIT, FAN OFF

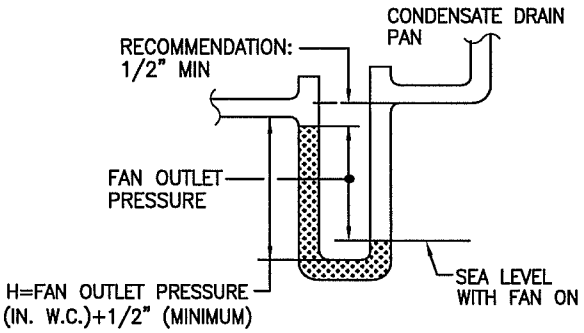

TRAP FOR BLOW-THRU UNIT, FAN RUNNING CONDENSATE BEGINNING TO DRAIN AWAY

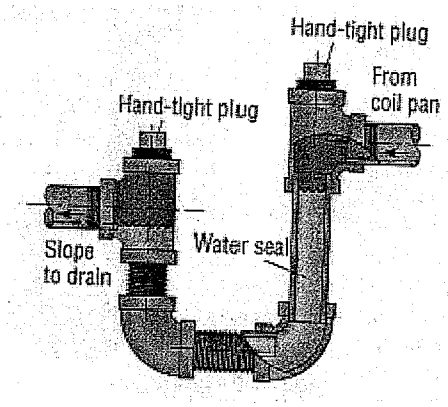

RECOMMENDED USE OF FEES AND PLUGS

X/XX **CONDENSATE TRAPS FOR COOLING COILS**

SCALE: NONE

LBNL STANDARD CONDENSATE TRAPS FOR COOLING COILS	DRAWN BY	DATE
	CHECKED BY	
	APPROVED BY	
	CAD FILE PATH	
	SCALE NTS	
UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY FACILITIES DIVISION	DRAWING NO. H114	SHEET
	PROJECT NO.	

T:\groups\ELECT\Romy\Mech_IHEM\HVAC_Details\H114 CONDENSATE-TRAPS-COOL-COILS.dwg