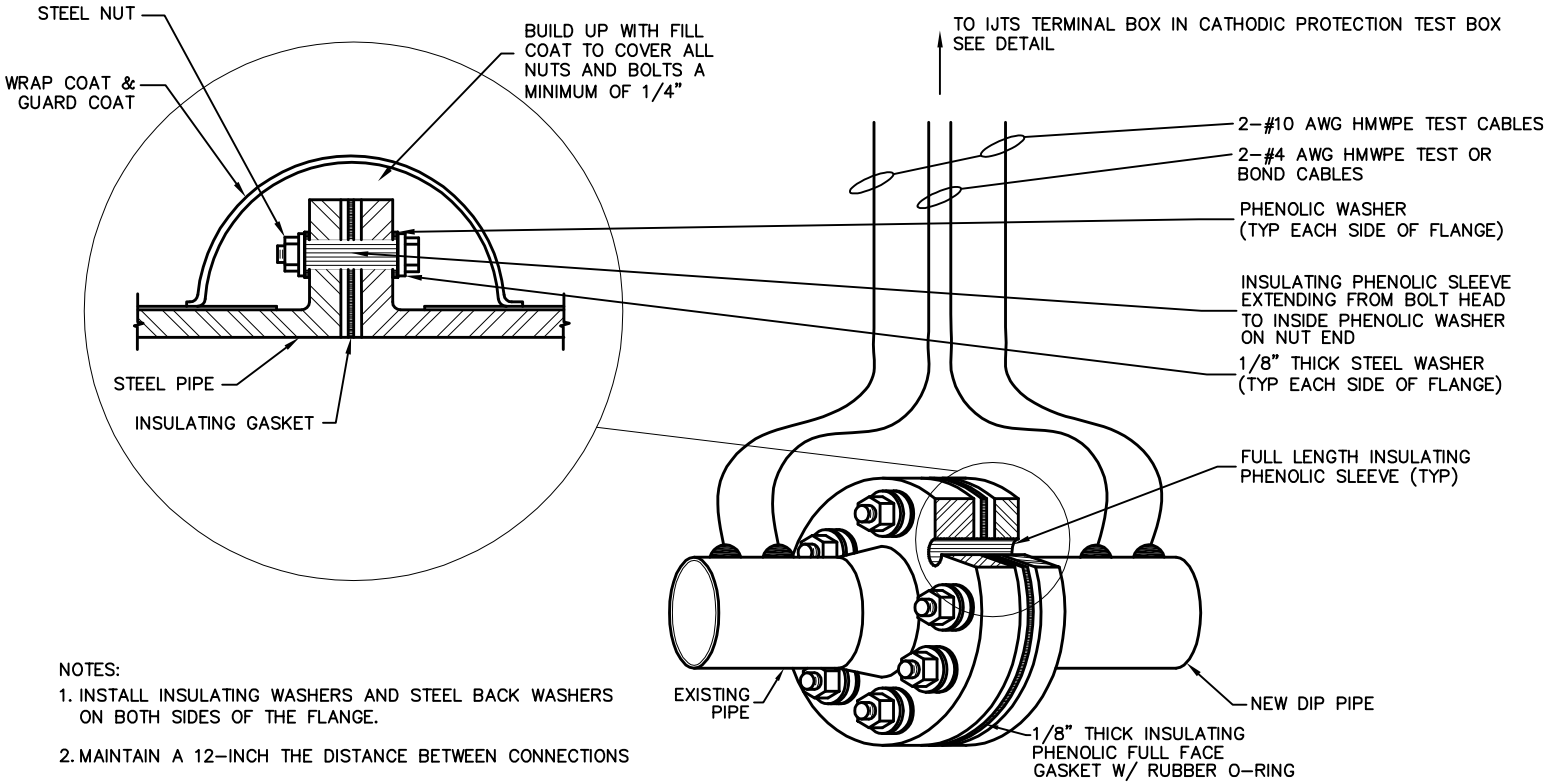

NOTES:

1. INSTALL INSULATING WASHERS AND STEEL BACK WASHERS ON BOTH SIDES OF THE FLANGE.
2. MAINTAIN A 12-INCH THE DISTANCE BETWEEN CONNECTIONS
3. GASKET SHALL BE FOR WATER SERVICE AND OF SAME PRESSURE RATING AS THE FLANGE.

X
XX

BELOW GRADE INSULATION FLANGE DETAIL

SCALE: NONE

SEE RELATED DETAILS U104 & U116

LBNL STANDARD

BELOW GRADE INSULATION FLANGE DETAIL

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY

FACILITIES DIVISION

DRAWN BY		DATE
CHECKED BY		
APPROVED BY		
CAD FILE PATH		
SCALE	NTS	
DRAWING NO.	U103	SHEET
PROJECT NO.		

G:\Capital Projects\Procedures, Standards & Forms\Standards\CDDG\CDDG_Vol 3_Const_Dts\Part-I - Civil_Site\SiteUtilities\U103 BELOW-GRADE-INSULAT-FLANGE-DETAIL.dwg