



NOTES:

1. ALL CAST IRON COVERS WILL BE MARKED "CP TEST 00#" (NUMBERING CONSECUTIVELY) WITH 2 INCH HIGH LETTERS.
2. ALL TEST STATIONS SHALL HAVE THE SAME LID LABEL.

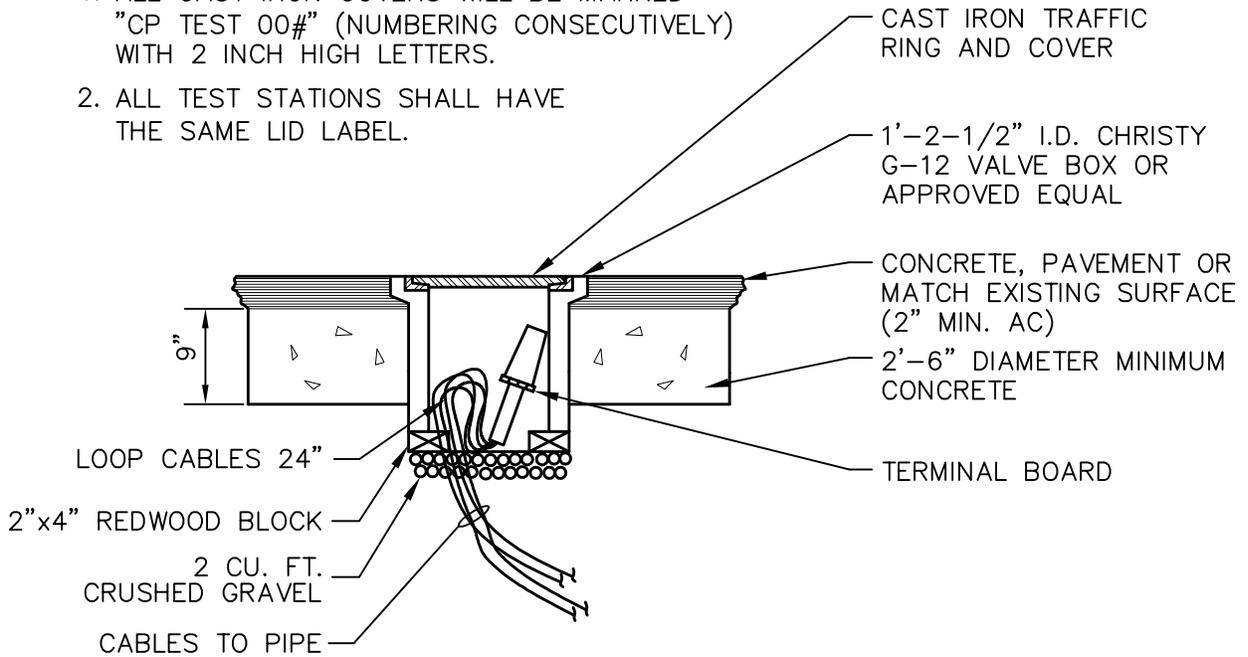

CATHODIC PROTECTION TEST BOX DETAIL

SCALE: NONE

LBNL STANDARD
CATHODIC PROTECTION TEST BOX DETAIL

DRAWN BY	DATE
CHECKED BY	
APPROVED BY	
CAD FILE PATH	
SCALE: NTS	
DRAWING NO.	SHEET
U 1 0 7	
PROJECT NO.	

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY
FACILITIES DIVISION