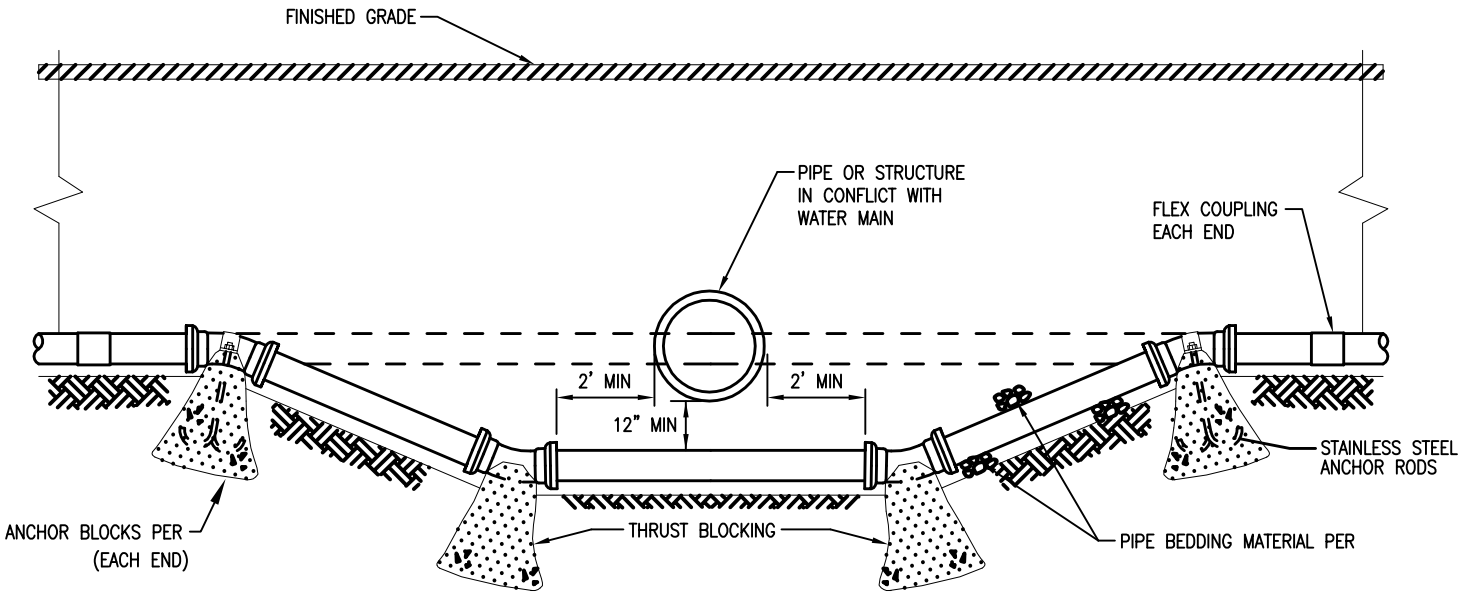

NOTES:

1. ALL PIPE & FITTINGS SHALL BE DUCTILE IRON & SHALL BE WRAPPED IN POLYETHELENE PER SPECIFICATIONS.
2. ONLY MECHANICAL JOINT FITTINGS WITH RETAINER GLANDS OR FLANGED FITTINGS MAY BE USED.
3. ALL BENDS SHALL BE 45° OR 22-1/2° FITTINGS.
4. REFER TO DRAWINGS C-3 TO C-21 FOR LOCATIONS.

X
XX

TYPICAL WATER MAIN INSTALLATION UNDER STRUCTURE

SCALE: NONE

LBNL STANDARD

TYPICAL WATER MAIN INSTALLATION UNDER STRUCTURE

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY

FACILITIES DIVISION

DRAWN BY		DATE
CHECKED BY		
APPROVED BY		
CAD FILE PATH		
SCALE	NTS	
DRAWING NO.	U148	SHEET
PROJECT NO.		

G:\Capital Projects\Procedures, Standards & Forms\Standards\CDDG\CDDG_Vol 3_Const_Dts\Part-I - Civil_Site\SiteUtilities\U148 TYPICAL WATER MAIN INSTALLATION UNDER STRUCTURE.dwg