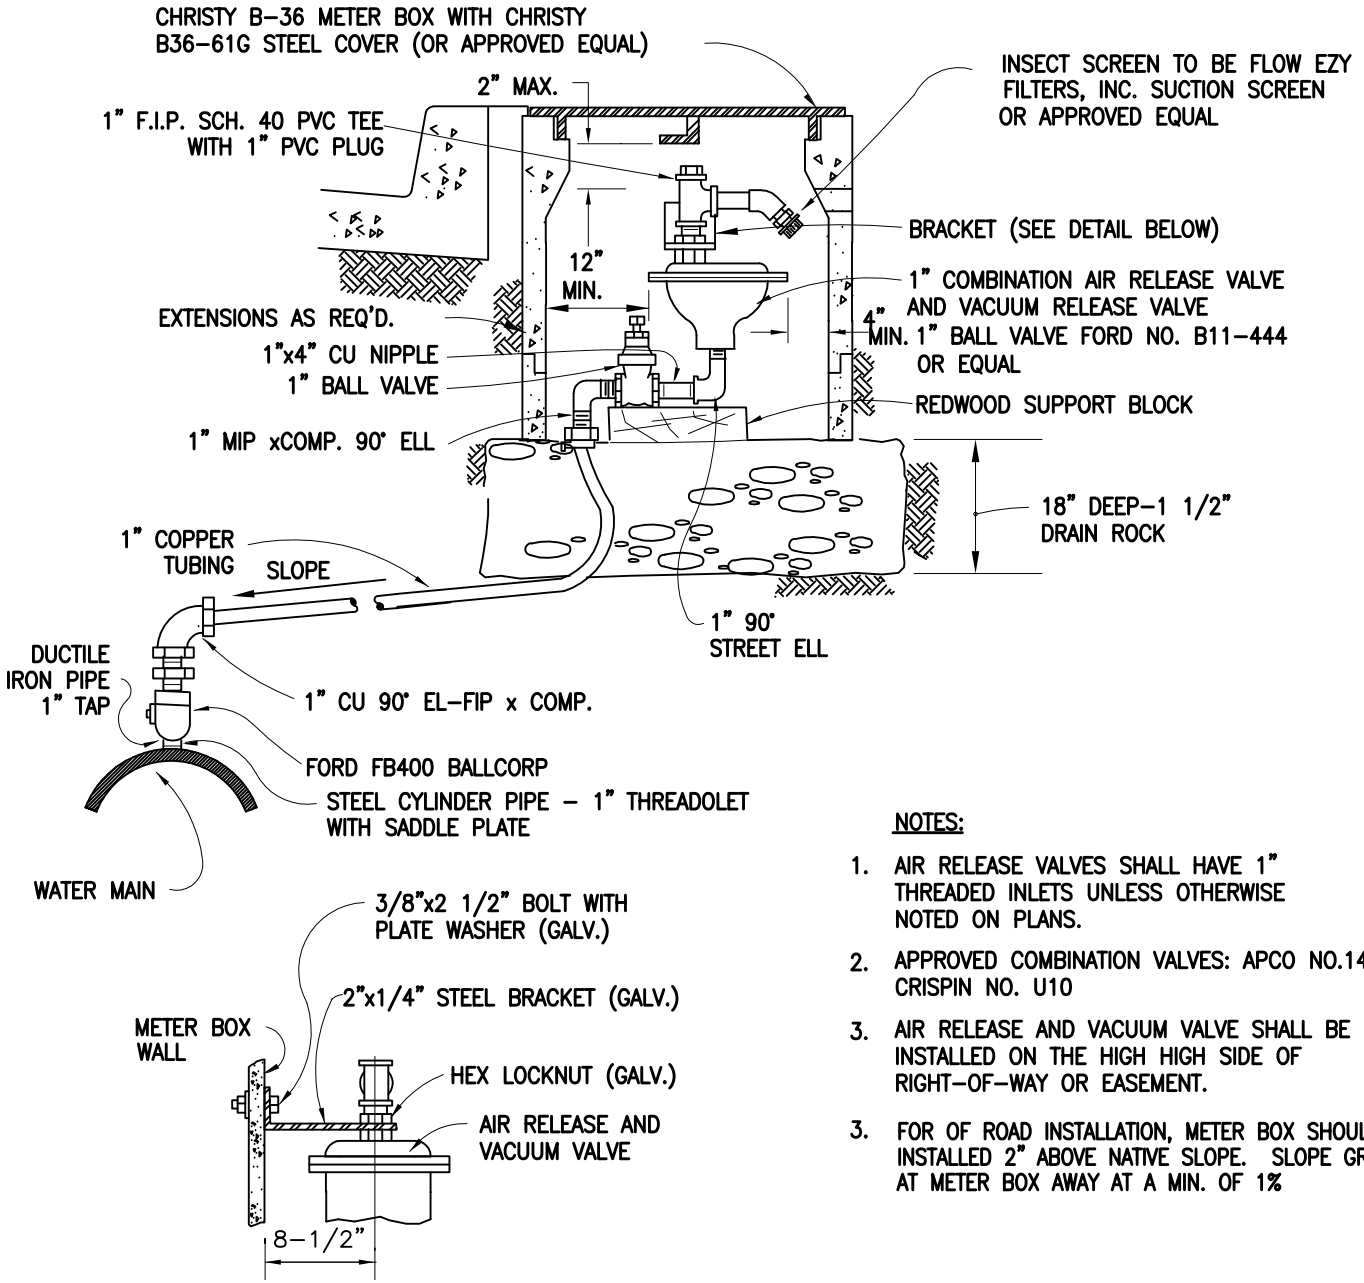

BRACKET DETAIL

NOTES:

1. AIR RELEASE VALVES SHALL HAVE 1" THREADED INLETS UNLESS OTHERWISE NOTED ON PLANS.
2. APPROVED COMBINATION VALVES: APCO NO.143C CRISPIN NO. U10
3. AIR RELEASE AND VACUUM VALVE SHALL BE INSTALLED ON THE HIGH HIGH SIDE OF RIGHT-OF-WAY OR EASEMENT.
3. FOR OF ROAD INSTALLATION, METER BOX SHOULD BE INSTALLED 2" ABOVE NATIVE SLOPE. SLOPE GRADE AT METER BOX AWAY AT A MIN. OF 1%

LBNL STANDARD

COMBINATION AIR RELIEF VALVE

UNIVERSITY OF CALIFORNIA LAWRENCE BERKELEY NATIONAL LABORATORY

FACILITIES DIVISION

DRAWN BY RZT	CHECKED BY MCD	APPROVED BY MCD
DATE 11/18/2010	11/18/2010	11/18/2010

SCALE NOT TO SCALE

DRAWING NO. U151

PROJECT NO.

SHEET 1 OF 1

G:\Capital Projects\Procedures, Standards & Forms\Standards\CDDG\CDDG_Vol 3_Const_Dts\Part-I - Civil_Site\SiteUtilities\U151 COMBINATION ARV.dwg